

INFLOW DESIGN FLOOD CONTROL PLAN

CFR 257.82

Fly Ash Reservoir II

Cardinal Plant
Brilliant, Ohio

September, 2016

Prepared for: Cardinal Operating Company - Cardinal Plant
Brilliant, Ohio

Prepared by: Geotechnical Engineering Services
American Electric Power Service Corporation
1 Riverside Plaza
Columbus, OH 43215



GERS-16-061

INFLOW DESIGN FLOOD CONTROL PLAN
CFR 257.82
FLY ASH POND FAR II
CARDINAL PLANT

GERS-16-061

PREPARED BY




DATE

8/26/2016

Mohammad A. Ajlouni, Ph.D., P.E.

REVIEWED BY

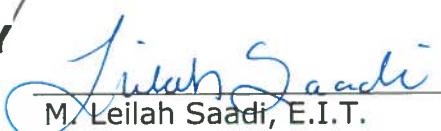


DATE

9/9/16

M. Leilah Saadi, E.I.T.

APPROVED BY




DATE

9/12/2016

Gary F. Zych, P.E.

Manager – AEP Geotechnical Engineering

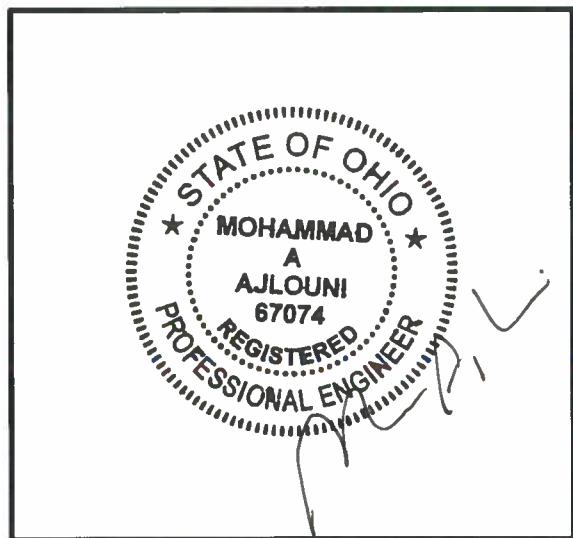

I certify to the best of my knowledge, information, and belief that the information contained in inflow design flood control plan meets the requirements of 40 CFR § 257.82

Table of CONTENTS

1.0 OBJECTIVE.....	1
2.0 DESCRIPTION OF THE CCR UNIT.....	1
3.0 INFLOW DESIGN FLOOD 257.82(a)(3).....	1
4.0 FLOOD CONTROL PLAN 257.82(c)	1

1.0 OBJECTIVE

This report was prepared by AEP- Geotechnical Engineering Services (GES) section to fulfill requirements of CFR 257.82 for the hydrologic and hydraulic evaluation of CCR surface impoundments.

2.0 DESCRIPTION OF THE CCR UNIT

The Cardinal Power Plant in Wells Township, Jefferson County, near the town of Brilliant in eastern Ohio. It is owned by Buckeye Power and AEP Generation Resources (GENCO) and is operated by Cardinal Operating Company. The facility operates two surface impoundments for storing CCR; the Bottom Ash Complex and Cardinal Fly Ash Reservoir II (FAR II) Dam. This report deals with the hydrologic and hydraulic evaluation for the Fly Ash Pond FAR II.

The FAR II Dam is a valley filled dam with a unique structure whose current configuration is the result of the original earth fill dam and two separate raisings. The original earth fill dam (Stage 1) consisted of a 180 feet high arched earth embankment incorporating a zoned cross section. At 925 feet NGVD, the dam featured a 70-foot wide by 1,055-feet long crest. The maximum operating pool that could be achieved with the original configuration was El. 913. In 1997, the original dam was raised, referred to as Stage 2. Following this raising, the dam was 237 feet high with a 30-foot wide crest. In 2013, the dam was raised 13 feet using back-to-back MSE walls, bringing the dam into its current, Stage 3 configuration. The principal features of the typical section are the MSE wall themselves and a vinyl sheet pile wall extending from the existing clay core to the top of the PMF flood level for seepage cutoff purposes. The FAR II Dam received sluiced fly ash and waste water from the plant via the bottom ash pond.

3.0 INFLOW DESIGN FLOOD 257.82(a)(3)

The facility is classified as a High Hazard Potential Dam. The Inflow Design Flood is the Probable Maximum Flood (PMF).

4.0 FLOOD CONTROL PLAN 257.82(c)

All storm water runoff from the watershed drains into the reservoir created by the Fly Ash Pond Dam. The design spillway system has enough capacity to pass the probable maximum flood without overtopping the dam. The design is based on the normal pool being at maximum normal operating pool and utilizing only the emergency spillway to handle the PMF without overtopping the crest of the dam. The water discharged through the emergency spillway is directed away from the dam such that it causes no threat to the stability of the structure.

The analysis in Attachment A includes excerpts of the 2013 design report and the associated report Appendix C that provides the description of the spillway system, flood storage capacity, inflow peak discharge and volume, peak discharge from the facility and maximum pool elevation.

The calculations show that the facility has the capacity to manage the inflow design flood.

ATTACHMENT A

Attachment A-1
Excerpts from 2013 Design Report
Hydrology and Hydraulics

4. HYDROLOGIC AND HYDRAULIC ANALYSIS

4.1 Introduction

The existing hydrologic conditions at the proposed dam site are described herein. Blockhouse Run, the major drainage feature in the project area, drains directly into the Ohio River. Approximately one mile upstream of the Ohio River, Blockhouse Run splits into two branches, designated as the East Branch and the West Branch.

The East Branch drains the eastern watershed as delineated in the Watershed Map on Plate 2 of Appendix C. The active fly ash dam II inundates the East Branch. The West Branch has been dammed to form the old Fly Ash Reservoir I (FAR I).

The location of the dam is shown on the drawings. Extension of the dam will inundate approximately 161 acres, or 24 percent of the area in the eastern watershed. Since the location of the dam is situated downstream of the discharge points of the old dam, runoff from the western watershed drains into the existing reservoir. Therefore, the spillway system of the proposed dam raising has been designed to meet ODNR Class I design criteria based on the runoff from both watersheds. The following sections present the hydrologic considerations and analyses performed during the design phase of this project.

4.2 Basin Characteristics

Figure 3.1 shows the limits of the watershed boundary for the existing Fly Ash Reservoir II(FAR II). The total drainage area above the dam has been divided into two watersheds, East and West, for analysis of the storm runoff entering the reservoir, as shown on Plate 2 of Appendix C.

A review of available topographic maps and aerial photos was made to determine essential basin characteristics for each watershed. Such characteristics include the drainage boundaries, areas, slopes, soil types, ground cover, land use and the time of concentration. The time of concentration is defined as the elapsed time for runoff to travel from the hydraulically most distant part of the watershed to some reference point downstream.

The old fly ash dam is located in the western watershed. Present land use within the drainage area is limited to reclaimed strip mine areas, some woodlands, and the inactive FAR I. Reclamation of the reservoir area is actively in progress in the form of a residual waste landfill above the level of the ponded fly ash. A built-out landfill condition was also analyzed for the western watershed, using the 2005 FAR I PTI. The PTI listed a Curve Number (CN) of 74, therefore the composite CN of the current FAR I condition of 75 was used. See Plates 4 through 6 of Appendix C.

Woodlands and scattered reclaimed strip mines constitute the existing land use in the East watershed. Construction of the proposed fly ash dam raising will inundate approximately 161 acres at Elevation 974.0 feet NGVD, the maximum operating pool elevation.

Soil types in the areas have been identified by the Soil Conservation Service (SCS) of the U.S. Department of Agriculture and classified into hydrologic soil groups. Within the study area, all soils fall under the hydrologic soil group B. Table 4.2.1, below, lists the basin characteristics for the Western and Eastern watersheds.

Table 4.2.1 Basin Characteristics

BASIN CHARACTERISTICS	WATERSHED			
	WEST		EAST	
	Woods	Landfill	Woods	Reservoir
Drainage area (acres)	519	158	514	161
Average land slope %	30	n/a	25	n/a
Hydrologic soil group	C	C	C	n/a
SCS curve number (CN)	70	91	70	100
Composite CN	75		n/a	
Time of concentration (hours)	0.87		0.57	0.1
TOTAL AREA (acres)	677		675	

4.3 Characteristics of Proposed Reservoir

A previously referenced, Drawing No. 2 shows the location of the existing dam. Based on this layout, the reservoir will have the following surface areas and storage capacities - as shown below in Table 4.3.1.

Table 4.3.1 Surface Areas and Storage Capacities

ELEVATION (Ft. NGVD)	AREA (AC)	STORAGE (AC-FT)
Maximum Pool	161	11,868
Emerg. Spillway	165	12,200
Top of Dam	184	13,500

The area-capacity-elevation curve developed for this dam is shown on Plate 3 of Appendix C.

4.4 Design and Assumptions

Rainfall - runoff data was not available for the site because the streams flow intermittently. Therefore, runoff hydrographs were generated using the U.S. Army Corps of Engineers HEC-1 computer program. The SCS dimensionless unit hydrograph method was employed in the calculation of the hydrographs. For each watershed, separate runoff hydrographs were computed and then later combined to form a single inflow hydrograph for the proposed reservoir.

Runoff from the West watershed was analyzed based on current landfill construction activity. The landfill area was assumed to be in a disturbed (unvegetated) condition. A composite curve number was used to represent the unvegetated landfill and surrounding wooded areas. This is shown on Plate 4 of Appendix C.

In the East watershed, the reservoir surface is modeled as a subbasin to convert direct rainfall into a runoff hydrograph. The ash sluice water of 13.3 mgd (20.6 cfs) is represented as a base flow in the East watershed.

Once computed, the runoff hydrographs from the three subbasin watersheds are combined and routed through the reservoir.

4.4.1 Service Spillway

According to OAC 1501:21-13-04, design of the principal (service) spillway for class I dams must be such that the average frequency use of the emergency spillway is predicted to be less than once in fifty years. The estimated precipitation for a 50-year storm was obtained from the NOAA Atlas 14. For a 6-hour storm, the precipitation is 3.43 inches, whereas the 24-hour storm amount is 4.51 inches, as shown on Plate 9 of Appendix C.

Both 6-hour and 24-hour storm durations with average soil moisture conditions were checked. The 24-hour storm resulted in a higher maximum water surface, therefore this storm duration was used for developing the 50-year storm inflow hydrograph.

4.4.2 Emergency Spillway

OAC 1501:21-13-02 specifies that for class I dams, the spillway system shall safely pass the design flood equal to the probable maximum flood (PMF) without any overtopping of the dam. The PMF is the result of the probable maximum precipitation (PMP), defined as the greatest depth of precipitation for a given duration that is meteorologically possible for a given basin at a particular time of year. Generalized estimates of the PMP have been published by the

Hydrometeorological branch of the National Weather Service, as shown on Plates 11 and 12 of Appendix C. For the study area, a 6-hour PMP of 26.5 inches was used as the design rainfall event. The antecedent moisture conditions of the soil cover were assumed to be average.

The layout of the control section and outlet channel for the emergency spillway is shown on the Emergency Spillway Plan.

The emergency spillway control section will be a section of mass concrete at Elevation 975.5. It will have a bottom length of 108 feet and side slopes consisting of access ramps at 2 to 15% grades. Downstream of the access ramps and control section, vertical concrete retaining walls wrap into the spillway and guide flow down the channel. The width of the control section along the flow direction will be 15 feet. The downstream channel of the spillway will be stepped. Steps will be formed of the mass concrete beginning at the downstream end of the control section and tying-in to the existing RCC steps. The calculations show that flow downstream of the control section becomes supercritical. The spillway channel transitions from an approximate 3.5H:2V slope along the proposed concrete steps to a 5H:2V slope along the existing RCC steps..

4.5 Analysis

All reservoir flood routings were conducted using the HEC-1 computer program. The program routes floods through the reservoir by the modified Puls method. In general, reservoir storage data and either spillway dimensions or discharge-rating curves are supplied by the user.

4.5.1 Service Spillway

Analysis of the service spillway system consisted of routing the 50-year storm to establish the invert of the emergency spillway. A design for the service spillway was determined and a stage-discharge curve was computed. A maximum operating level of elevation 974 was predetermined based on the projected life of the dam raising. Reservoir routings of the 50-year storm were performed using the maximum operating level of the reservoir.

Inflow was calculated as weir flow over the 4-foot stop log. Above Elevation 976, flow will enter through the top of the vertical service spillway structure. This flow was analyzed as both weir and orifice flow. Rating calculations for the service spillway are included on Plates 13 through 19 of Appendix C.

4.5.2 Emergency Spillway

Hydrologic reservoir routings were conducted to analyze the emergency spillway and its ability to pass the probable maximum flood without overtopping the dam. A flat rectangular control section was designed with a width of 15 feet and length of 108 feet. Discharge over the spillway was rated based on calculations of critical depth using the Corps of Engineers HEC-RAS computer program. Cross sections were taken at changes in geometry, slope or surface roughness. Manning's n roughness coefficients were input based on the expected channel surface conditions. Based on literature (see Plates 40 through 42 of Appendix C), a relatively high Manning's roughness coefficient of $n=0.07$ was used to model the stepped spillway surface. As shown on the drawings, proposed reinforced concrete training walls extend from the crest of the dam to a point approximately 3 feet beyond the proposed stepped channel transitions into the existing steps. Downstream from the training walls section, the spillway width becomes 110 feet, consistent with the current configuration.

The calculated relationship between stage and discharge was then used in the routing process to determine the maximum discharge and pool elevation. This information was used as the emergency spillway rating and input into HEC-1.

Discharges from the emergency spillway are routed away from the dam through an existing outlet channel.

4.6 Results

4.6.1 Service Spillway-Hydraulic Capacity

The proposed new principal spillway is a vertical concrete shaft structure with a 4-foot wide opening on one side. The spillway shaft will tie into the existing inclined spillway structure. The existing structure drains into a 54-inch diameter Prestressed Concrete Cylinder Pipe (P.C.C.P.), which then ties into a 42-inch steel pipe extending down the dam. The existing energy dissipator at the outlet of the steel pipe will be utilized. During most of the operating conditions, discharge through the service spillway will be controlled by weir flow over the stop logs in the opening of the shaft. The maximum operating level is set at elevation 974.0 feet. This corresponds to a maximum stop log elevation of 972.5 based on the base inflow of 20.6 cfs.

The peak inflow during the 50-year, 24-hour storm is 486 cfs, which results from 4.51 inches of rainfall according to NOAA Atlas 14. The reservoir level will rise to elevation 975.2 feet based

on an initial pool level of elevation 974. The peak outflow from the dam will be 58 cfs. The HEC-1 output for the reservoir routings are contained on Plates 44 through 75 of Appendix C.

4.6.2 Service Spillway-Structural Capacity

The 54-inch P.C.C.P. portion of the service spillway was also analyzed for additional internal and external pressures due to the 13-foot dam raising. The pipe is installed under the dam embankment and was trenched into bedrock. Pipe crushing calculations were performed to analyze the additional loading on the pipe from the raised dam. Previous calculations (see 2000 As-Built Drawing No. 13-30043-5) indicate that the pipe was designed to handle 80 feet of overburden material at 125 pcf. The proposed top of dam will be 74.6 feet above the pipe, therefore the existing concrete pipe will be suitable to handle the additional load. Additional information on as-built drawing 13-30043-5 also indicates that the pipe is capable of handling internal pressure up to 35 psi. It is possible that at high headwater elevations, the spillway pipe could become pressurized. Under the maximum pool elevation of 983.0, the maximum static head on the downstream portion of the pipe would be 80.5 feet, or 34.9 psi. As the water will be flowing through the pipe, the actual pressure on the pipe will be less than this value; therefore the pressure should not exceed the pipe rating of 36 psi. See Plates 20 and 21 of Appendix C.

4.6.3 Emergency Spillway

The development of the PMF hydrograph indicates a peak inflow to the reservoir equal to 16,329 cfs. This value represents the combined hydrographs from the West and East watersheds. Values of the runoff from each watershed and the combined runoff are shown in Appendix C.

Based on the flood routing, the calculated peak discharge from the dam is 5,409 cfs at a maximum pool elevation of 981.9 feet NGVD. The PMF routing was also checked with the service spillway blocked, which resulted in a maximum pool elevation of 982.8 and 0.2 feet of freeboard.

Both 6-hour and 24-hour storm durations were checked. The 6-hour storm resulted in a higher maximum water surface, therefore this storm duration was used for developing the PMF inflow hydrograph.

Depth of flow in the spillway was determined based on the HEC-RAS analysis. In the proposed spillway section, the training walls were kept a minimum of 1 foot above the critical water surface depth of 4.5 feet, as shown on Plates 23 and 32 of Appendix C. The training wall height downstream of the steps transition was kept to a minimum of 1 foot above the resultant water

surface depth during the PMF event (2 to 2.5 feet). The existing wall height of 4 feet meets this requirement. The HEC-RAS output is presented as Plates 25 through 36 of Appendix C. The structural analysis of the raised emergency spillway is presented elsewhere in this report.

4.7 Summary and Conclusions

The hydrologic/hydraulic studies for the proposed dam raising included estimating the PMF and 50-year flood hydrographs and designing the emergency and service spillways. The U.S. Army Corps of Engineers computer programs HEC-1 and HEC-RAS were used in the analyses. The Hydrograph presented on Plate 43 of Appendix C displays the resultant inflow and outflow hydrographs from HEC-1 based on the PMF event. Table 4.7.1, gives a complete summary of the study.

The proposed spillway system has enough capacity to pass the probable maximum flood without overtopping the dam. The water discharged through the emergency spillway is directed away from the dam such that it causes no threat to the stability of the structure.

Table 4.7.1 Hydrologic/Hydraulic Summary for Proposed Raising Of Dam

HYDROLOGIC AND HYDRAULIC SUMMARY		
Drainage Area	AREA (AC)	2.2 Sq. Mi.
Design Floods (Inflow)		
	PMF Peak	16,329 cfs
	50-Yr Peak	547 cfs
Peak Discharge		
	PMF	5,409 cfs
	50-Yr	58 cfs
Maximum Pool Elevations, NVGD		
	PMF	981.9 ft
	50-Yr	975.2 ft
Emergency Spillway - Overflow Control Section - Concrete		
	Crest Elevation, NGVD	975.5 ft
	Bottom Width	105.0 ft
	Side Slopes	Vertical
Service Spillway - Size		
	Top of Vertical Concrete Structure	976.0 ft
	Stop Log Width	4.0 ft
	Conduit Size	54" & 42"
	Maximum Operating Pool Level, NGVD	974.0 ft

Attachment A-2

2013 Report Appendix C

Hydrologic and Hydraulics Analysis

APPENDIX C HYDROLOGIC AND HYDRAULIC ANALYSIS





Appendix C calculations checked and reviewed by:

Stephen J. Loskota
Stephen J. Loskota, P.E.
S&ME, Inc.

Appendix C calculations prepared by:

A.J. Smith
A.J. Smith, P.E.
S&ME, Inc.

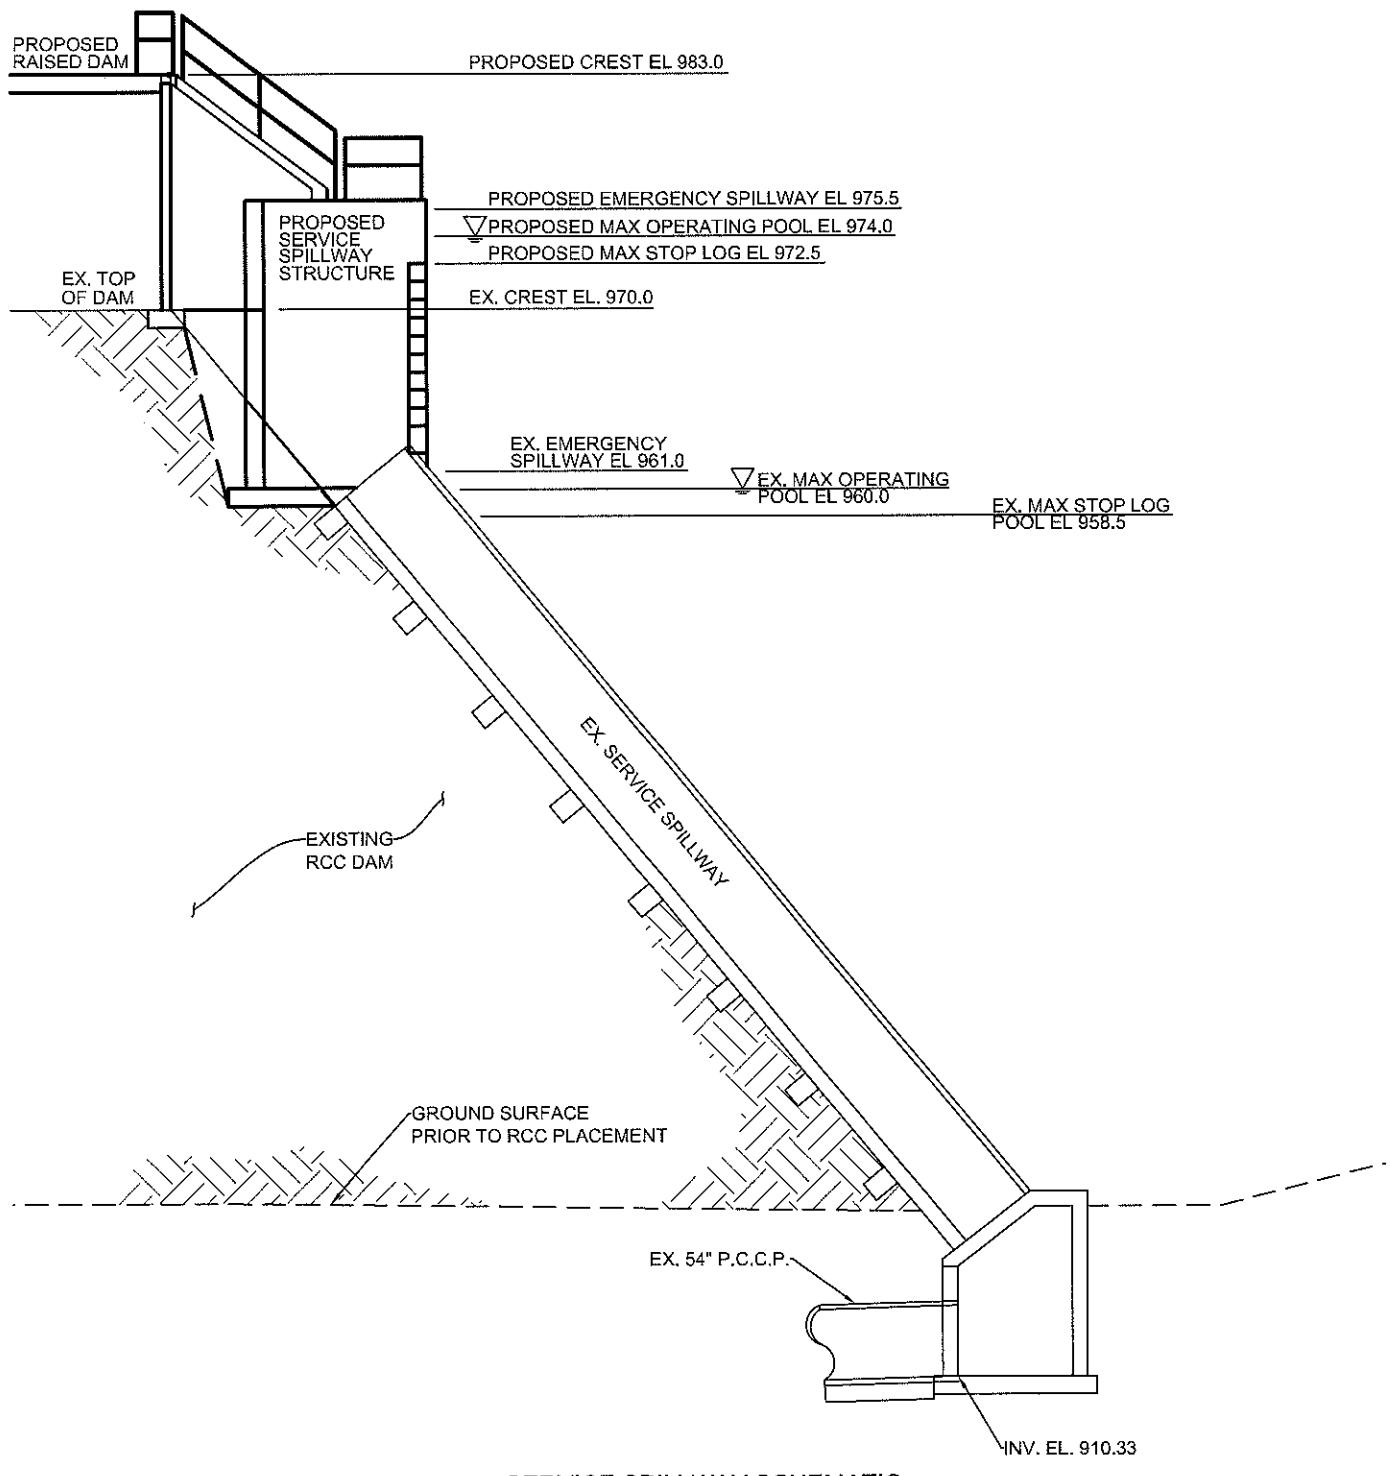

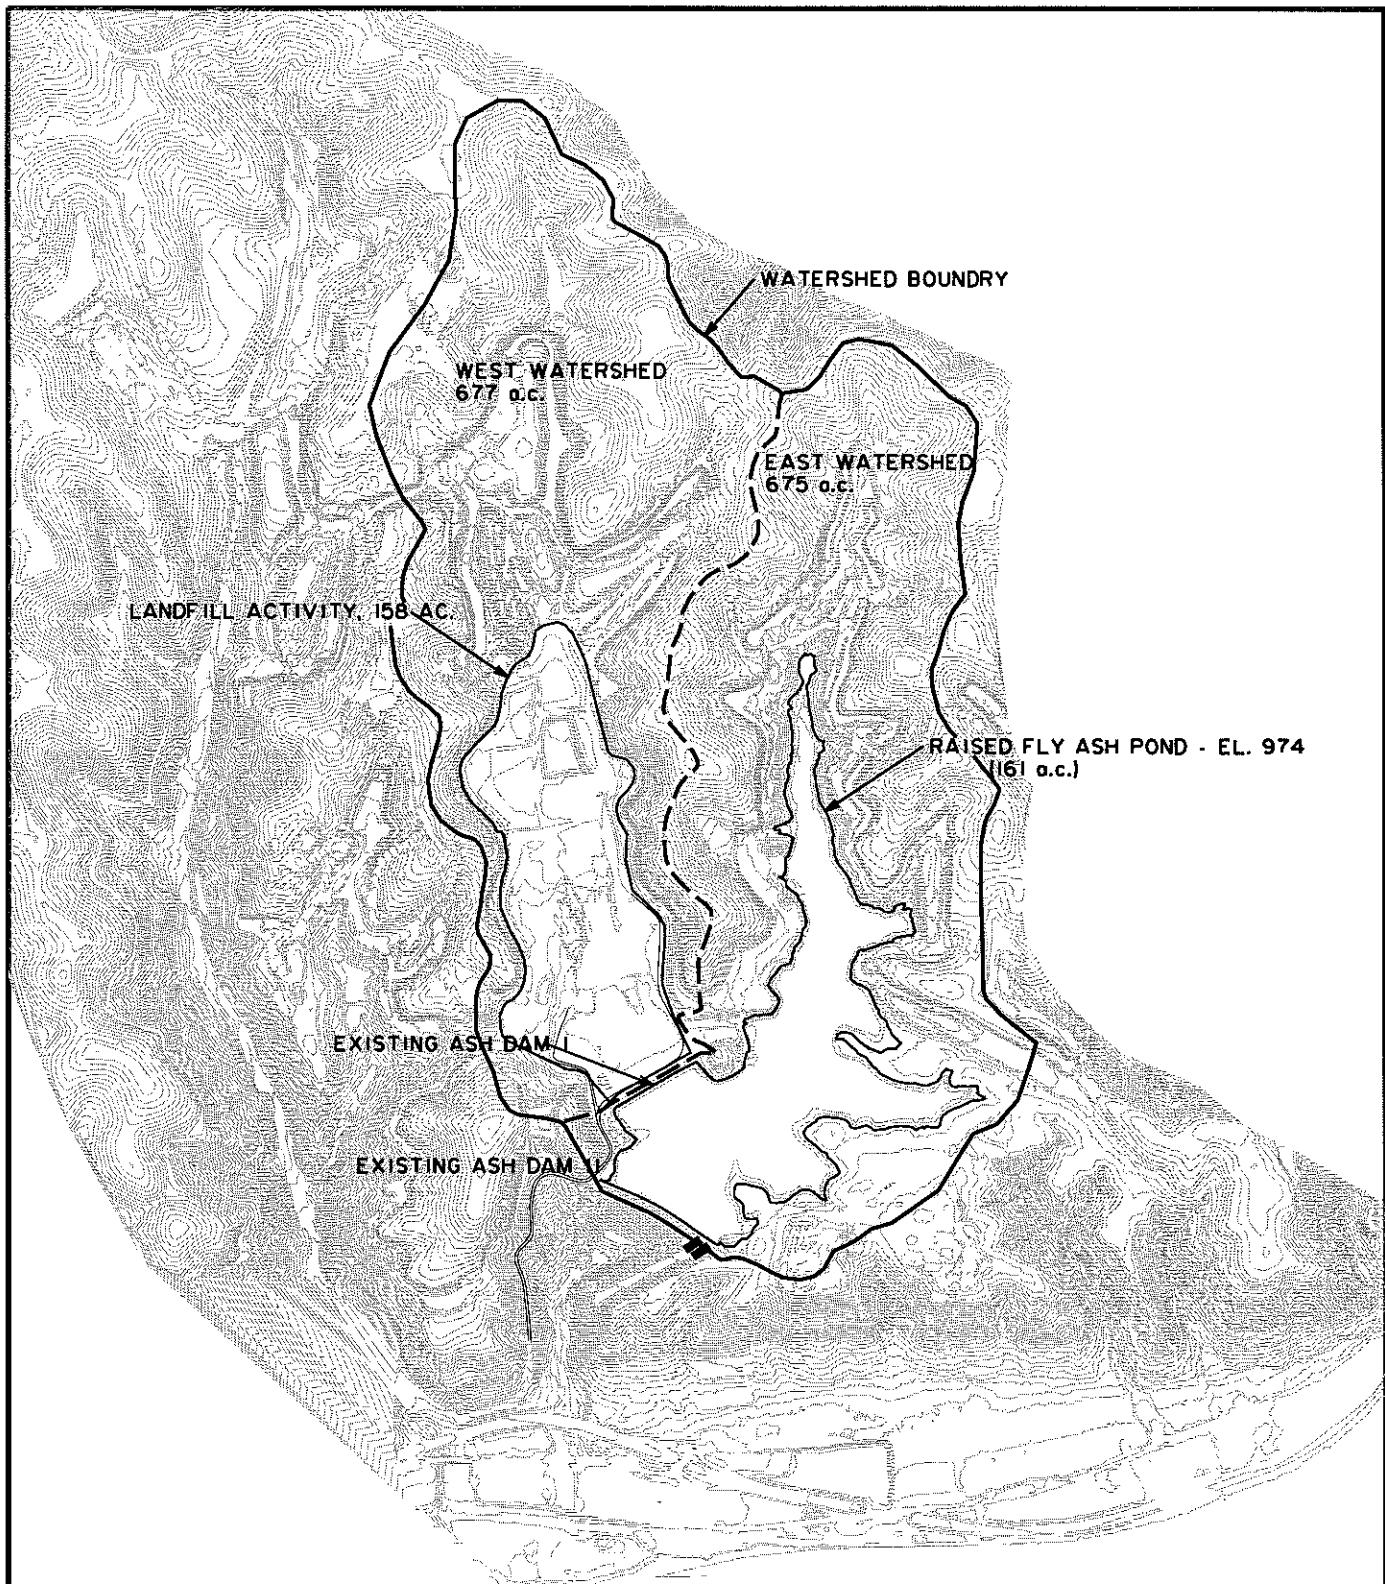

WATERSHED MAP	
CARDINAL PLANT FLY ASH RETENTION POND II BRILLIANT, OHIO	
Project: OII-11497-042	Drawn By: BAM
Drawing Date: 3/16/12	Approved By: AJS
Revision Date:	Scale: AS SHOWN

SCALE IN FEET
0 1000 2000




S&ME
WWW.SMEINC.COM

Storage Volume Calc
Cardinal Plant - Fly Ash Reservoir No. 2 Raising

Stage-storage for a dam raising design with a proposed crest at El. 983
 Area calculations above El. 970 (present crest) based on ground surface elevation contours
 Ground surface elevations taken from 2-foot contour interval base map from aerial photo dated 3-5-2009

	Elev	area (ft^2) (ft^2)	area (ac)	ave area (ft^2)	height (ft)	vol (ft^3) (ft^3)	Vol (ac-ft)	Cum Vol (ac-ft)	Total Vol (ac-ft)
ex. pool	960	5,903,719	135.5					0	9,800
	962	6,043,519	138.7	5,973,619	2	11,947,238	274	274	10,074
	964	6,186,216	142.0	6,114,867	2	12,229,735	281	555	10,355
	966	6,331,928	145.4	6,259,072	2	12,518,144	287	842	10,642
ex. crest	970	6,668,342	153.1	6,500,135	4	26,000,539	597	1,439	11,239
prop. pool	974	7,031,831	161.4	6,850,086	4	27,400,345	629	2,068	11,868
prop. E.S.	975.5	7,186,488 <i>(interpolated)</i>	165.0	7,212,264	0.5	3,606,132	83	2,395	12,195
	976	7,238,040	166.2	7,434,667	4	29,738,670	683	2,478	12,278
	980	7,631,295	175.2	7,820,348	3	23,461,043	539	3,160	12,960
prop. crest	983	8,009,400 <i>(interpolated)</i>	183.9	8,198,450	3	24,595,349	565	3,699	13,499
	986	8,387,500	192.6					4,263	14,063

Cardinal FAD 2 - Stage-Storage Curves

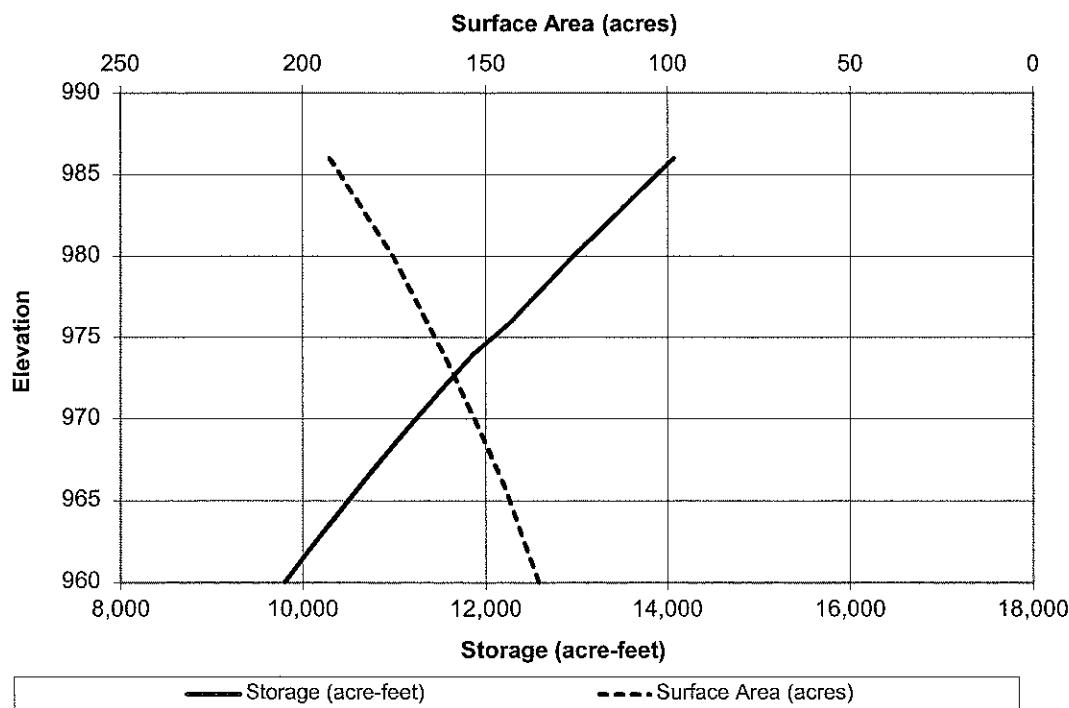

CARDINAL FAD 2

CALCULATE COMPOSITE CN - WEST WATERSHED

Based off of Worksheet 2 in Appendix D of 210-VI-TR-55, Second Ed., June 1986

Check FAR 1 Landfill Post-Development conditions:

From 2005 FAR 1 PTI by GeoSyntec, Post-Development conditions for the final cover system is a CN of **74**. (see attached)

Therefore, use current landfill construction condition of CN = 75.

Written by: William Steier Date: 2 October 2005 Reviewed by: Joo Chai Wong Date: _____Client: AEP Project: Cardinal Power Plant Project/Proposal No.:CHE8126 Task No.: _____

- **Hydrologic Soil Groups:**

Interim Conditions – Interim site conditions will include exposed temporary waste slopes. FGD waste material is assumed to exhibit similar characteristics to soils of Hydrologic Soils Group C.

Post-Development - Soil used to construct the final cover system will consist of low permeability material, which will exhibit characteristics of Hydrologic Soils Group C.

- **Curve Number (CN):**

Interim Conditions – For interim slopes, a CN of 91 is selected, the value recommended by SCS for hydrologic soil group C for “newly graded areas”.

Post-Development - For the final cover system, a curve number (CN) of 74 is used, the value recommended by SCS for hydrologic soil group C for “open spaces in good condition (grass cover > 75%)”. A summary of runoff CN values provided by SCS [SCS, 1986] are provided in Table 2.

- **Time of Concentration T_c :** The T_c value represents the total time for stormwater runoff to travel from the hydraulically most distant point of a watershed or drainage area to a point of interest. Factors affecting T_c include surface roughness, channel shape and flow patterns, and slope. For this analysis the calculation of T_c evaluates the impact of three different types of stormwater runoff flow:

- **sheet flow** – flow over plane surfaces, which is limited to a maximum length of 150 ft.;
- **shallow concentrated flow** – after about 150 ft., sheet flow will begin to concentrate, but not necessarily defined in a specific channel; and
- **channel flow** – flow that is confined to a defined channel section.

The T_c value for a drainage area is the sum of the individual various travel time (T_t) values of the above flow types. The equations for calculating the T_t are presented below

➢ **Sheet Flow:**
$$T_t = \frac{0.007 (nL)^{0.8}}{(P_2)^{0.5} s^{0.4}}$$

➢ **Shallow Concentrated Flow:**
$$T_t = \frac{L}{3,600 V}$$

Written by: William Steier Date: 2 October 2005 Reviewed by: Joo Chai Wong Dat

 Client: AEP Project: Cardinal Power Plant Project/Proposal No.:CHE8126 Ta

TABLE 2
Summary of Typical Runoff Curve Numbers

Table 2-2a Runoff curve numbers for urban areas¹

Cover type and hydrologic condition	Average percent impervious area ²	Curve numbers for hydrologic soil group—			
		A	B	C	D
<i>Fully developed urban areas (vegetation established)</i>					
Open space (lawns, parks, golf courses, cemeteries, etc.) ³ :					
Poor condition (grass cover < 50%)	68	79	86	89	
Fair condition (grass cover 50% to 75%)	49	69	79	84	
→ Good condition (grass cover > 75%)	39	61	74	80	
Impervious areas:					
Paved parking lots, roofs, driveways, etc. (excluding right-of-way)	98	98	98	98	
Streets and roads:					
Paved; curbs and storm sewers (excluding right-of-way)	98	98	98	98	
Paved; open ditches (including right-of-way)	83	89	92	93	
Gravel (including right-of-way)	76	85	89	91	
Dirt (including right-of-way)	72	82	87	89	
Western desert urban areas:					
Natural desert landscaping (pervious areas only) ⁴ ... (from FAR 1 PTI)	63	77	85	88	
Artificial desert landscaping (impervious weed barrier, desert shrub with 1- to 2-inch sand or gravel mulch and basin borders).	96	96	96	96	
Urban districts:					
Commercial and business.....	85	89	92	94	95
Industrial.....	72	81	88	91	93
Residential districts by average lot size:					
1/8 acre or less (town houses).....	65	77	85	90	92
1/4 acre	38	61	75	83	87
1/3 acre	30	57	72	81	86
1/2 acre	25	54	70	80	85
1 acre	20	51	68	79	84
2 acres	12	46	65	77	82
<i>Developing urban areas</i>					
Newly graded areas (pervious areas only, no vegetation) ⁵	77	86	91	94	
Idle lands (CN's are determined using cover types similar to those in table 2-2c).					

¹Average runoff condition, and $I_a = 0.2S$.

²The average percent impervious area shown was used to develop the composite CN's. Other assumptions are as follows: impervious areas are directly connected to the drainage system, impervious areas have a CN of 98, and pervious areas are considered equivalent to open space in good hydrologic condition. CN's for other combinations of conditions may be computed using figure 2-3 or 2-4.

³CN's shown are equivalent to those of pasture. Composite CN's may be computed for other combinations of open space cover type.

⁴Composite CN's for natural desert landscaping should be computed using figures 2-3 or 2-4 based on the impervious area percentage (CN = 98) and the pervious area CN. The pervious area CN's are assumed equivalent to desert shrub in poor hydrologic condition.

⁵Composite CN's to use for the design of temporary measures during grading and construction should be computed using figure 2-3 or 2-4, based on the degree of development (impervious area percentage) and the CN's for the newly graded pervious areas.

Table 2-2a Runoff curve numbers for urban areas^{1/}

Cover type and hydrologic condition	Cover description	Curve numbers for hydrologic soil group			
		A	B	C	D
<i>Fully developed urban areas (vegetation established)</i>					
Open space (lawns, parks, golf courses, cemeteries, etc.) ^{3/} :	Average percent impervious area ^{2/}				
Poor condition (grass cover < 50%)	68	79	86	89	
Fair condition (grass cover 50% to 75%)	49	69	79	84	
Good condition (grass cover > 75%)	39	61	74	80	
Impervious areas:					
Paved parking lots, roofs, driveways, etc. (excluding right-of-way)	98	98	98	98	
Streets and roads:					
Paved; curbs and storm sewers (excluding right-of-way)	98	98	98	98	
Paved; open ditches (including right-of-way)	83	89	92	93	
Gravel (including right-of-way)	76	85	89	91	
Dirt (including right-of-way)	72	82	87	89	
Western desert urban areas:					
Natural desert landscaping (perVIOUS areas only) ^{4/}	63	77	85	88	
Artificial desert landscaping (impervious weed barrier, desert shrub with 1- to 2-inch sand or gravel mulch and basin borders)	96	96	96	96	
Urban districts:					
Commercial and business	85	89	92	94	95
Industrial	72	81	88	91	93
Residential districts by average lot size:					
1/8 acre or less (town houses)	65	77	85	90	92
1/4 acre	38	61	75	83	87
1/3 acre	30	57	72	81	86
1/2 acre	25	54	70	80	85
1 acre	20	51	68	79	84
2 acres	12	46	65	77	82
<i>Developing urban areas</i>					
→ Newly graded areas (perVIOUS areas only, no vegetation) ^{5/}	77	86	91	94	
Idle lands (CN's are determined using cover types similar to those in table 2-2c).					

¹ Average runoff condition, and $I_a = 0.2S$.² The average percent impervious area shown was used to develop the composite CN's. Other assumptions are as follows: impervious areas are directly connected to the drainage system, impervious areas have a CN of 98, and perVIOUS areas are considered equivalent to open space in good hydrologic condition. CN's for other combinations of conditions may be computed using figure 2-3 or 2-4.³ CN's shown are equivalent to those of pasture. Composite CN's may be computed for other combinations of open space cover type.⁴ Composite CN's for natural desert landscaping should be computed using figures 2-3 or 2-4 based on the impervious area percentage (CN = 98) and the perVIOUS area CN. The perVIOUS area CN's are assumed equivalent to desert shrub in poor hydrologic condition.⁵ Composite CN's to use for the design of temporary measures during grading and construction should be computed using figure 2-3 or 2-4 based on the degree of development (impervious area percentage) and the CN's for the newly graded perVIOUS areas.

Table 2-2c Runoff curve numbers for other agricultural lands^{1/}

Cover type	Cover description	Hydrologic condition	Curve numbers for hydrologic soil group			
			A	B	C	D
Pasture, grassland, or range—continuous forage for grazing. ^{2/}	Poor	68	79	86	89	
	Fair	49	69	79	84	
	Good	39	61	74	80	
Meadow—continuous grass, protected from grazing and generally mowed for hay.	—	30	58	71	78	
Brush—brush-weed-grass mixture with brush the major element. ^{3/}	Poor	48	67	77	83	
	Fair	35	56	70	77	
	Good	30 ^{4/}	48	65	73	
Woods—grass combination (orchard or tree farm). ^{5/}	Poor	57	73	82	86	
	Fair	43	65	76	82	
	Good	32	58	72	79	
→ Woods. ^{6/}	Poor	45	66	77	83	
	Fair	36	60	73	79	
	Good	30 ^{4/}	55	70	77	
Farmsteads—buildings, lanes, driveways, and surrounding lots.	—	59	74	82	86	

^{1/} Average runoff condition, and $I_a = 0.2S$.^{2/} Poor: <50% ground cover or heavily grazed with no mulch.

Fair: 50 to 75% ground cover and not heavily grazed.

Good: >75% ground cover and lightly or only occasionally grazed.

^{3/} Poor: <50% ground cover.

Fair: 50 to 75% ground cover.

Good: >75% ground cover.

^{4/} Actual curve number is less than 30; use CN = 30 for runoff computations.^{5/} CN's shown were computed for areas with 50% woods and 50% grass (pasture) cover. Other combinations of conditions may be computed from the CN's for woods and pasture.^{6/} Poor: Forest litter, small trees, and brush are destroyed by heavy grazing or regular burning.

Fair: Woods are grazed but not burned, and some forest litter covers the soil.

Good: Woods are protected from grazing, and litter and brush adequately cover the soil.



NOAA Atlas 14, Volume 2, Version 3
 Location name: Mingo Junction, Ohio, US*
 Coordinates: 40.2666, -80.6517
 Elevation: 1001ft*
* source: Google Maps



POINT PRECIPITATION FREQUENCY ESTIMATES

G.M. Bonnin, D. Martin, B. Lin, T. Parzybok, M. Yekta, and D. Riley

NOAA, National Weather Service, Silver Spring, Maryland

[PF_tabular](#) | [PF_graphical](#) | [Maps & aerials](#)

PF tabular



Duration	PDS-based point precipitation frequency estimates with 90% confidence intervals (in inches) ¹									
	Average recurrence interval(years)									
1	2	5	10	25	50	100	200	500	1000	
5-min	0.320 (0.283–0.363)	0.383 (0.339–0.435)	0.463 (0.409–0.526)	0.524 (0.462–0.594)	0.603 (0.530–0.683)	0.663 (0.581–0.750)	0.720 (0.628–0.814)	0.780 (0.678–0.880)	0.859 (0.742–0.969)	0.916 (0.789–1.03)
10-min	0.497 (0.440–0.565)	0.598 (0.529–0.680)	0.720 (0.636–0.817)	0.809 (0.713–0.916)	0.922 (0.811–1.04)	1.01 (0.881–1.14)	1.09 (0.946–1.23)	1.16 (1.01–1.31)	1.26 (1.09–1.42)	1.33 (1.15–1.50)
15-min	0.610 (0.540–0.692)	0.731 (0.647–0.831)	0.883 (0.781–1.00)	0.995 (0.877–1.13)	1.14 (1.00–1.29)	1.24 (1.09–1.41)	1.35 (1.18–1.52)	1.45 (1.26–1.64)	1.58 (1.36–1.78)	1.67 (1.44–1.88)
30-min	0.807 (0.714–0.916)	0.979 (0.866–1.11)	1.21 (1.07–1.37)	1.38 (1.22–1.57)	1.61 (1.41–1.82)	1.78 (1.56–2.01)	1.95 (1.70–2.20)	2.11 (1.84–2.39)	2.34 (2.02–2.63)	2.50 (2.15–2.82)
60-min	0.985 (0.872–1.12)	1.20 (1.06–1.37)	1.52 (1.34–1.72)	1.76 (1.55–1.99)	2.09 (1.83–2.36)	2.34 (2.05–2.65)	2.60 (2.27–2.94)	2.87 (2.49–3.24)	3.23 (2.79–3.64)	3.51 (3.02–3.96)
2-hr	1.13 (0.992–1.31)	1.37 (1.20–1.58)	1.74 (1.52–2.00)	2.02 (1.76–2.32)	2.41 (2.10–2.76)	2.72 (2.37–3.12)	3.05 (2.63–3.48)	3.39 (2.91–3.86)	3.85 (3.28–4.38)	4.22 (3.58–4.80)
3-hr	1.21 (1.07–1.40)	1.46 (1.29–1.69)	1.84 (1.62–2.14)	2.14 (1.88–2.48)	2.56 (2.24–2.96)	2.90 (2.53–3.34)	3.26 (2.83–3.75)	3.63 (3.13–4.18)	4.15 (3.55–4.77)	4.56 (3.87–5.25)
6-hr	1.44 (1.28–1.65)	1.73 (1.54–1.98)	2.17 (1.93–2.47)	2.52 (2.24–2.87)	3.02 (2.67–3.43)	3.43 (3.01–3.88)	3.86 (3.37–4.37)	4.32 (3.75–4.87)	4.96 (4.26–5.59)	5.49 (4.67–6.17)
12-hr	1.70 (1.53–1.90)	2.04 (1.83–2.28)	2.52 (2.26–2.82)	2.91 (2.61–3.25)	3.49 (3.11–3.88)	3.97 (3.52–4.39)	4.47 (3.94–4.93)	5.01 (4.39–5.51)	5.79 (5.01–6.35)	6.42 (5.51–7.01)
24-hr	2.02 (1.87–2.18)	2.41 (2.24–2.61)	2.94 (2.74–3.18)	3.39 (3.14–3.65)	4.00 (3.70–4.31)	4.51 (4.15–4.85)	5.04 (4.62–5.40)	5.59 (5.10–5.98)	6.37 (5.77–6.81)	6.99 (6.30–7.46)
2-day	2.37 (2.21–2.55)	2.82 (2.63–3.03)	3.42 (3.19–3.67)	3.90 (3.63–4.19)	4.57 (4.24–4.90)	5.11 (4.73–5.47)	5.67 (5.22–6.06)	6.24 (5.73–6.67)	7.04 (6.42–7.51)	7.66 (6.95–8.18)
3-day	2.53 (2.38–2.71)	3.01 (2.83–3.22)	3.63 (3.40–3.88)	4.12 (3.86–4.41)	4.81 (4.49–5.13)	5.36 (4.98–5.71)	5.92 (5.49–6.31)	6.50 (6.00–6.92)	7.29 (6.69–7.76)	7.92 (7.22–8.42)
4-day	2.70 (2.55–2.87)	3.21 (3.02–3.41)	3.84 (3.62–4.08)	4.35 (4.09–4.62)	5.05 (4.74–5.36)	5.61 (5.24–5.95)	6.18 (5.76–6.55)	6.76 (6.27–7.16)	7.55 (6.97–8.01)	8.17 (7.50–8.67)
7-day	3.25 (3.08–3.44)	3.84 (3.63–4.06)	4.55 (4.31–4.82)	5.12 (4.83–5.41)	5.88 (5.54–6.22)	6.48 (6.09–6.85)	7.09 (6.65–7.49)	7.71 (7.20–8.14)	8.52 (7.92–9.00)	9.14 (8.45–9.67)
10-day	3.74 (3.55–3.94)	4.41 (4.19–4.66)	5.18 (4.92–5.47)	5.78 (5.49–6.10)	6.59 (6.24–6.95)	7.22 (6.83–7.61)	7.85 (7.40–8.27)	8.47 (7.96–8.94)	9.29 (8.69–9.80)	9.91 (9.23–10.5)
20-day	5.24 (5.00–5.51)	6.16 (5.87–6.48)	7.13 (6.79–7.50)	7.89 (7.51–8.29)	8.89 (8.45–9.33)	9.64 (9.15–10.1)	10.4 (9.83–10.9)	11.1 (10.5–11.7)	12.0 (11.3–12.7)	12.7 (11.9–13.4)
30-day	6.58 (6.26–6.93)	7.70 (7.33–8.12)	8.83 (8.41–9.30)	9.72 (9.25–10.2)	10.9 (10.3–11.4)	11.7 (11.1–12.4)	12.6 (11.9–13.2)	13.4 (12.7–14.1)	14.4 (13.6–15.2)	15.2 (14.3–16.0)
45-day	8.42 (8.04–8.81)	9.82 (9.38–10.3)	11.1 (10.6–11.7)	12.1 (11.6–12.7)	13.4 (12.8–14.0)	14.4 (13.7–15.0)	15.3 (14.5–16.0)	16.1 (15.3–16.9)	17.2 (16.2–18.0)	17.9 (16.9–18.8)
60-day	10.1 (9.73–10.6)	11.8 (11.3–12.3)	13.3 (12.7–13.8)	14.4 (13.8–15.0)	15.8 (15.1–16.4)	16.8 (16.0–17.5)	17.7 (16.9–18.5)	18.6 (17.7–19.4)	19.6 (18.7–20.5)	20.3 (19.3–21.3)

¹ Precipitation frequency (PF) estimates in this table are based on frequency analysis of partial duration series (PDS).




Numbers in parenthesis are PF estimates at lower and upper bounds of the 90% confidence interval. The probability that precipitation frequency estimates (for a given duration and average recurrence interval) will be greater than the upper bound (or less than the lower bound) is 5%. Estimates at upper bounds are not checked against probable maximum precipitation (PMP) estimates and may be higher than currently valid PMP values.


Please refer to NOAA Atlas 14 document for more information.

[Back to Top](#)

PF graphical

PLATE 9

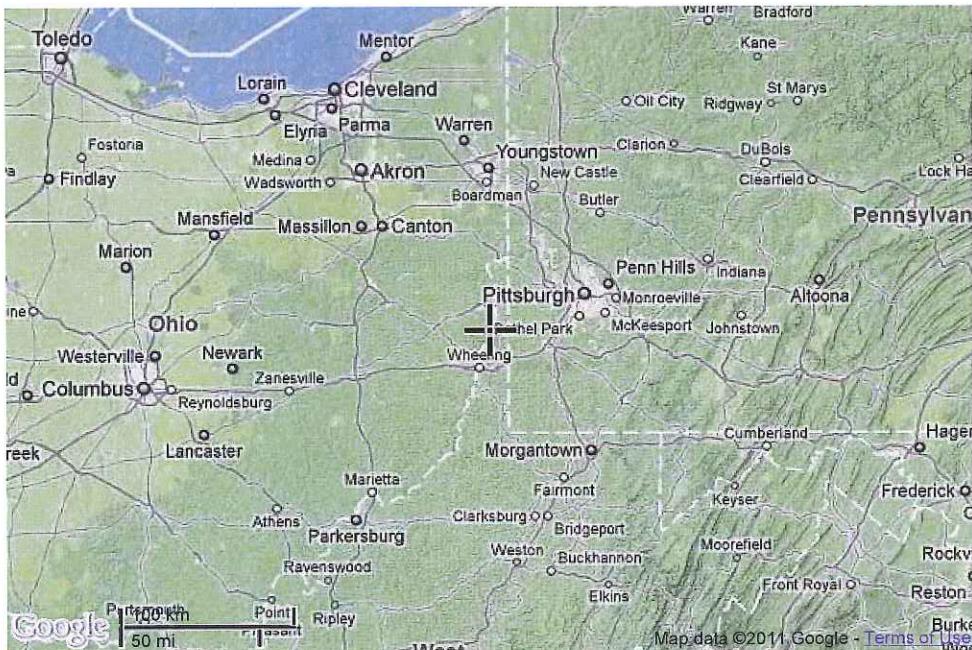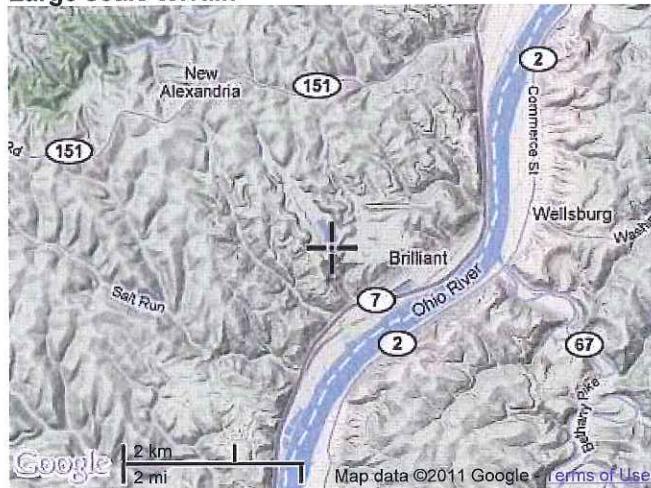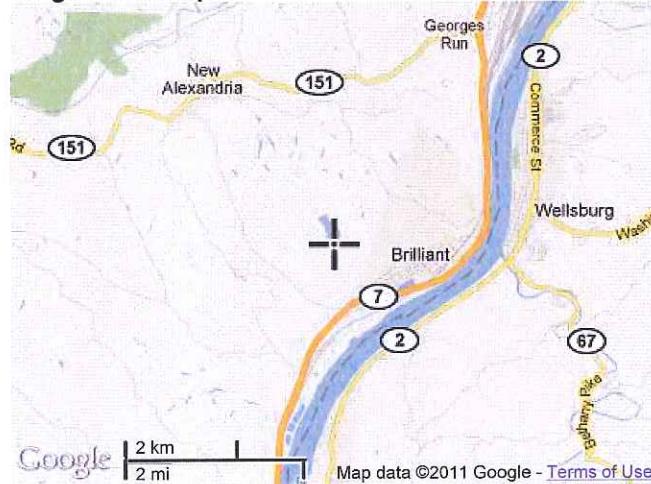**Large scale terrain****Large scale map****Large scale aerial**

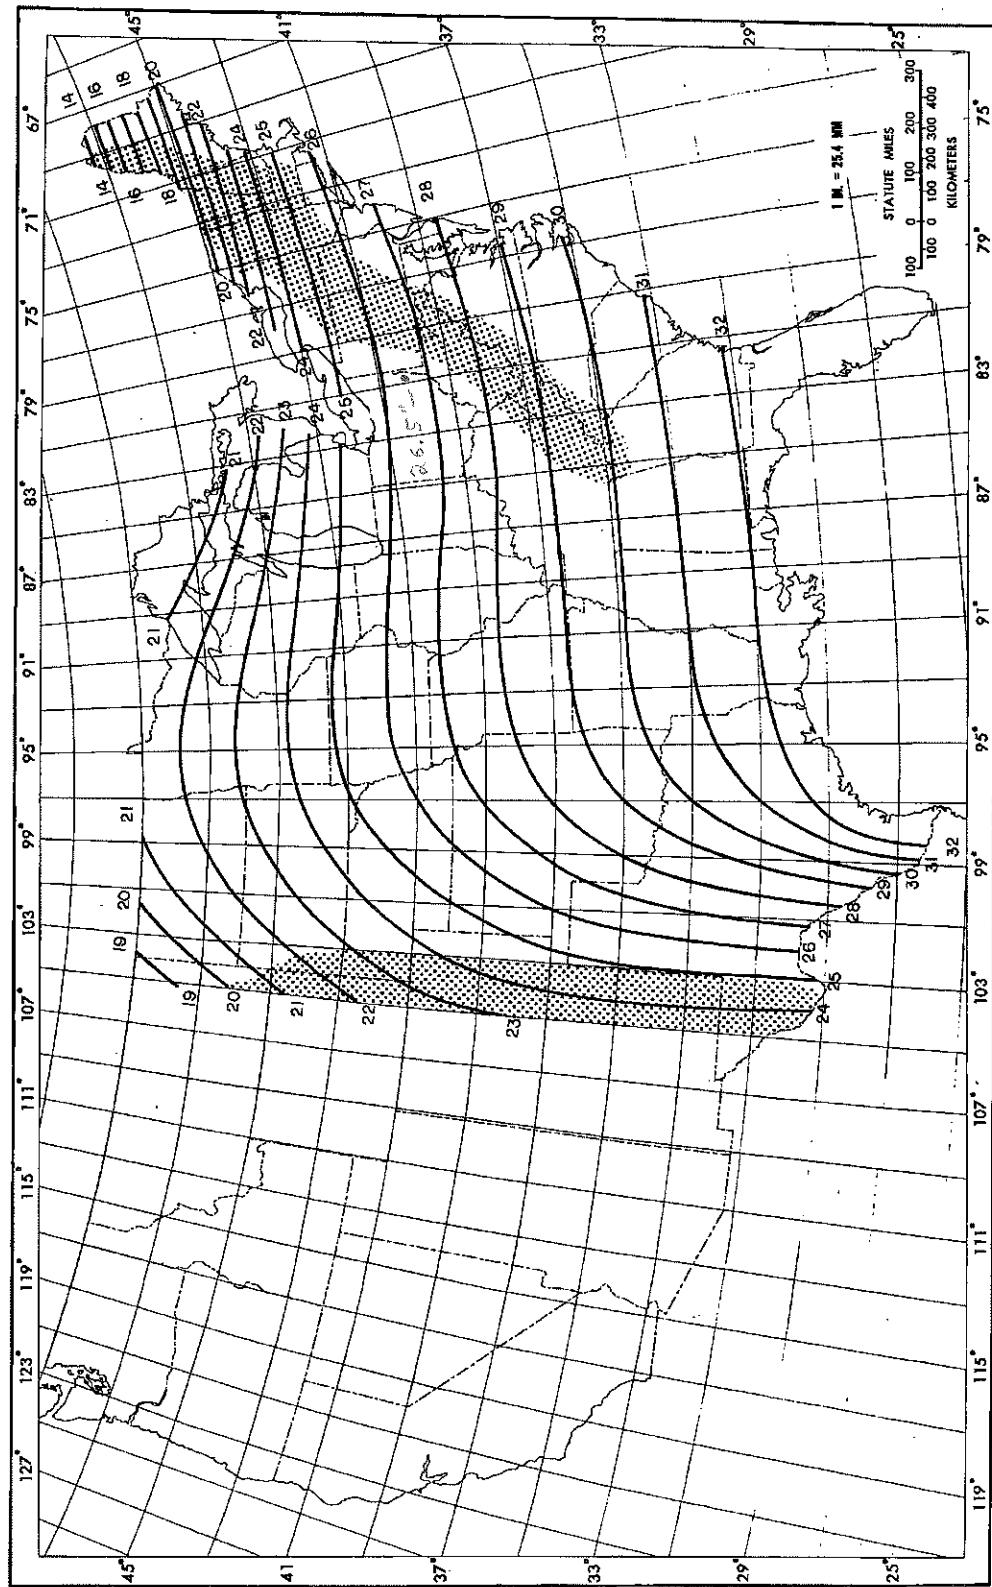

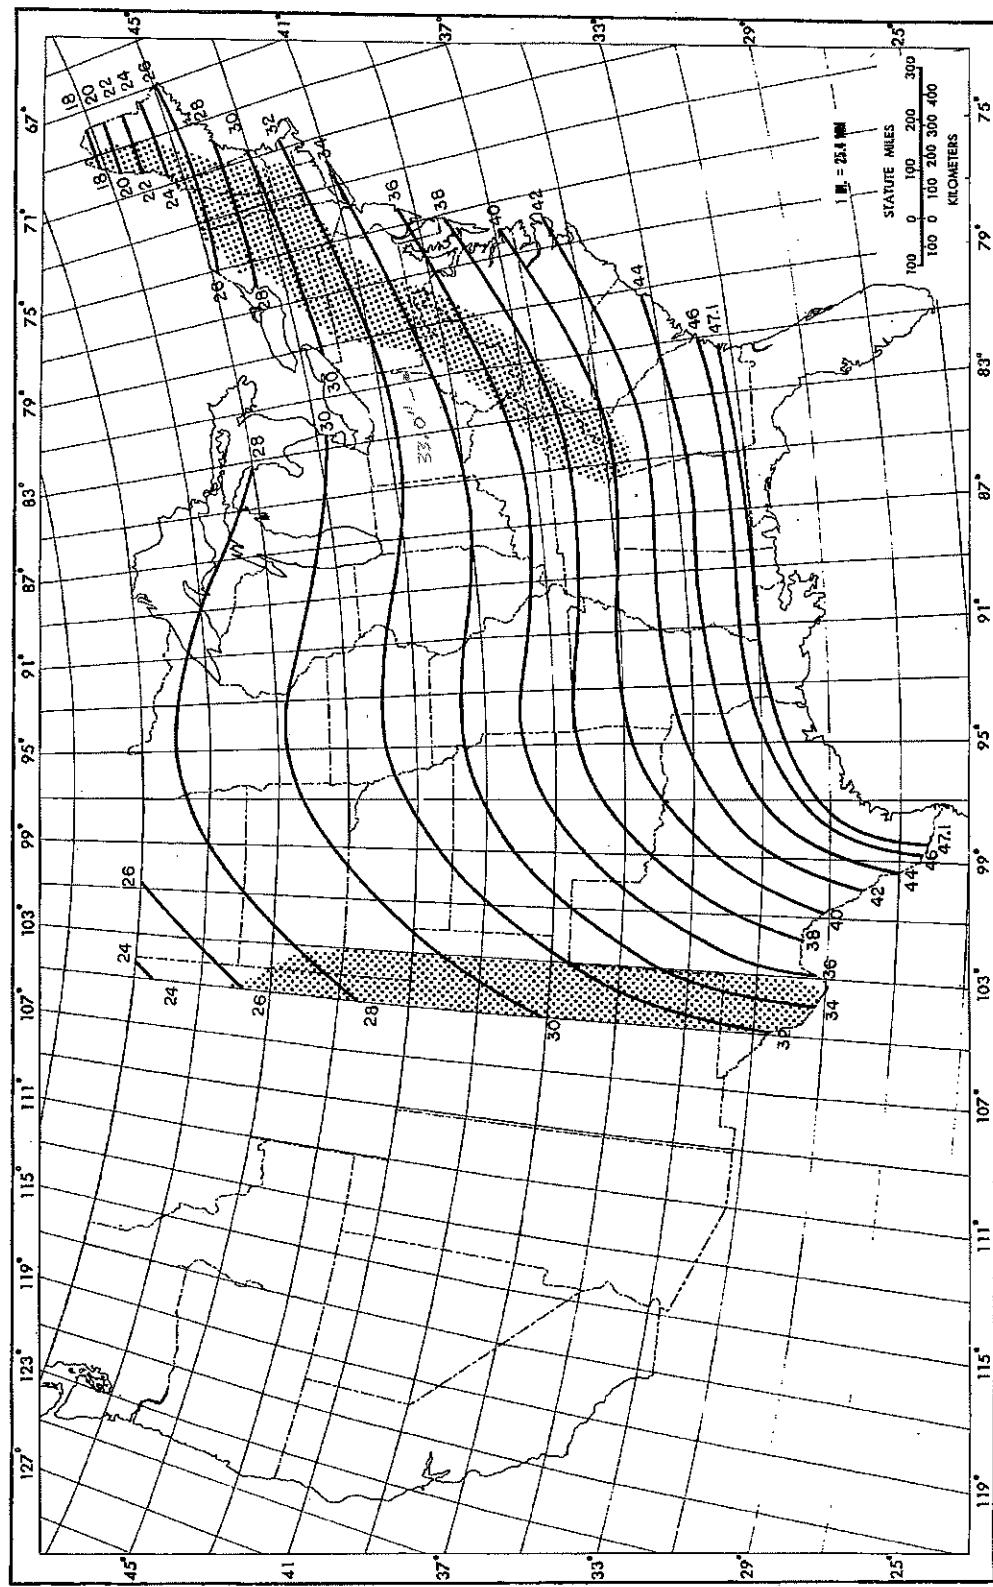


Figure 20.--All-season PMP (in.) for 24 hr 10 mi² (26 km²).

From HMR 17

Cardinal FAD 2 Dam Raising Spillway Capacity - Proposed Top of Dam El. 983, ES width = 105'

Top of Dam = 983,0

Cardinal FAD 2 Stop Logs Weir Rating Weir Flow

$$Q = C_{SCW} L H^{\frac{3}{2}}$$

$$C_{SCW} = 3.27 + 0.4 \left(\frac{H}{H_c} \right)$$

for $H/H_c < 0.3$, C_{SCW} becomes 3.33

L= 4.00

g= 32.2

Crest Elevation= 972.5

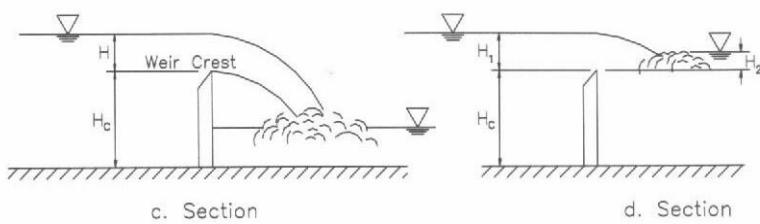


Figure 8-13. Sharp crested weirs.

Reference:
FHWA-SA-96-078
Urban Drainage Design Manual
Hydraulic Engineering Circular 22
November, 1996

**Cardinal FAD 2 Existing Spillway Pipe Rating
Pipe Inlet Control**

$$Q = CA\sqrt{2gh_1}$$

for C=0.62 orifice equation becomes:

$$Q = 3.91D^2 \sqrt{h_1}$$

d= 54.000	INCHES	54" PCCP
Invert Elevation = 910.33		

Headwater Elevation (ft.)	Orifice	
	Discharge (cfs)	Velocity (ft/s)
972.50	612.9	0.0
973.00	615.4	38.7
973.50	618.0	38.9
974.00	620.5	39.0
974.50	623.0	39.2
975.00	625.6	39.4
975.50	628.1	39.5
976.27	631.9	39.8
976.89	635.0	39.9
977.70	638.9	40.2
978.37	642.2	40.4
978.98	645.2	40.6
980.06	650.4	40.9
981.02	655.0	41.2
981.90	659.2	41.5
982.32	661.2	41.6
982.73	663.2	41.7
983.00	664.4	41.8

Reference:
FHWA-SA-96-078
Urban Drainage Design Manual
Hydraulic Engineering Circular 22
November, 1996

Cardinal FAD 2 Existing Spillway Pipe Rating

Pressure Pipe Flow Computed with the Energy Equation

(from inlet to outlet)

Manning's n= 0.015

Inlet Invert: 910

Outlet Invert (z_2): 736

Entrance Coefficient $K_e = 0.9$

Outlet Coefficient $K_o = 1.0$

MH Coefficient $K_{MH} = 0.5$

Bends Coefficient $K_b = 0.8$

Pipe Diameter in inches= 42

Pipe Diameter in feet (D)= 3.50

Pipe Eq. Length in feet (L)= 852

Darcy-Weisbach $f = 0.027$

The Darcy-Weisbach friction factor is related to Manning's n through the following equation:

$$f = \frac{185}{D} \frac{n^2}{\frac{1}{3}}$$

The Energy Equation is:

$$\frac{p_1}{\gamma} + \frac{v_1^2}{2g} + z_1 = \frac{p_2}{\gamma} + \frac{v_2^2}{2g} + z_2 + \sum h_L$$

Where:

$$\sum h_L = \frac{v^2}{2g} \left(f \frac{L}{D} + K_e + K_o + K_b \right)$$

Because p_1 , v_1 and p_2 all are equal to 0 the energy equation becomes:

$$z_1 - z_2 = \frac{v^2}{2g} + \frac{v^2}{2g} \left(f \frac{L}{D} + K_e + K_o + K_b \right)$$

Solving for v gives:

$$v = \sqrt{\frac{2g(z_1 - z_2)}{1 + \left(f \frac{L}{D} + K_e + K_o + K_b \right)}}$$

Determine flow rate Q by:

$$Q = VA$$

Cardinal FAD 2 Vertical Box Structure Overflow Rating Weir Flow

$$Q = C_{SCW} L H^{\frac{3}{2}}$$

$$C_{SCW} = 3.27 + 0.4 \left(\frac{H}{H_c} \right)$$

for $H/H_c < 0.3$, C_{SCW} becomes 3.33

Size= 5'-8" x 7'-6 " inside dimensions

L= 26.3

g= 32.2

Crest Elevation= 976.0

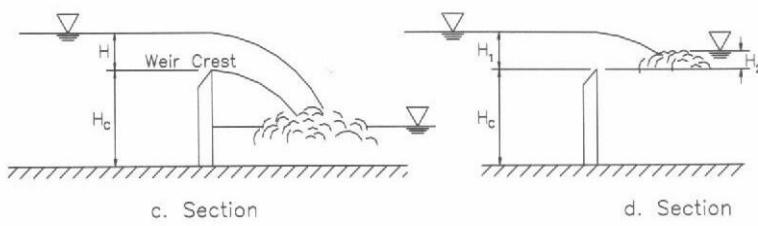


Figure 8-13. Sharp crested weirs.

Reference:
FHWA-SA-96-078
Urban Drainage Design Manual
Hydraulic Engineering Circular 22
November, 1996

Cardinal FAD 2 Vertical Box Structure Overflow Rating Orifice Flow

$$Q = CA\sqrt{2gh_1}$$

Size= 5'-8" x 7'-6 " inside dimensions

A= 42.5 S.F.

Grating % Open Area 60 %
Orifice Centroid Elevation = 976.0


Reference:
FHWA-SA-96-078
Urban Drainage Design Manual
Hydraulic Engineering Circular 22
November, 1996



Cincinnati (513) 771-8471
Cleveland (216) 901-1000
Columbus (614) 793-2226

Project/Proposal No. _____ Calculated By AJS Date _____
 Project/Proposal Name Cardinal Dam Checked By _____ Date _____
 Subject Pressure Pipe Flow Sheet _____ of _____

Cardinal Dam - Extended Service Spillway

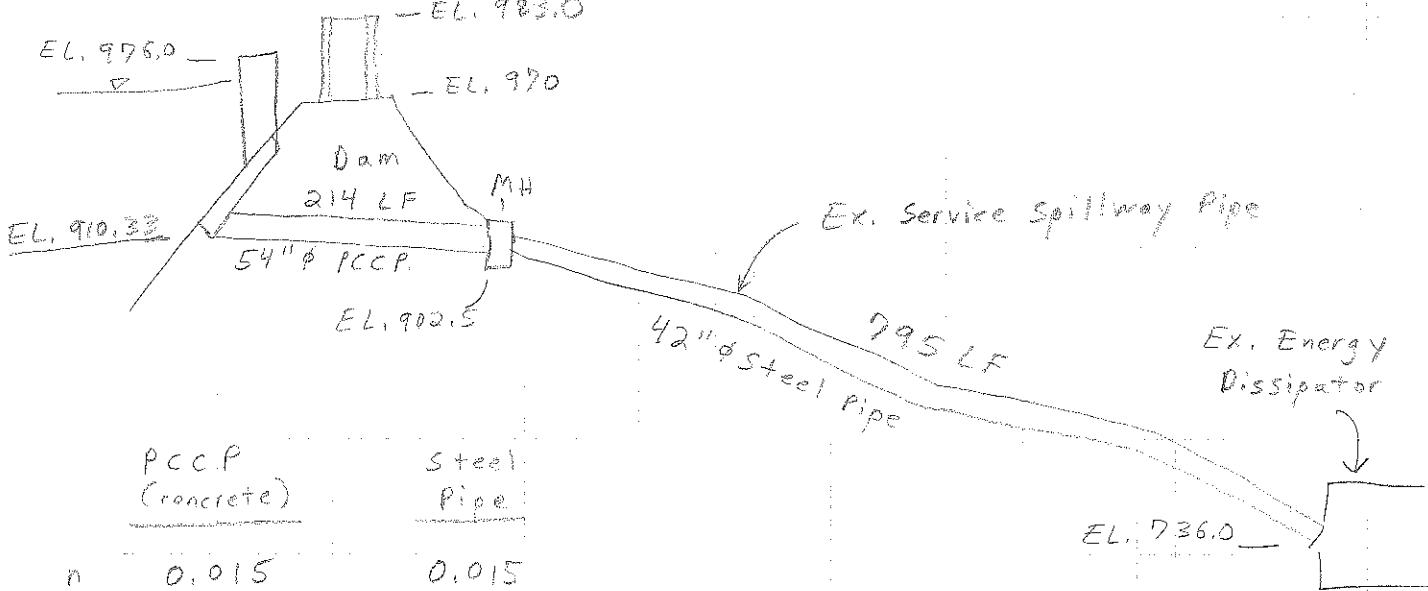

PCCP (concrete) Steel Pipe

$n = 0.015$ 0.015

$D = 54"$ $42"$

$f = 0.025$ 0.027

$L = 214'$ $795'$

$L_e = 57'$

$$f = 185n^2 \\ D^{1/3}$$

Equivalent Length of 54" pipe to 42":

$$L_e = L \left(\frac{f}{f_0} \right) \left(\frac{D_e}{D} \right)^5 \rightarrow \frac{f}{f_0} = 0.93$$

$$= (214 +) (0.93) (3.5/4.5)^5 = 57'$$

Outlet Control - Full Pipe Flow

$$\text{Headwater} = \text{Tailwater} + \frac{V^2}{2g} (1 + k_e + k_{MH} + k_{bends} + k_f + k_o)$$

$$k_e = 0.9$$

$$k_o = 1.0$$

$$k_f = f \left(\frac{L}{D} \right) = 0.027 \left(\frac{795+57}{3.5} \right) = 6.6$$

$$HW = TW + \frac{V^2}{2g} (1 + 0.9 + 0.5 + 4(0.2) + 6.6 + 1.0)$$

$$HW - TW = \frac{V^2}{2g} (10.8)$$

Let $TW = \text{crown of pipe} \approx 739.5$

$$\therefore \left(\frac{(HW - 739.5) 2g}{10.8} \right)^{1/2} = V ; V = 2.44 (HW - 739.5)^{1/2} \quad A = 9.621 \text{ ft}^2 \\ Q = VA$$


- See spreadsheet for HW vs. Q, stop log weir flow PLATE 19 until ~EL. 982

Reference 2000 As-Built Dwg. No. 13-30043-5 General Note 2)

Check pressure in 54" P.C.C.P. Pipe is rated for 35 psi.

Weir inlet should control except for higher headwaters.

Check pressure with headwater at Top of Dam (EL. 983.0)

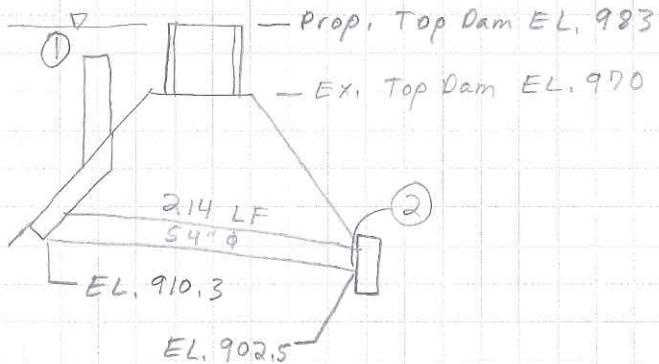

$$Z_1 = 983.0$$

$$Z_2 = 902.5$$

$$80.5'$$

Energy Equation:

$$\frac{P_1}{\gamma} + \frac{V_1^2}{2g} + Z_1 = \frac{P_2}{\gamma} + \frac{V_2^2}{2g} + Z_2 + \sum h_L ; \quad P_1, V_1 = 0$$

$$\frac{P_2}{\gamma} = (z_1 - z_2) - \frac{V_2^2}{2g} - \sum h_L$$

$$\frac{P_2}{62.4 \text{ lb/ft}^3} = (983.0 - 902.5) - \frac{V_2^2}{64.4} - \sum h_L$$

$$P_2 [\text{lb/in}^2] = 80.5(62.4) - \frac{V_2^2}{1.03} - \sum h_L (62.4)$$

$$P_2 [\text{lb/in}^2] = 34.9 - \frac{V_2^2}{148} - \frac{\sum h_L}{0.4}$$

$$80.5' = 34.9 \text{ psi}$$

$\therefore P_2 < 34.9 \text{ psi}$ with flow


$34.9 \text{ psi} < 35 \text{ psi}$ ✓

TASK: DETERMINE SUITABILITY OF EXISTING 54"Ø P.C.C.P SPILLWAY PIPE UNDER ADDITIONAL PROPOSED LOADING CONDITIONS.

RESULTS:


COVER OVER SPILLWAY PIPE INCLUDING ADDITIONAL CONCRETE = 74.6 FT. BASED ON DRAWING 13-30043-5, THE 54"Ø SPILLWAY PIPE WAS DESIGNED TO HANDLE 80 FT SO OUR ADDITIONAL COVER STILL FALLS WITHIN THE PIPE STRENGTH CAPACITY.

SKETCH OF EXISTING VS PROPOSED (NOT TO SCALE)

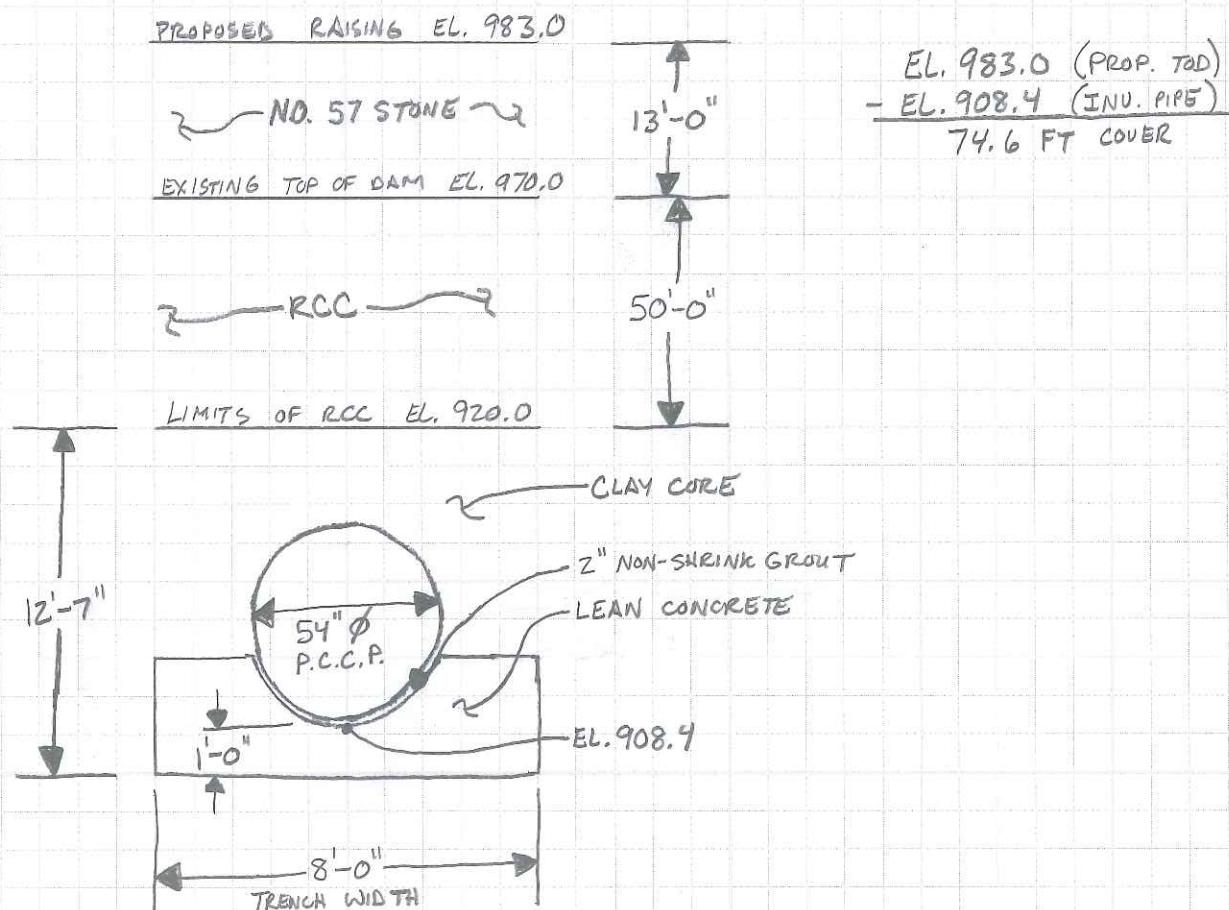

HEC-RAS Geometry

Emergency Spillway

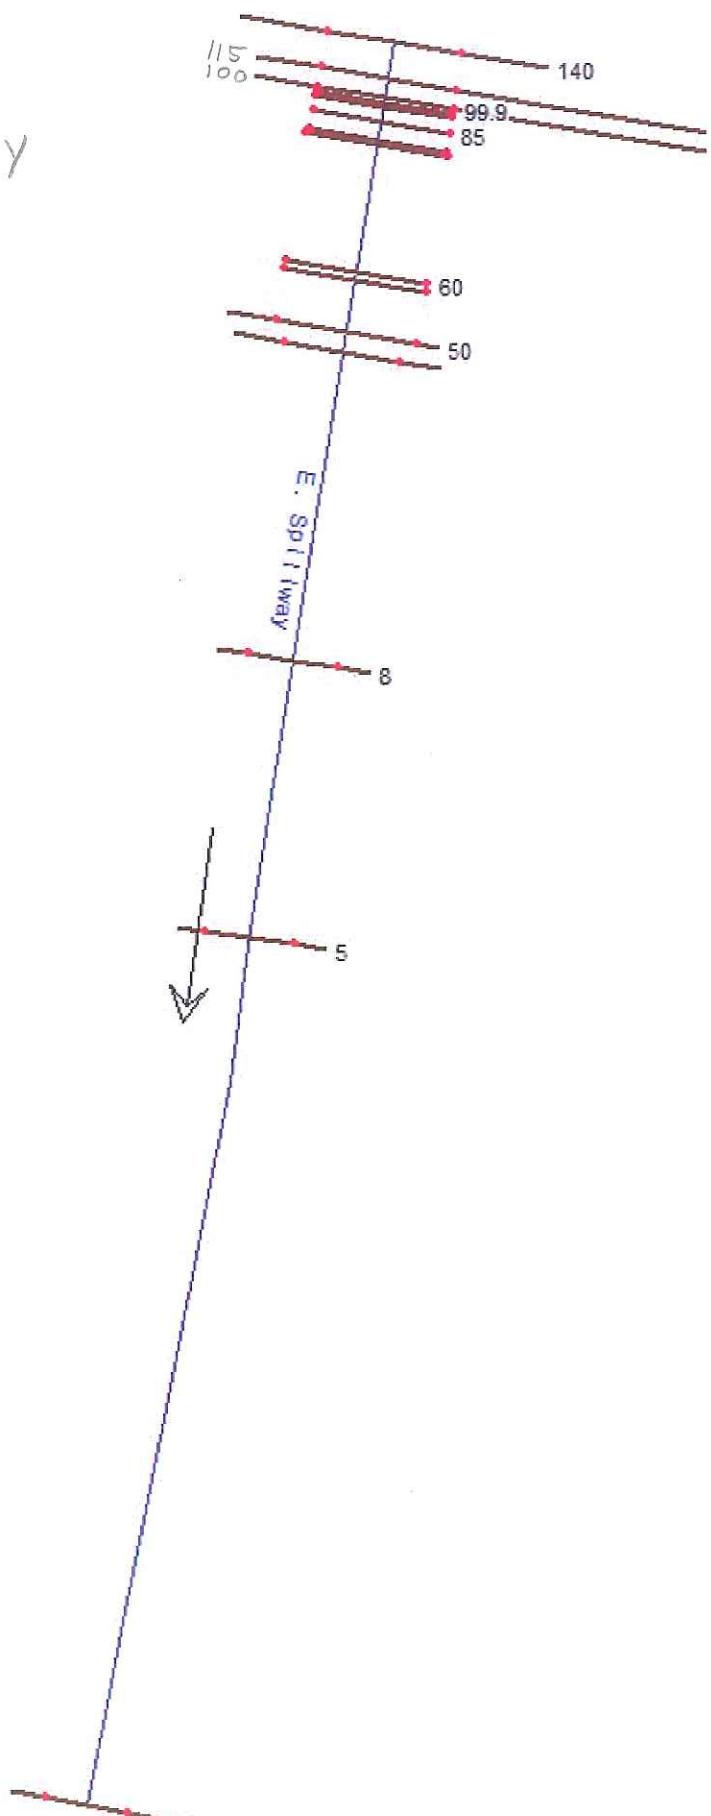


Schematic data outside default extents (see View/Set Schematic Plot Extents...)

The XS's are Geo-Referenced ( Geo-Ref user entered XS  Geo-Ref interpolated XS  Non Geo-Ref user entered XS  Non Geo-Ref interpolated XS)

PLATE 22f

HEC-RAS Cross-Section Stations on Proposed Energy Spillway

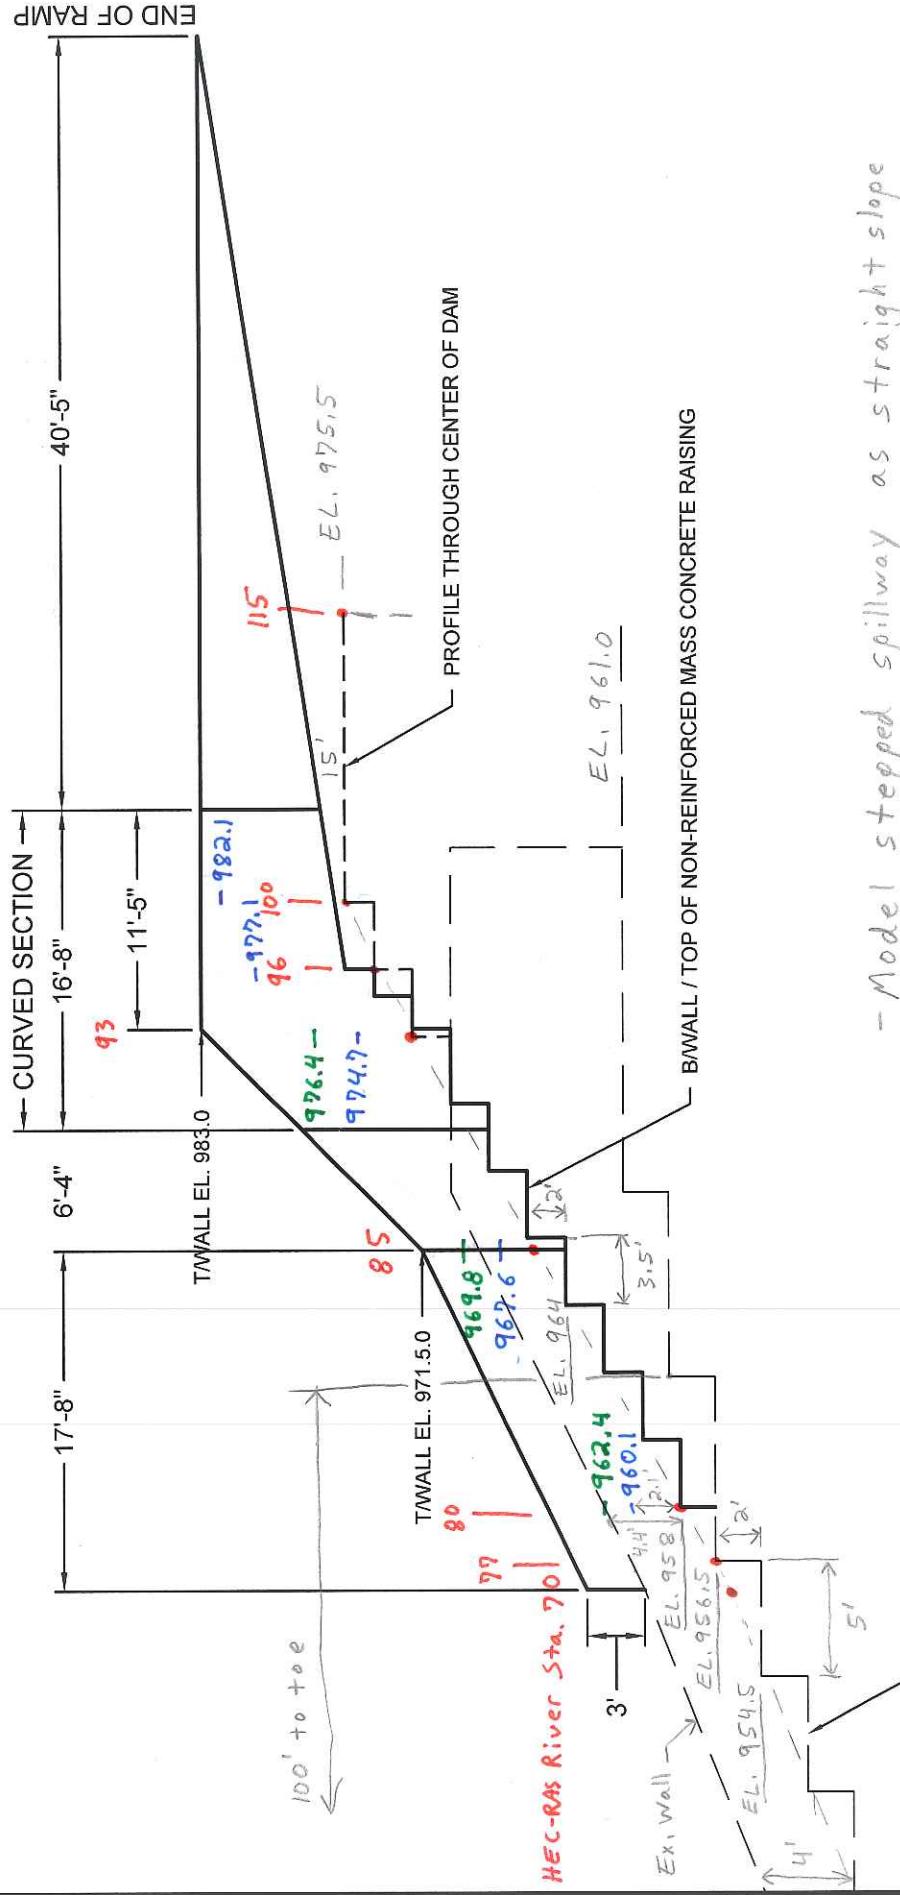

- Model stepped spillway as straight slope between edge of steps


- Use Manning's n = 0.07

RIGHT TRAINING WALL PROFILE

- Critical W.S. ($\sim 4.5'$ deep)
- Resultant W.S. ($2.0 + 2.5'$ deep)

From 2000 Ass-Built
Dwg. No. 13-30041-6

HEC-RAS Cross-Section Stations on Existing Emergency Spillway

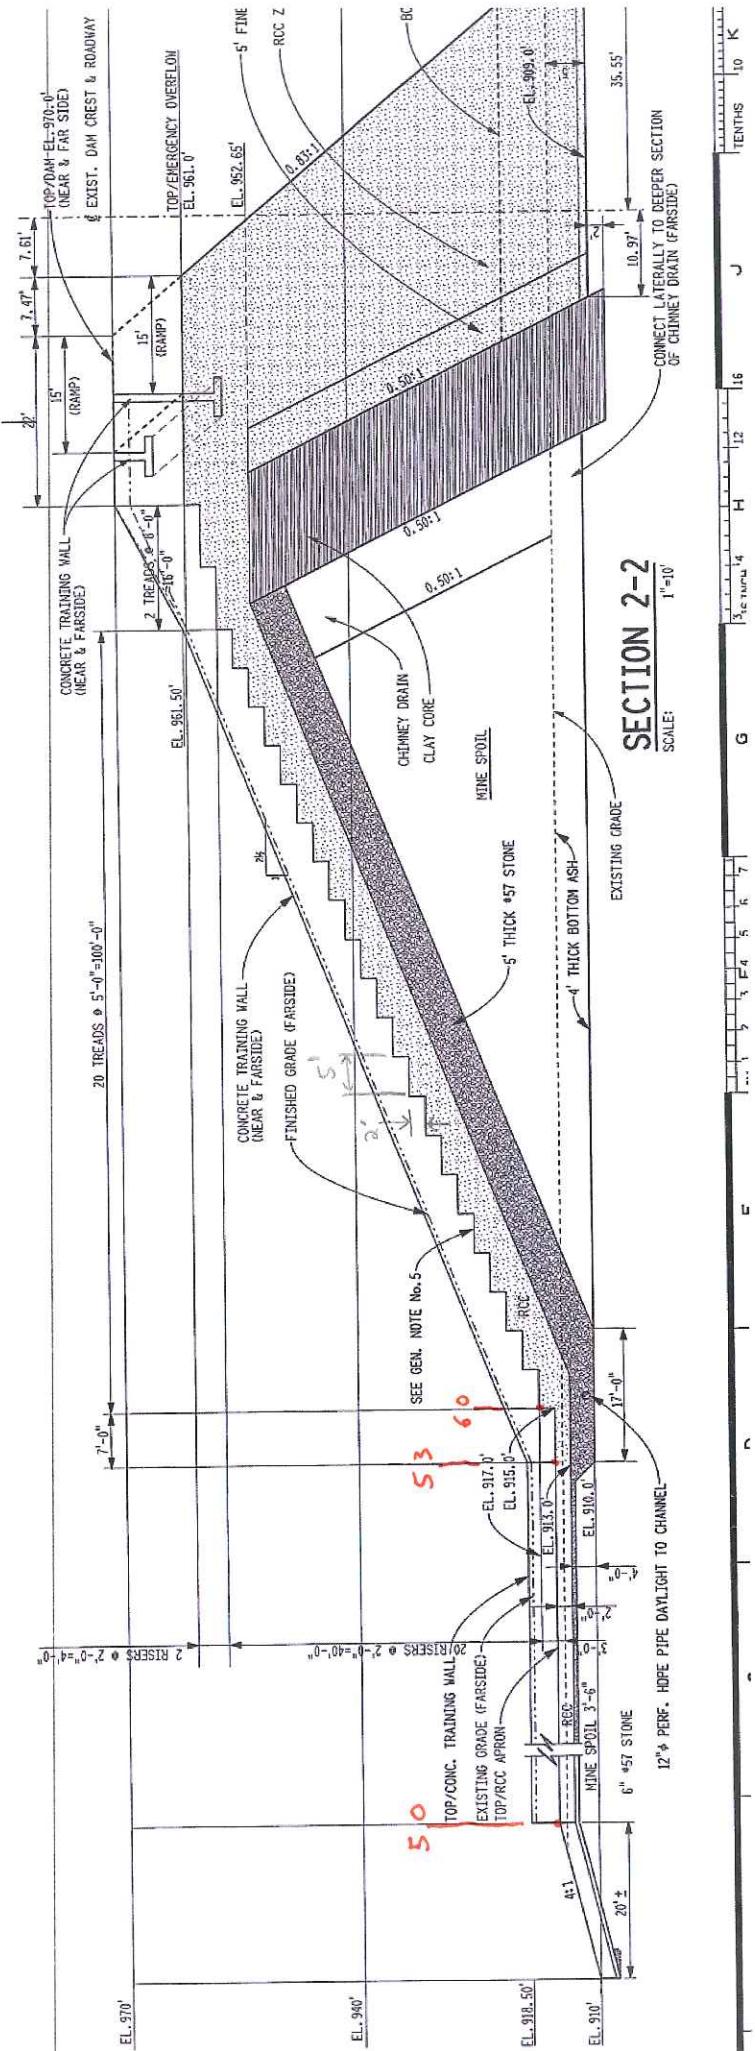

HEC-RAS Plan: P1an 22 River: E. Spillway Reach: 1

Reach	River Sta	Profile	Q Total (cfs)	Min Ch El (ft)	W.S. Elev (ft)	Crit W.S. (ft)	E.G. Elev (ft)	E.G. Slope (ft/ft)	Vel Chnl (ft/s)	Flow Area (sq ft)	Top Width (ft)	Froude # Chnl
1	140	PF 1	200.00	940.00	976.27	940.28	976.27	0.000000	0.03	8703.65	240.00	0.00
1	140	PF 2	500.00	940.00	976.89	940.51	976.89	0.000000	0.07	8853.88	240.00	0.00
1	140	PF 3	1000.00	940.00	977.70	940.81	977.70	0.000000	0.13	9047.40	240.00	0.00
1	140	PF 4	1500.00	940.00	978.37	941.07	978.37	0.000000	0.19	9209.44	240.00	0.01
1	140	PF 5	2000.00	940.00	978.98	941.29	978.98	0.000000	0.25	9354.95	240.00	0.01
1	140	PF 6	3000.00	940.00	980.06	941.69	980.06	0.000001	0.37	9613.49	240.00	0.01
1	140	PF 7	4000.00	940.00	981.02	942.04	981.02	0.000001	0.48	9844.20	240.00	0.01
1	140	PF 8	5000.00	940.00	981.90	942.37	981.90	0.000002	0.59	10056.02	240.00	0.02
1	140	PF 9	5500.00	940.00	982.32	942.54	982.32	0.000002	0.64	10156.63	240.00	0.02
1	140	PF 10	6000.00	940.00	982.73	942.69	982.73	0.000002	0.69	10254.30	240.00	0.02
1	115.1	PF 1	200.00	975.50	976.16		976.26	0.008703	2.61	81.00	142.14	0.57
1	115.1	PF 2	500.00	975.50	976.74		976.88	0.005540	3.18	173.06	175.04	0.50
1	115.1	PF 3	1000.00	975.50	977.52		977.68	0.003505	3.51	327.48	219.50	0.44
1	115.1	PF 4	1500.00	975.50	978.19		978.36	0.002549	3.63	488.12	255.18	0.39
1	115.1	PF 5	2000.00	975.50	978.80		978.96	0.001970	3.65	649.07	274.43	0.35
1	115.1	PF 6	3000.00	975.50	979.87		980.04	0.001413	3.73	962.46	308.48	0.31
1	115.1	PF 7	4000.00	975.50	980.83		981.00	0.001091	3.75	1267.33	323.63	0.29
1	115.1	PF 8	5000.00	975.50	981.71		981.89	0.000908	3.78	1557.18	335.36	0.27
1	115.1	PF 9	5500.00	975.50	982.13		982.31	0.000843	3.81	1698.33	340.92	0.26
1	115.1	PF 10	6000.00	975.50	982.54		982.71	0.000790	3.83	1837.51	346.32	0.25
1	115	PF 1	200.00	975.50	976.16		976.26	0.001226	2.62	80.95	142.13	0.57
1	115	PF 2	500.00	975.50	976.74		976.88	0.000780	3.19	173.02	175.02	0.50
1	115	PF 3	1000.00	975.50	977.52		977.68	0.000493	3.51	327.44	219.49	0.44
1	115	PF 4	1500.00	975.50	978.19		978.36	0.000359	3.63	488.11	255.18	0.39
1	115	PF 5	2000.00	975.50	978.80		978.96	0.000277	3.65	649.04	274.43	0.35
1	115	PF 6	3000.00	975.50	979.87		980.04	0.000199	3.73	962.44	308.48	0.31
1	115	PF 7	4000.00	975.50	980.83		981.00	0.000153	3.75	1267.31	323.63	0.29
1	115	PF 8	5000.00	975.50	981.71		981.89	0.000128	3.78	1557.18	335.36	0.27
1	115	PF 9	5500.00	975.50	982.13		982.31	0.000119	3.81	1698.33	340.92	0.26
1	115	PF 10	6000.00	975.50	982.54		982.71	0.000111	3.83	1837.51	346.32	0.25
1	100	PF 1	200.00	975.50	976.12		976.24	0.001460	2.76	76.48	140.33	0.62
1	100	PF 2	500.00	975.50	976.72		976.86	0.000820	3.24	170.09	174.07	0.52
1	100	PF 3	1000.00	975.50	977.51		977.67	0.000502	3.53	325.32	218.89	0.44
1	100	PF 4	1500.00	975.50	978.18		978.35	0.000362	3.64	486.46	254.98	0.39
1	100	PF 5	2000.00	975.50	978.79		978.96	0.000279	3.66	647.63	274.26	0.36
1	100	PF 6	3000.00	975.50	979.87		980.04	0.000199	3.74	961.40	308.37	0.32

HEC-RAS Plan: P1an 22 River: E. Spillway Reach: 1 (Continued)

Reach	River Sta	Profile	Q Total	Min Ch El	W.S. Elev	Crit W.S.	E.G. Elev	E.G. Slope	Vel Chnl	Flow Area	Top Width	Froude # Chnl
			(cfs)	(ft)	(ft)	(ft)	(ft)	(ft/ft)	(ft/s)	(sq ft)	(ft)	
1	100	PF 7	4000.00	975.50	980.83	981.00	0.000154	3.75	1266.50	323.59	0.29	
1	100	PF 8	5000.00	975.50	981.71	981.88	0.000128	3.79	1556.51	335.33	0.27	
1	100	PF 9	5500.00	975.50	982.13	982.30	0.000119	3.81	1697.67	340.90	0.26	
1	100	PF 10	6000.00	975.50	982.53	982.71	0.000111	3.84	1836.83	346.30	0.25	
1	99.9	PF 1	2000.00	975.50	975.98	975.98	0.091785	3.95	50.60	105.01	1.00	
1	99.9	PF 2	500.00	975.50	976.39	976.83	0.075231	5.37	93.08	105.02	1.01	
1	99.9	PF 3	1000.00	975.50	976.91	977.62	0.064567	6.77	147.71	105.04	1.01	
1	99.9	PF 4	1500.00	975.50	977.34	978.28	0.058886	7.75	193.68	105.05	1.01	
1	99.9	PF 5	2000.00	975.50	977.73	978.86	0.055267	8.53	234.60	105.06	1.01	
1	99.9	PF 6	3000.00	975.50	978.43	979.91	0.050473	9.76	307.49	105.08	1.01	
1	99.9	PF 7	4000.00	975.50	979.05	980.84	0.047379	10.74	372.45	105.09	1.01	
1	99.9	PF 8	5000.00	975.50	979.62	981.69	0.044943	11.56	432.64	105.11	1.00	
1	99.9	PF 9	5500.00	975.50	979.89	982.10	0.044050	11.94	460.88	105.12	1.00	
1	99.9	PF 10	6000.00	975.50	980.15	982.49	0.043279	12.30	488.18	105.12	1.01	
1	96	PF 1	200.00	974.00	974.32	974.48	0.376398	6.04	33.13	105.01	1.89	
1	96	PF 2	500.00	974.00	974.53	974.89	0.417760	8.99	55.65	105.01	2.18	
1	96	PF 3	1000.00	974.00	974.86	976.41	0.338287	11.13	89.86	105.02	2.12	
1	96	PF 4	1500.00	974.00	975.16	975.84	0.280174	12.37	121.29	105.03	2.03	
1	96	PF 5	2000.00	974.00	975.43	976.23	0.242904	13.30	150.45	105.03	1.96	
1	96	PF 6	3000.00	974.00	975.95	979.29	0.196469	14.67	204.51	105.04	1.85	
1	96	PF 7	4000.00	974.00	976.43	977.55	0.167924	15.70	254.77	105.05	1.78	
1	96	PF 8	5000.00	974.00	976.88	978.12	0.148546	16.55	302.19	105.06	1.72	
1	96	PF 9	5500.00	974.00	977.09	978.39	0.141529	16.95	324.66	105.07	1.70	
1	96	PF 10	6000.00	974.00	977.30	978.65	0.134987	17.30	346.96	105.07	1.68	
1	93	PF 1	200.00	972.00	972.28	972.48	0.556401	6.79	29.47	105.01	2.26	
1	93	PF 2	500.00	972.00	972.48	972.89	0.561951	9.82	50.91	105.01	2.49	
1	93	PF 3	1000.00	972.00	972.76	973.41	0.508273	12.57	79.53	105.01	2.55	
1	93	PF 4	1500.00	972.00	973.00	973.84	0.450602	14.26	105.17	105.02	2.51	
1	93	PF 5	2000.00	972.00	973.23	974.23	0.402379	15.47	129.30	105.02	2.46	
1	93	PF 6	3000.00	972.00	973.66	974.93	0.331961	17.17	174.72	105.03	2.35	
1	93	PF 7	4000.00	972.00	974.07	975.55	0.283724	18.38	217.66	105.04	2.25	
1	93	PF 8	5000.00	972.00	974.46	976.12	0.249809	19.34	258.54	105.04	2.17	
1	93	PF 9	5500.00	972.00	974.65	976.39	0.237044	19.78	278.10	105.05	2.14	
1	93	PF 10	6000.00	972.00	974.83	976.65	0.225141	20.17	297.57	105.05	2.11	
1	85	PF 1	200.00	965.40	965.68	965.88	0.574097	6.85	29.19	105.01	2.29	

HEC-RAS Plan: P1an 22 River: E. Spillway Reach: 1 (Continued)

Reach	River Sta	Profile	Q Total (cfs)	Min Ch El (ft)	W.S. Elev (ft)	Crit W.S. (ft)	E.G. Elev (ft)	E.G. Slope (ft/ft)	Vel Chnl (ft/s)	Flow Area (sq ft)	Top Width (ft)	Froude # Chnl
1	85	PF 2	500.00	965.40	965.88	966.29	967.40	0.574378	9.89	50.58	105.02	2.51
1	85	PF 3	1000.00	965.40	966.13	966.81	968.77	0.573735	13.04	76.70	105.02	2.69
1	85	PF 4	1500.00	965.40	966.33	967.24	969.96	0.567474	15.29	98.14	105.03	2.79
1	85	PF 5	2000.00	965.40	966.52	967.63	971.03	0.556871	17.05	117.30	105.04	2.84
1	85	PF 6	3000.00	965.40	966.85	968.33	972.88	0.525993	19.72	152.20	105.05	2.89
1	85	PF 7	4000.00	965.40	967.16	968.95	974.45	0.491903	21.68	184.55	105.06	2.88
1	85	PF 8	5000.00	965.40	967.45	969.52	975.80	0.457272	23.19	215.67	105.07	2.85
1	85	PF 9	5500.00	965.40	967.60	969.79	976.42	0.441252	23.83	230.82	105.07	2.83
1	85	PF 10	6000.00	965.40	967.74	970.05	976.99	0.425444	24.41	245.88	105.08	2.81
1	80	PF 1	200.00	958.00	958.29	958.48	958.96	0.503104	6.59	30.37	105.01	2.16
1	80	PF 2	500.00	958.00	958.50	958.89	959.91	0.507624	9.53	52.49	105.02	2.37
1	80	PF 3	1000.00	958.00	958.76	959.41	961.21	0.507442	12.57	79.57	105.02	2.54
1	80	PF 4	1500.00	958.00	958.97	959.84	962.36	0.508227	14.79	101.45	105.03	2.65
1	80	PF 5	2000.00	958.00	959.15	960.23	963.42	0.508657	16.60	120.53	105.04	2.73
1	80	PF 6	3000.00	958.00	959.46	960.93	965.38	0.509361	19.53	153.67	105.05	2.84
1	80	PF 7	4000.00	958.00	959.74	961.55	967.15	0.504588	21.85	183.14	105.06	2.92
1	80	PF 8	5000.00	958.00	960.01	962.12	968.76	0.494769	23.74	210.63	105.06	2.95
1	80	PF 9	5500.00	958.00	960.13	962.39	969.50	0.488171	24.57	223.93	105.07	2.97
1	80	PF 10	6000.00	958.00	960.26	962.65	970.22	0.481204	25.33	236.95	105.07	2.97
1	77	PF 1	200.00	956.50	956.75	956.98	957.66	0.830089	7.65	26.14	105.01	2.70
1	77	PF 2	500.00	956.50	956.95	957.39	958.68	0.715384	10.56	47.36	105.01	2.77
1	77	PF 3	1000.00	956.50	957.20	957.91	960.04	0.646310	13.51	74.00	105.02	2.84
1	77	PF 4	1500.00	956.50	957.41	958.34	961.20	0.609956	15.62	96.04	105.03	2.88
1	77	PF 5	2000.00	956.50	957.60	958.73	962.29	0.594015	17.39	115.05	105.03	2.93
1	77	PF 6	3000.00	956.50	957.91	959.43	964.26	0.571945	20.22	148.42	105.04	3.00
1	77	PF 7	4000.00	956.50	958.19	960.05	966.05	0.555768	22.49	177.91	105.05	3.04
1	77	PF 8	5000.00	956.50	958.45	960.62	967.68	0.539953	24.38	205.17	105.06	3.07
1	77	PF 9	5500.00	956.50	958.58	960.89	968.44	0.531104	25.20	218.33	105.06	3.08
1	77	PF 10	6000.00	956.50	958.70	961.15	969.16	0.522282	25.96	231.19	105.06	3.08
1	70	PF 1	200.00	956.10	956.41	956.58	957.00	0.399350	6.14	32.55	105.01	1.94
1	70	PF 2	500.00	956.10	956.60	956.99	958.00	0.497833	9.47	52.80	105.01	2.35
1	70	PF 3	1000.00	956.10	956.85	957.51	959.36	0.527568	12.72	78.65	105.02	2.59
1	70	PF 4	1500.00	956.10	957.05	957.94	960.54	0.531031	14.98	100.12	105.03	2.70
1	70	PF 5	2000.00	956.10	957.23	958.33	961.64	0.535132	16.85	118.71	105.03	2.79
1	70	PF 6	3000.00	956.10	957.54	959.03	963.63	0.533230	19.80	151.57	105.04	2.90
1	70	PF 7	4000.00	956.10	957.82	959.65	965.43	0.527691	22.14	180.70	105.05	2.97

HEC-RAS Plan: P1an 22 River: E. Spillway Reach: 1 (Continued)


Reach	River Sta	Profile	Q Total	Min Ch El	W.S. Elev	Crit W.S.	E.G. Elev	E.G. Slope	Vel Chnl	Flow Area	Top Width	Froude # Chnl
			(cfs)	(ft)	(ft)	(ft)	(ft)	(ft/ft)	(ft/s)	(sq ft)	(ft)	
1	70	PF 8	5000.00	956.10	958.08	960.22	967.08	0.518801	24.08	207.65	105.06	3.02
1	70	PF 9	5500.00	956.10	958.20	960.49	967.84	0.511571	24.92	220.80	105.06	3.03
1	70	PF 10	6000.00	956.10	958.32	960.75	968.58	0.505503	25.71	233.47	105.06	3.04
1	69.9	PF 1	2000.00	956.10	956.39	956.57	956.99	0.438962	6.20	32.24	110.01	2.02
1	69.9	PF 2	5000.00	956.10	956.58	956.96	957.99	0.541413	9.53	52.45	110.02	2.43
1	69.9	PF 3	10000.00	956.10	956.81	957.47	959.35	0.571684	12.79	78.22	110.04	2.67
1	69.9	PF 4	15000.00	956.10	957.01	957.89	960.53	0.574944	15.06	99.60	110.05	2.79
1	69.9	PF 5	20000.00	956.10	957.17	958.27	961.63	0.578905	16.93	118.13	110.05	2.88
1	69.9	PF 6	30000.00	956.10	957.47	958.94	963.61	0.576374	19.89	150.87	110.07	2.99
1	69.9	PF 7	40000.00	956.10	957.73	959.54	965.42	0.570016	22.24	179.90	110.08	3.07
1	69.9	PF 8	50000.00	956.10	957.98	960.09	967.07	0.560262	24.19	206.75	110.09	3.11
1	69.9	PF 9	55000.00	956.10	958.10	960.37	967.82	0.552450	25.03	219.84	110.10	3.12
1	69.9	PF 10	60000.00	956.10	958.21	960.62	968.56	0.545879	25.82	232.47	110.11	3.13
1	60	PF 1	2000.00	917.00	917.30	917.47	917.86	0.386204	5.97	33.50	110.02	1.91
1	60	PF 2	5000.00	917.00	917.53	917.86	918.69	0.392246	8.65	57.78	110.03	2.10
1	60	PF 3	10000.00	917.00	917.79	918.37	919.83	0.395936	11.45	87.34	110.05	2.27
1	60	PF 4	15000.00	917.00	918.01	918.79	920.83	0.396575	13.47	111.35	110.06	2.36
1	60	PF 5	20000.00	917.00	918.20	919.16	921.75	0.396544	15.12	132.33	110.07	2.43
1	60	PF 6	30000.00	917.00	918.53	919.84	923.44	0.395788	17.77	168.89	110.09	2.53
1	60	PF 7	40000.00	917.00	918.82	920.44	925.00	0.396406	19.94	200.62	110.10	2.60
1	60	PF 8	50000.00	917.00	919.09	920.99	926.46	0.395771	21.80	229.49	110.12	2.66
1	60	PF 9	55000.00	917.00	919.21	921.27	927.16	0.395239	22.63	243.10	110.13	2.68
1	60	PF 10	60000.00	917.00	919.33	921.52	927.86	0.395732	23.44	256.04	110.13	2.71
1	53	PF 1	2000.00	915.00	915.34	915.47	915.79	0.280219	5.42	36.88	110.02	1.65
1	53	PF 2	5000.00	915.00	915.58	915.86	916.54	0.286142	7.87	63.51	110.03	1.83
1	53	PF 3	10000.00	915.00	915.88	916.37	917.55	0.285147	10.38	96.38	110.04	1.95
1	53	PF 4	15000.00	915.00	916.11	916.79	918.45	0.289592	12.26	122.36	110.06	2.05
1	53	PF 5	20000.00	915.00	916.31	917.17	919.29	0.295808	13.84	144.49	110.07	2.13
1	53	PF 6	30000.00	915.00	916.66	917.84	920.86	0.306301	16.45	182.38	110.08	2.25
1	53	PF 7	40000.00	915.00	916.95	918.44	922.34	0.345517	18.62	214.84	110.10	2.35
1	53	PF 8	50000.00	915.00	917.22	918.99	923.73	0.321483	20.48	244.25	110.11	2.42
1	53	PF 9	55000.00	915.00	917.34	919.27	924.41	0.324559	21.33	257.90	110.12	2.46
1	53	PF 10	60000.00	915.00	917.46	919.52	925.08	0.327665	22.15	270.95	110.12	2.49
1	52.9	PF 1	2000.00	915.00	915.35	915.47	915.77	0.101776	5.22	38.34	110.02	1.56
1	52.9	PF 2	5000.00	915.00	915.58	915.86	916.53	0.114142	7.79	64.19	110.03	1.80


HEC-RAS Plan: P1an 22 River: E. Spillway Reach: 1 (Continued)


Reach	River Sta	Profile	Q Total	Min Ch El	W.S. Elev	Crit W.S.	E.G. Elev	E.G. Slope	Vel Chnl	Flow Area	Top Width	Froude # Chnl
			(cfs)	(ft)	(ft)	(ft)	(ft)	(ft/ft)	(ft/s)	(sq ft)	(ft)	
1	52.9	PF 3	1000.00	915.00	915.88	916.37	917.53	0.115522	10.32	96.95	110.04	1.94
1	52.9	PF 4	1500.00	915.00	916.12	916.79	918.43	0.117970	12.21	122.89	110.06	2.04
1	52.9	PF 5	2000.00	915.00	916.32	917.17	919.27	0.120881	13.80	144.98	110.07	2.12
1	52.9	PF 6	3000.00	915.00	916.66	917.84	920.84	0.125556	16.41	182.83	110.08	2.24
1	52.9	PF 7	4000.00	915.00	916.96	918.44	922.32	0.129536	18.59	215.27	110.10	2.34
1	52.9	PF 8	5000.00	915.00	917.22	918.99	923.71	0.132129	20.44	244.66	110.11	2.42
1	52.9	PF 9	5500.00	915.00	917.35	919.27	924.39	0.133445	21.30	258.30	110.12	2.45
1	52.9	PF 10	6000.00	915.00	917.47	919.53	925.06	0.134768	22.12	271.35	110.12	2.48
1	50	PF 1	200.00	914.20	914.91		915.01	0.009510	2.56	78.07	110.03	0.54
1	50	PF 2	500.00	914.20	915.46		915.66	0.008811	3.61	138.44	110.05	0.57
1	50	PF 3	1000.00	914.20	916.17		916.50	0.007907	4.61	216.78	110.08	0.58
1	50	PF 4	1500.00	914.20	916.77		917.20	0.007375	5.31	282.36	110.11	0.58
1	50	PF 5	2000.00	914.20	917.28		917.82	0.007096	5.89	339.49	110.13	0.59
1	50	PF 6	3000.00	914.20	918.19		918.92	0.006743	6.83	439.76	110.17	0.60
1	50	PF 7	4000.00	914.20	918.99		919.89	0.006531	7.59	527.71	110.20	0.61
1	50	PF 8	5000.00	914.20	919.72		920.77	0.006356	8.22	609.31	113.67	0.62
1	50	PF 9	5500.00	914.20	920.06		921.18	0.006299	8.52	647.93	115.29	0.62
1	50	PF 10	6000.00	914.20	920.39		921.58	0.006233	8.79	685.98	116.86	0.62
1	49.9	PF 1	200.00	914.20	914.91		915.01	0.009218	2.52	78.78	112.38	0.53
1	49.9	PF 2	500.00	914.20	915.46		915.66	0.008274	3.50	141.01	114.22	0.55
1	49.9	PF 3	1000.00	914.20	916.17		916.50	0.007140	4.39	223.38	116.61	0.55
1	49.9	PF 4	1500.00	914.20	916.77		917.20	0.006450	4.98	293.73	118.62	0.55
1	49.9	PF 5	2000.00	914.20	917.29		917.82	0.006035	5.44	356.12	120.37	0.55
1	49.9	PF 6	3000.00	914.20	918.21		918.91	0.005460	6.16	468.14	123.45	0.54
1	49.9	PF 7	4000.00	914.20	919.02		919.87	0.005051	6.70	569.64	126.18	0.54
1	49.9	PF 8	5000.00	914.20	919.77		920.75	0.004734	7.14	664.25	128.67	0.53
1	49.9	PF 9	5500.00	914.20	920.11		921.16	0.004621	7.34	708.55	129.82	0.53
1	49.9	PF 10	6000.00	914.20	920.44		921.56	0.004516	7.52	751.83	130.93	0.53
1	30	PF 1	200.00	914.00	914.53		914.80	0.036552	4.15	48.50	92.33	1.00
1	30	PF 2	500.00	914.00	914.98		915.46	0.029619	5.60	90.14	94.28	1.00
1	30	PF 3	1000.00	914.00	915.55		916.30	0.025256	7.02	144.55	96.77	0.99
1	30	PF 4	1500.00	914.00	916.02		917.00	0.023257	8.04	190.31	98.82	1.00
1	30	PF 5	2000.00	914.00	916.44		917.62	0.021709	8.81	232.32	100.66	0.99
1	30	PF 6	3000.00	914.00	917.18		918.70	0.019651	10.02	308.60	103.92	0.99
1	30	PF 7	4000.00	914.00	917.83		919.64	0.018488	10.99	376.97	106.76	0.99
1	30	PF 8	5000.00	914.00	918.43		920.50	0.017510	11.79	441.74	109.39	0.99


HEC-RAS Plan: P1an 22 River: E. Spillway Reach: 1 (Continued)


Reach	River Sta	Profile	Q Total (cfs)	Min Ch El (ft)	W.S. Elev (ft)	Crit W.S. (ft)	E.G. Elev (ft)	E.G. Slope (ft/ft)	Vel Chnl (ft/s)	Flow Area (sq ft)	Top Width (ft)	Froude # Chnl
1	30	PF 9	5500.00	914.00	918.73	918.73	920.91	0.016968	12.11	474.09	110.67	0.98
1	30	PF 10	6000.00	914.00	919.00	919.00	921.30	0.016592	12.44	504.77	111.88	0.98
1	8	PF 1	200.00	904.00	904.67	904.63	904.94	0.027464	4.20	48.00	72.75	0.90
1	8	PF 2	500.00	904.00	905.04	905.15	905.74	0.040065	6.77	74.76	74.23	1.17
1	8	PF 3	1000.00	904.00	905.57	905.82	906.77	0.039315	8.85	115.07	76.42	1.24
1	8	PF 4	1500.00	904.00	906.00	906.37	907.63	0.039161	10.37	148.05	78.16	1.29
1	8	PF 5	2000.00	904.00	906.39	906.86	908.38	0.037780	11.48	179.08	79.77	1.31
1	8	PF 6	3000.00	904.00	907.04	907.72	909.74	0.037500	13.41	231.48	82.40	1.36
1	8	PF 7	4000.00	904.00	908.40	908.49	910.56	0.018523	12.07	347.73	87.98	1.01
1	8	PF 8	5000.00	904.00	909.09	909.19	911.54	0.017473	12.91	409.07	90.78	1.01
1	8	PF 9	5500.00	904.00	909.39	909.50	912.00	0.017277	13.34	436.71	92.01	1.01
1	8	PF 10	6000.00	904.00	909.71	909.82	912.44	0.016859	13.69	465.80	93.30	1.01
1	5	PF 1	200.00	898.00	898.66	898.63	898.94	0.029687	4.30	46.83	72.47	0.93
1	5	PF 2	500.00	898.00	899.06	899.15	899.73	0.037008	6.61	76.49	73.98	1.13
1	5	PF 3	1000.00	898.00	899.67	899.82	900.73	0.032456	8.36	121.81	76.25	1.14
1	5	PF 4	1500.00	898.00	900.34	900.38	901.52	0.022966	8.83	174.27	78.78	1.02
1	5	PF 5	2000.00	898.00	900.84	900.87	902.24	0.021127	9.63	214.07	80.66	1.01
1	5	PF 6	3000.00	898.00	901.26	901.73	903.61	0.029568	12.50	248.50	82.24	1.22
1	5	PF 7	4000.00	898.00	902.35	902.50	904.60	0.019600	12.31	339.75	86.30	1.04
1	5	PF 8	5000.00	898.00	903.03	903.21	905.59	0.018457	13.17	399.59	88.86	1.03
1	5	PF 9	5500.00	898.00	903.33	903.52	906.06	0.018223	13.61	426.65	90.00	1.04
1	5	PF 10	6000.00	898.00	903.65	903.84	906.51	0.017721	13.95	455.43	91.19	1.03
1	3	PF 1	200.00	878.00	878.68	878.66	878.98	0.030014	4.41	46.07	70.91	0.94
1	3	PF 2	500.00	878.00	879.12	879.19	879.77	0.034177	6.58	78.12	74.75	1.10
1	3	PF 3	1000.00	878.00	879.73	879.87	880.76	0.030618	8.32	125.22	80.06	1.12
1	3	PF 4	1500.00	878.00	880.34	880.42	881.53	0.023880	8.99	175.92	85.40	1.04
1	3	PF 5	2000.00	878.00	880.77	880.91	882.21	0.023299	9.95	213.82	89.19	1.05
1	3	PF 6	3000.00	878.00	881.56	881.75	883.38	0.021500	11.29	286.81	96.06	1.05
1	3	PF 7	4000.00	878.00	882.38	882.48	884.37	0.018037	11.88	368.74	103.24	1.00
1	3	PF 8	5000.00	878.00	883.14	883.15	885.25	0.015782	12.35	448.84	109.79	0.96
1	3	PF 9	5500.00	878.00	883.17	883.44	885.68	0.018586	13.47	453.01	110.12	1.04
1	3	PF 10	6000.00	878.00	883.60	883.73	886.05	0.016496	13.38	500.82	113.85	1.00

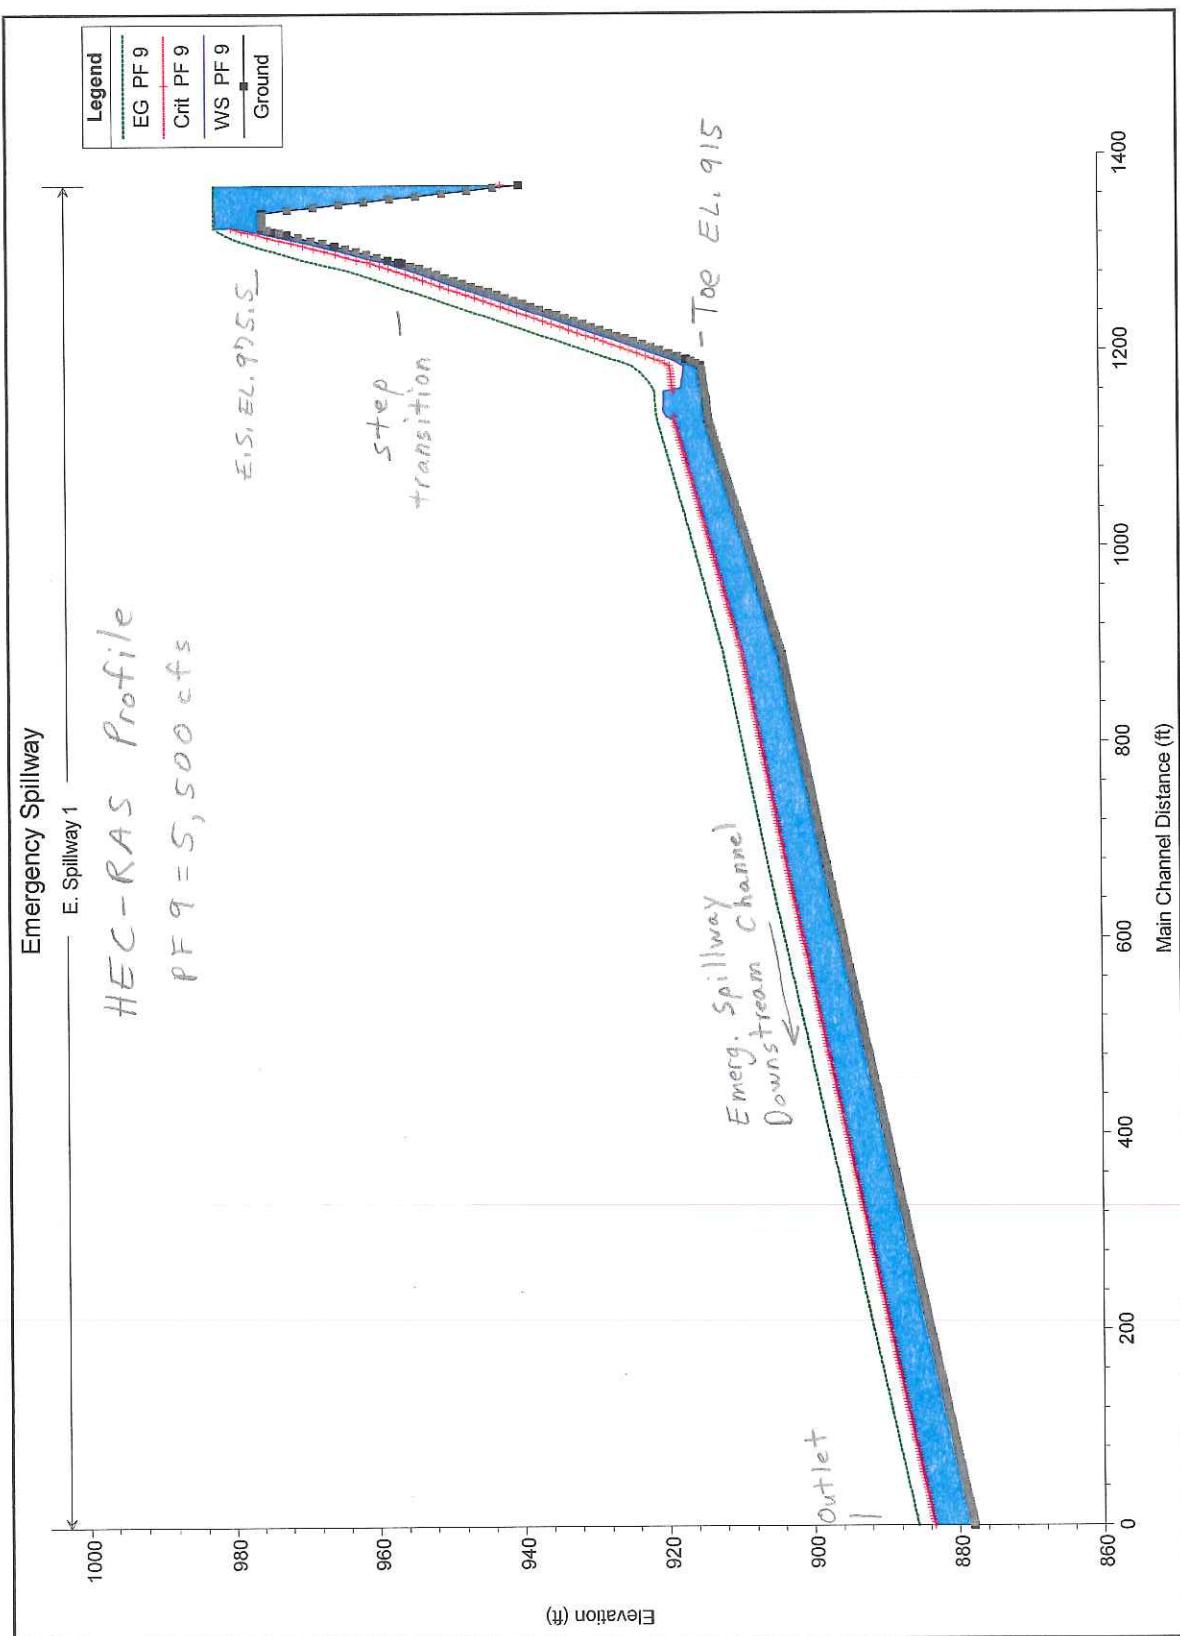

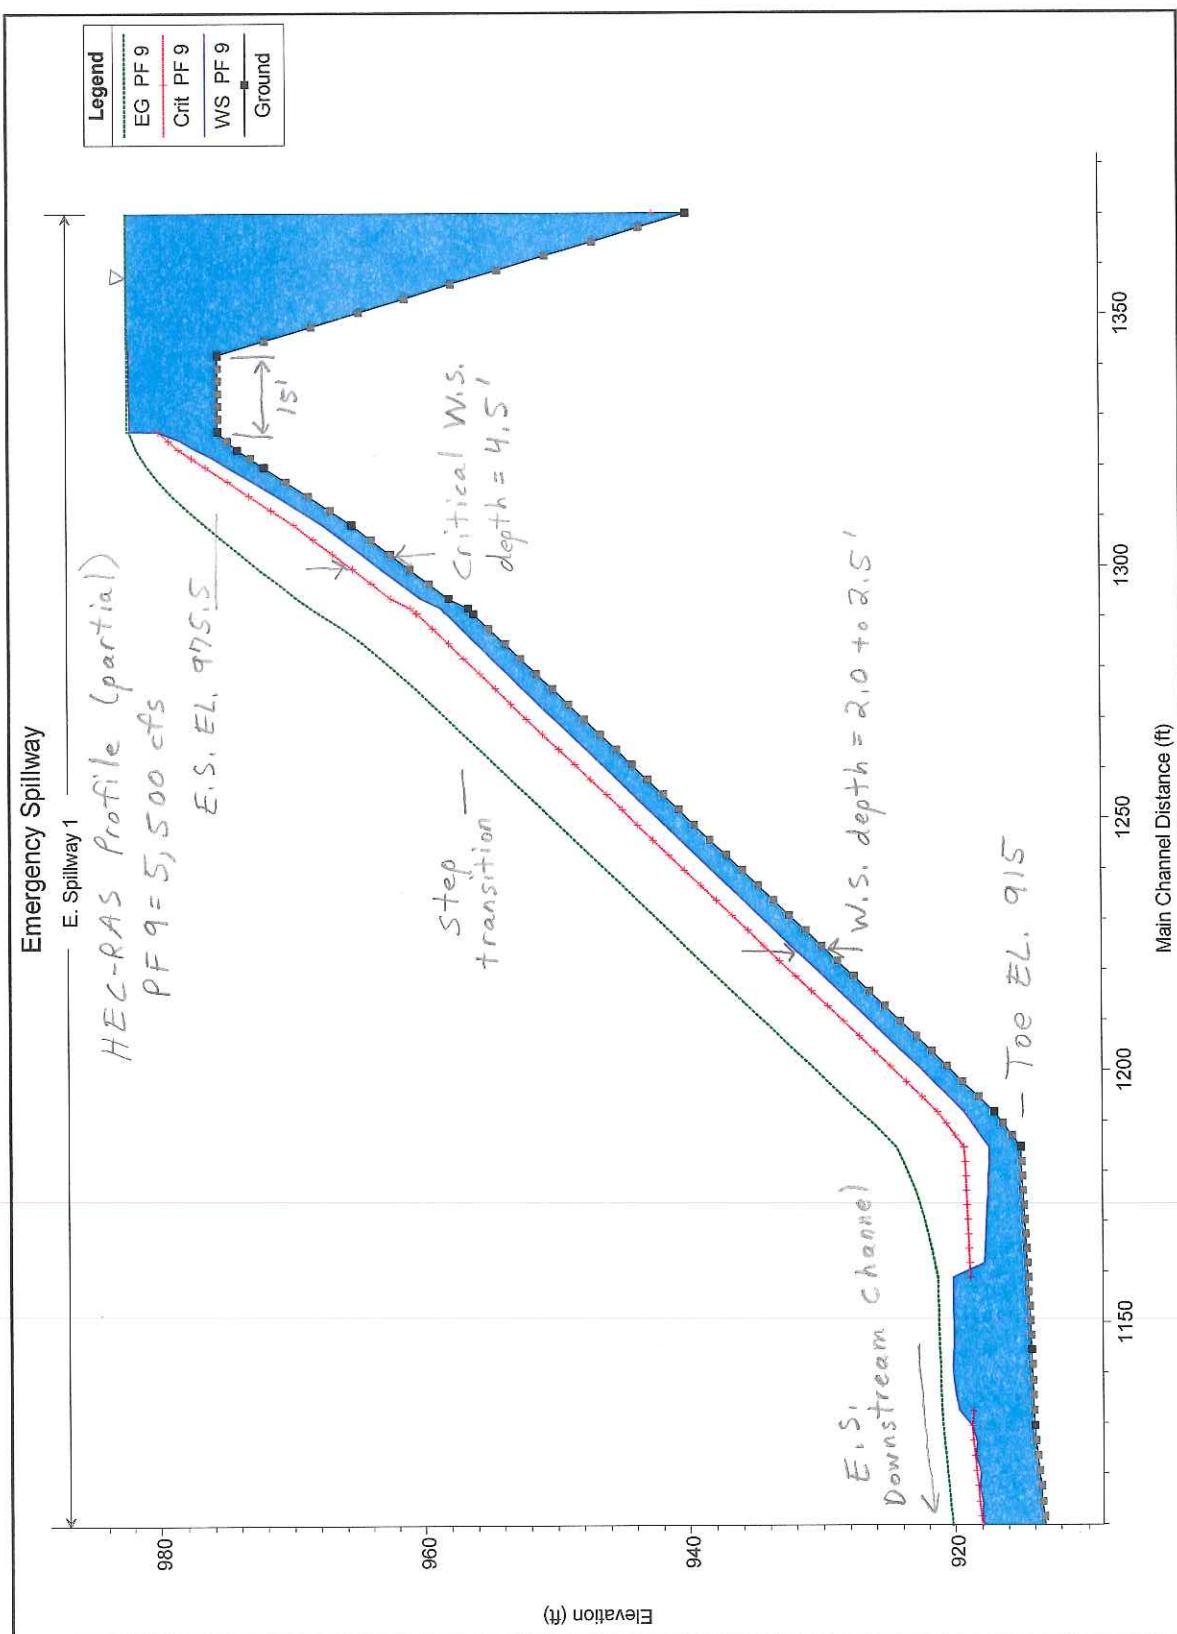

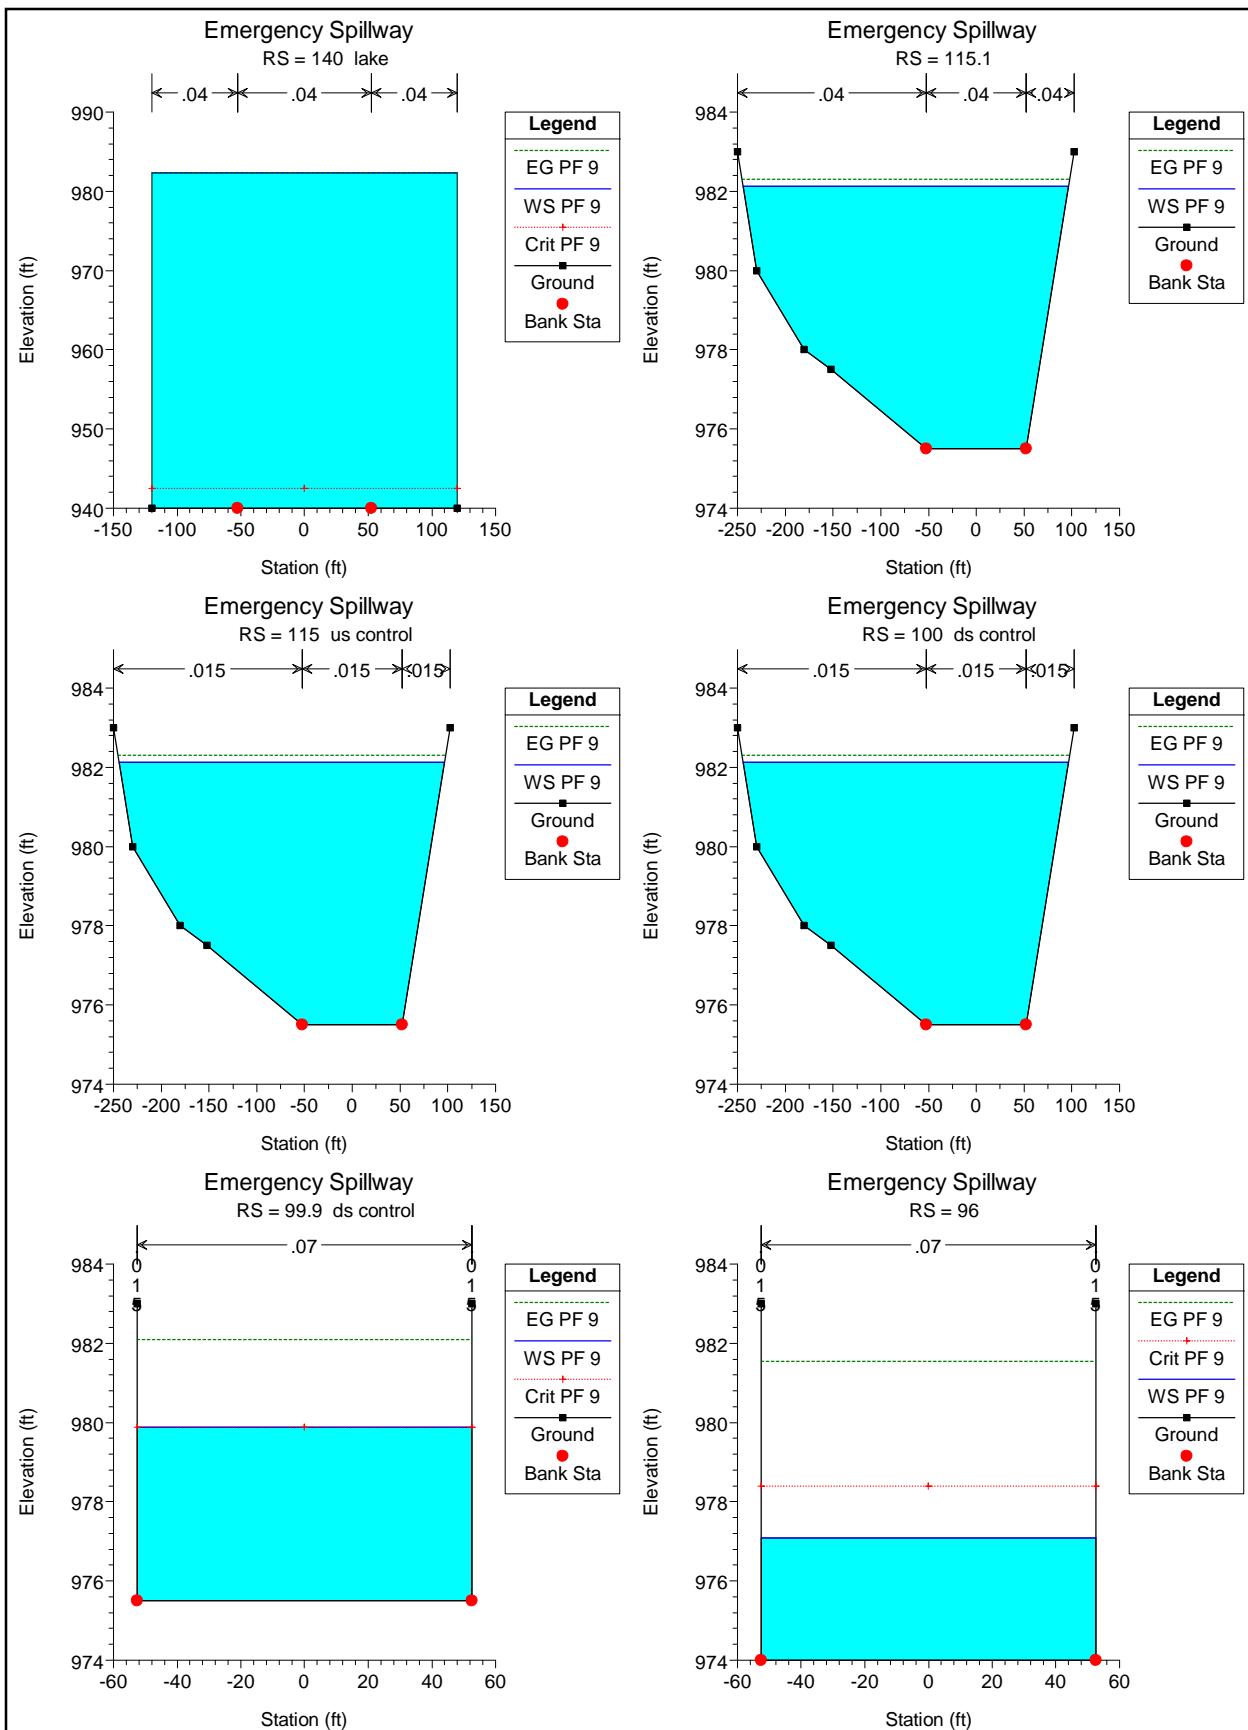

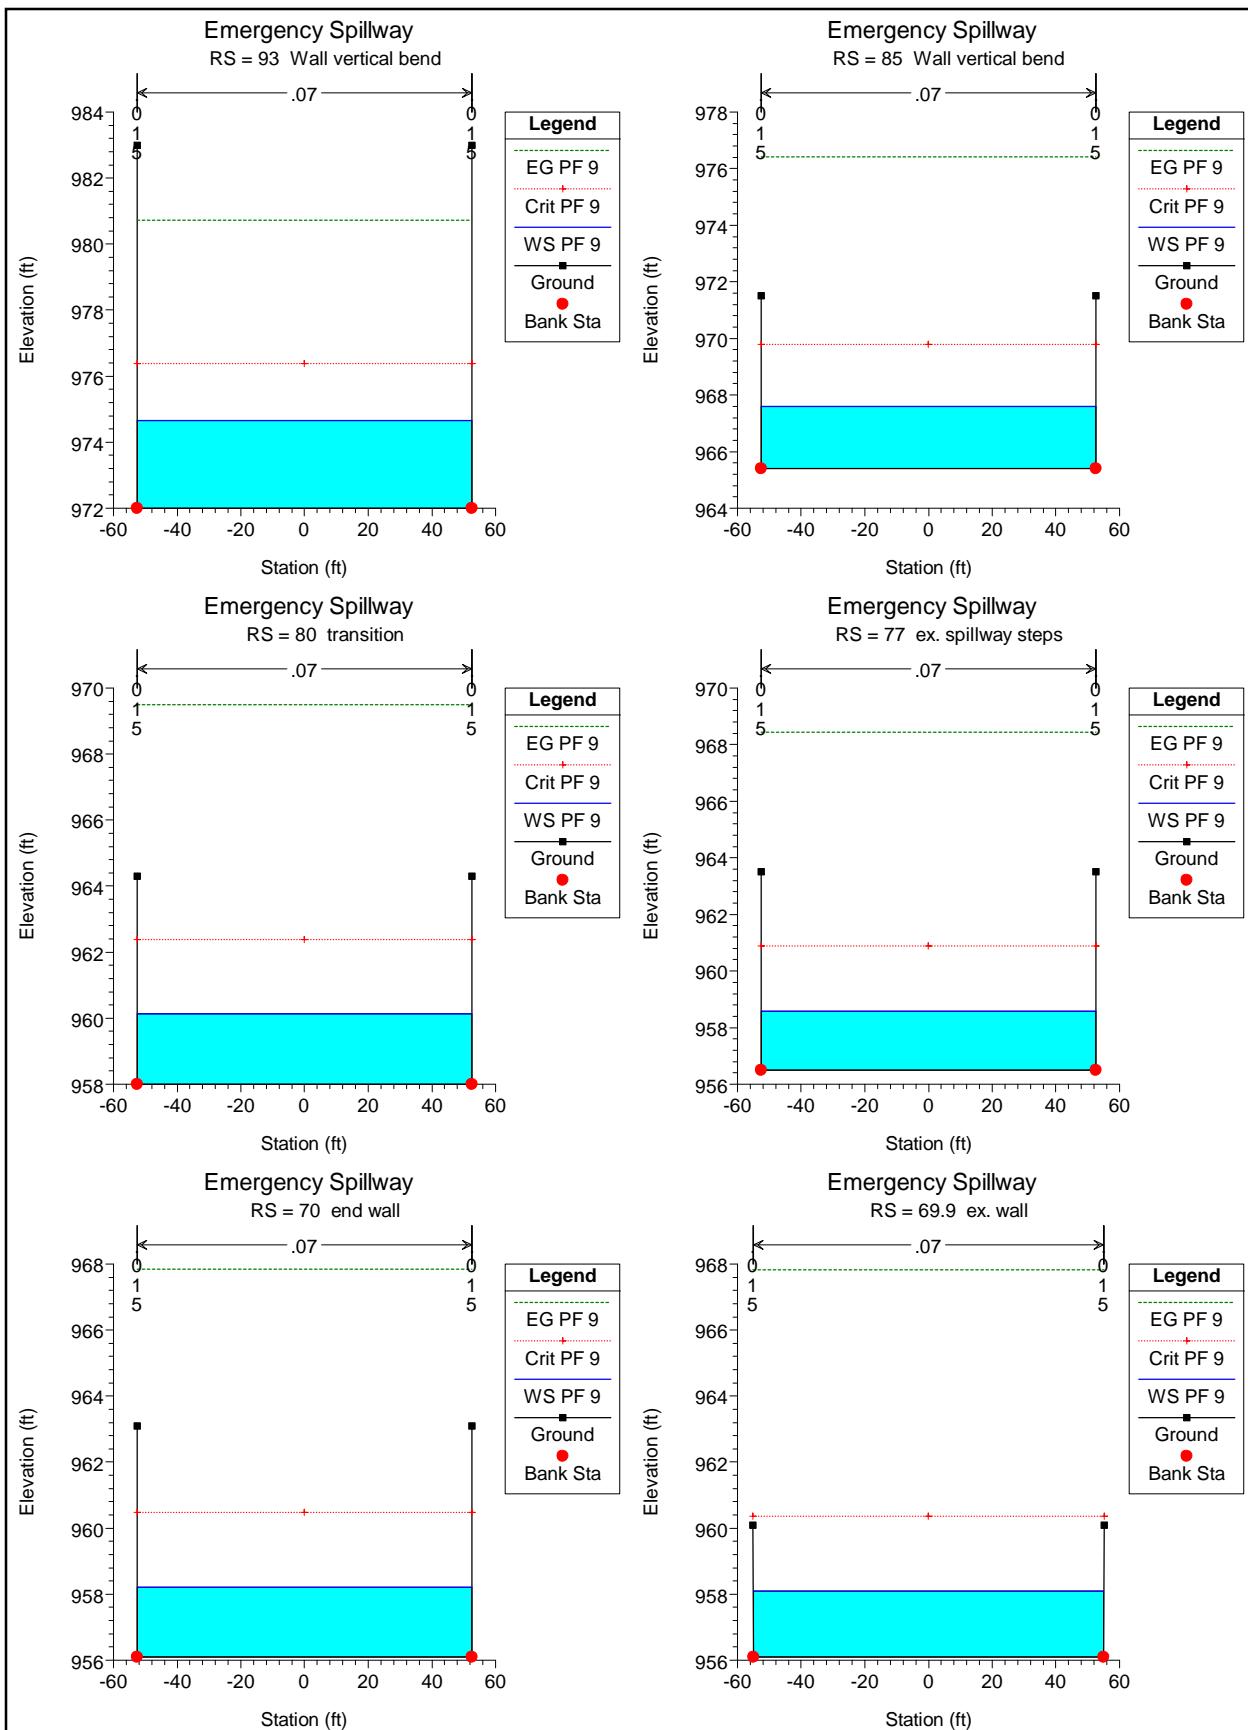

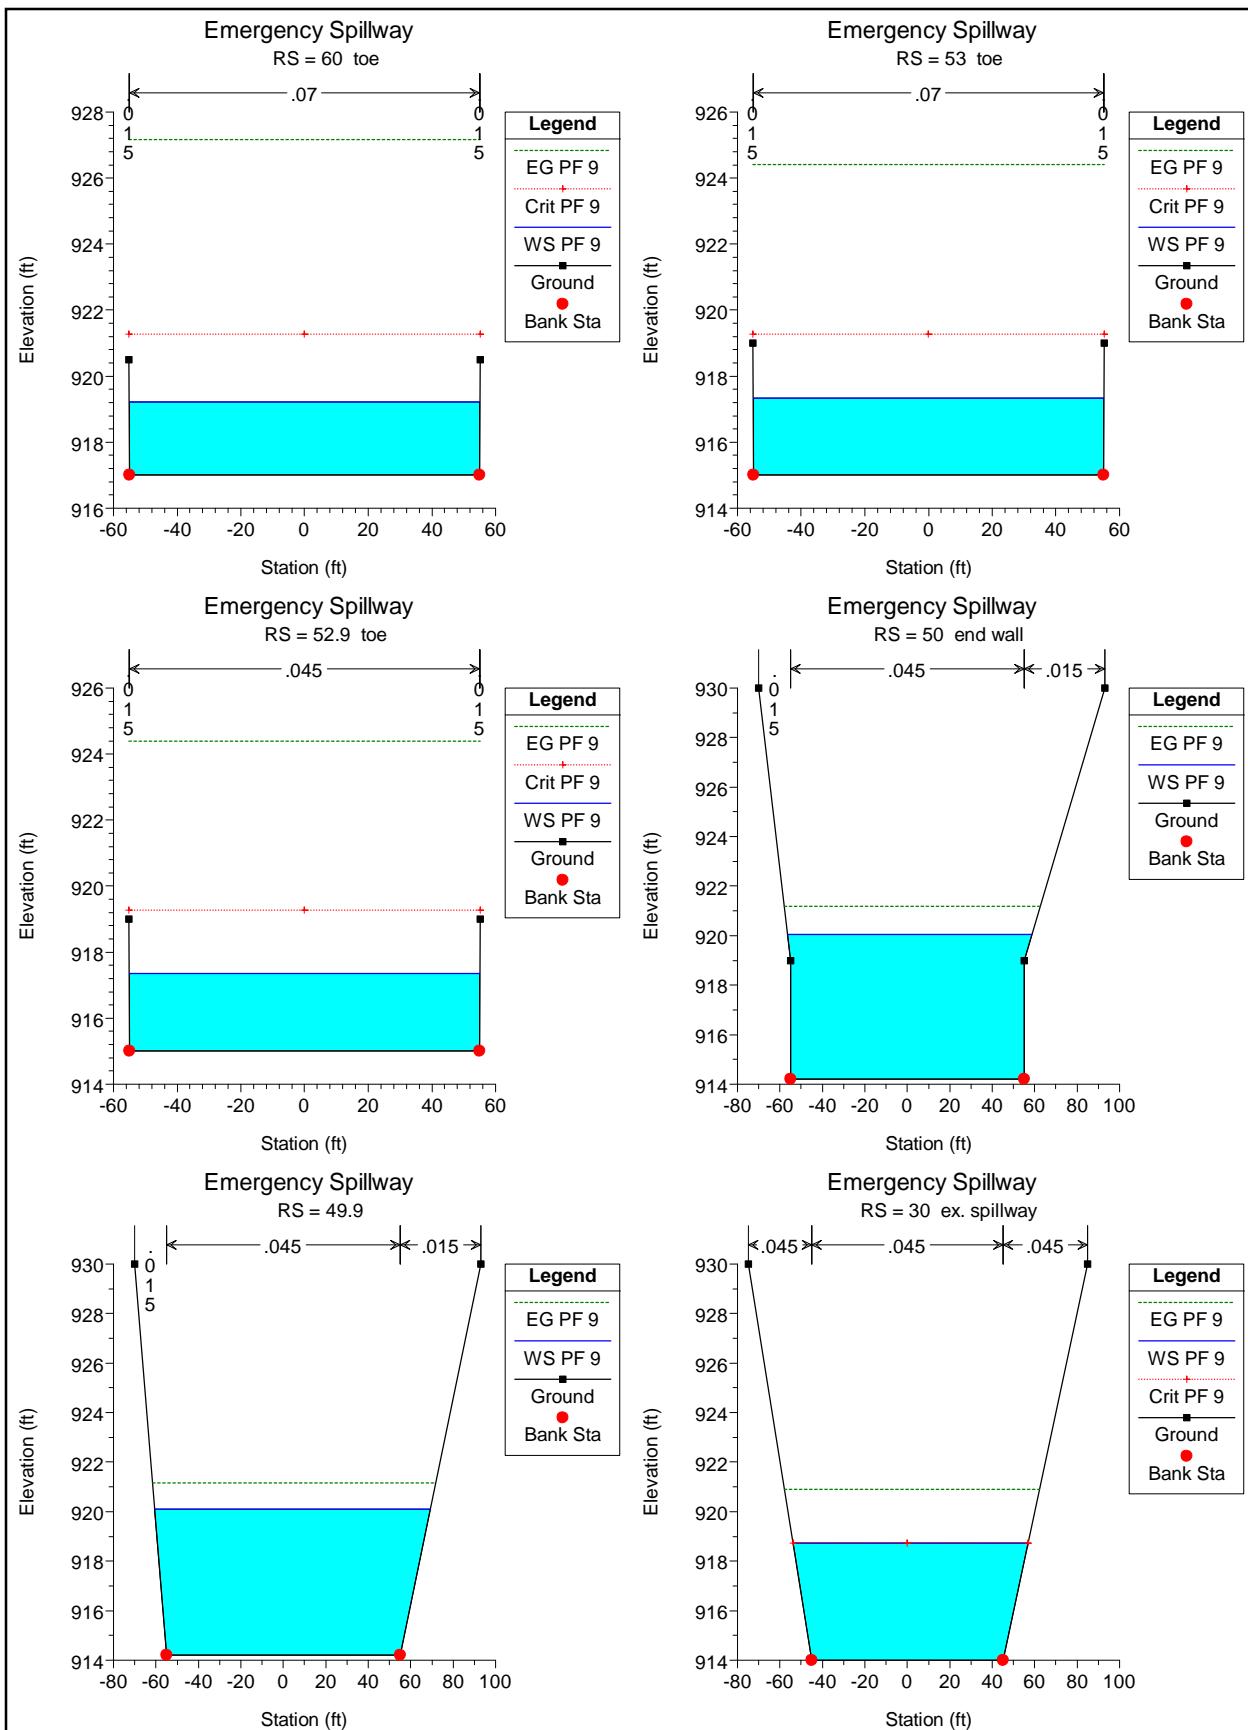

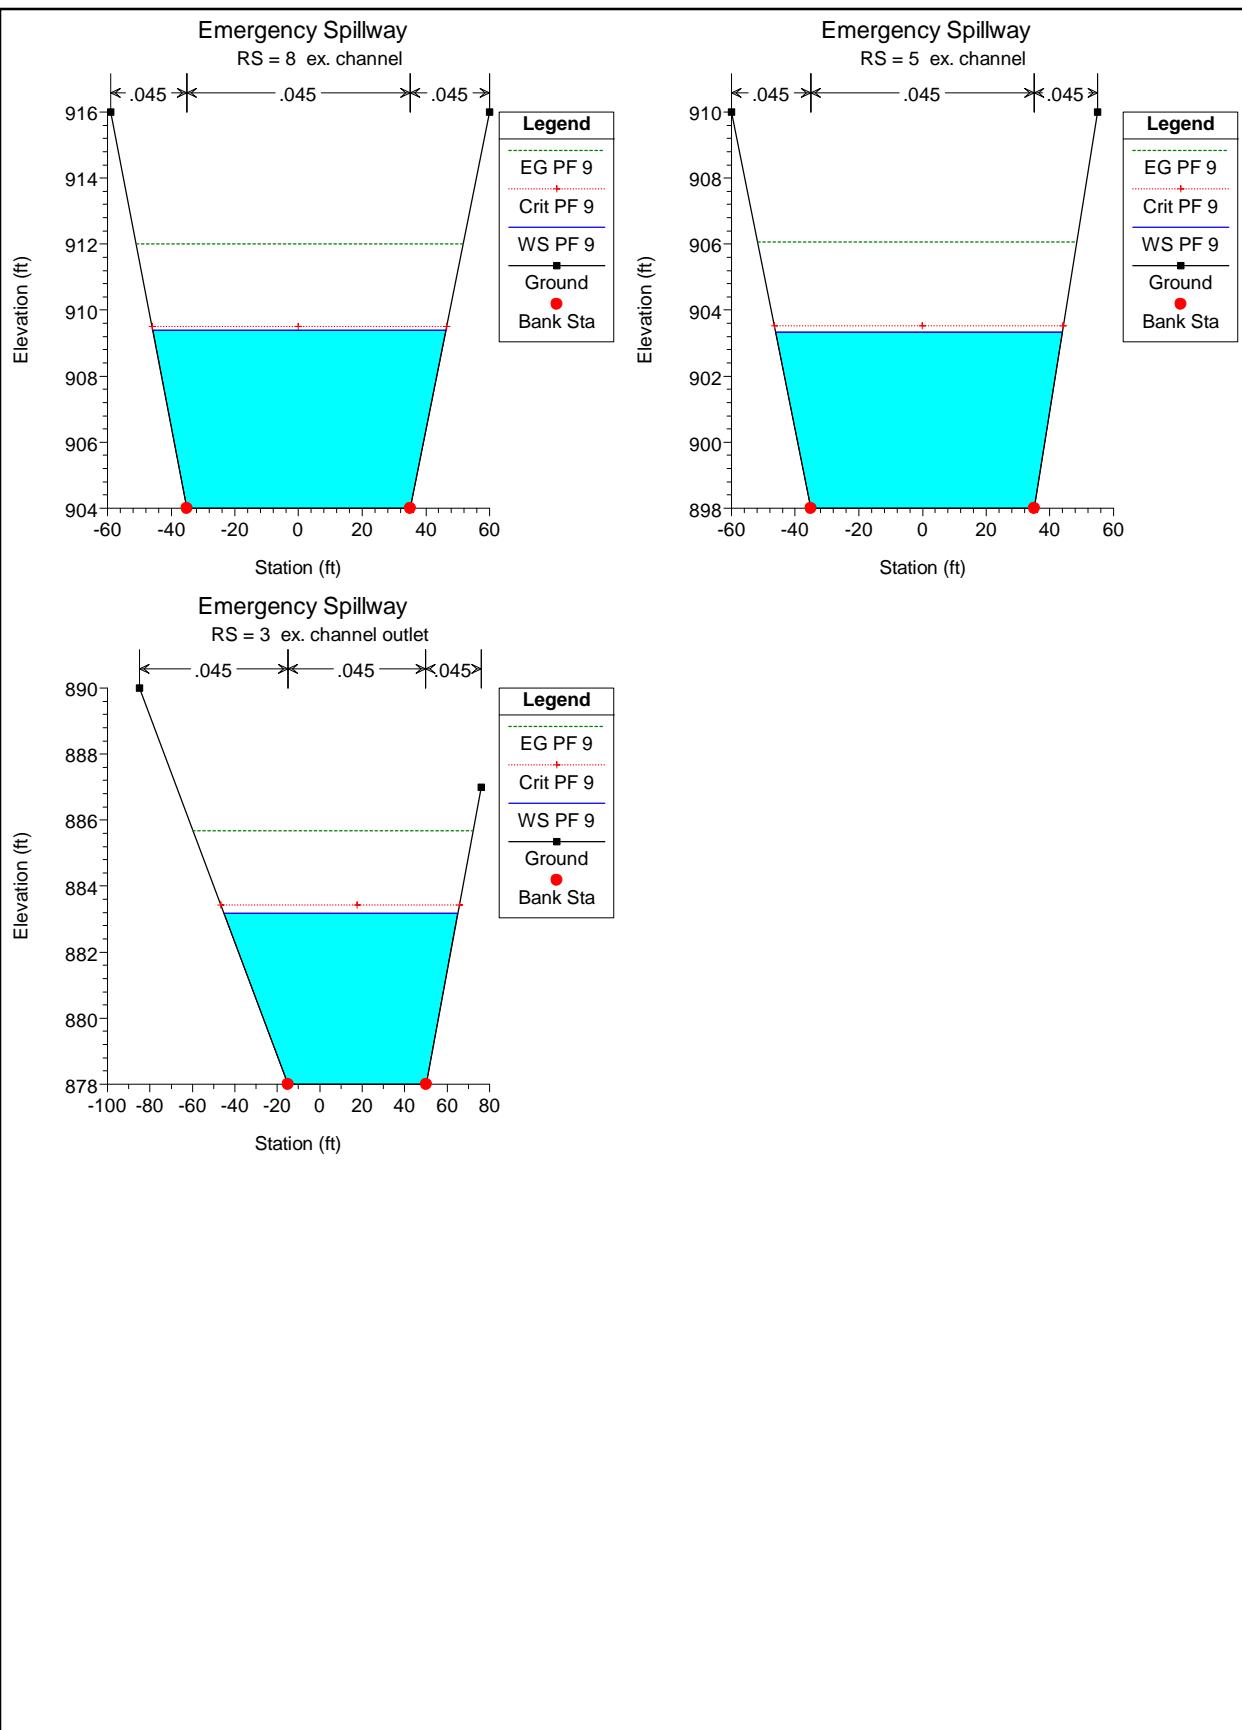


Table 3-1 (Continued) Manning's 'n' Values

Type of Channel and Description	Minimum	Normal	Maximum
<i>C. Excavated or Dredged Channels</i>			
1. Earth, straight and uniform			
a. Clean, recently completed	0.016	0.018	0.020
b. Clean, after weathering	0.018	0.022	0.025
c. Gravel, uniform section, clean	0.022	0.025	0.030
d. With short grass, few weeds	0.022	0.027	0.033
2. Earth, winding and sluggish			
a. No vegetation	0.023	0.025	0.030
b. Grass, some weeds	0.025	0.030	0.033
c. Dense weeds or aquatic plants in deep channels	0.030	0.035	0.040
d. Earth bottom and rubble side	0.028	0.030	0.035
e. Stony bottom and weedy banks	0.025	0.035	0.040
f. Cobble bottom and clean sides	0.030	0.040	0.050
3. Dragline-excavated or dredged			
a. No vegetation	0.025	0.028	0.033
b. Light brush on banks	0.035	0.050	0.060
4. Rock cuts			
a. Smooth and uniform	0.025	0.035	0.040
b. Jagged and irregular	0.035	0.040	0.050
5. Channels not maintained, weeds and brush			
a. Clean bottom, brush on sides	0.040	0.050	0.080
b. Same as above, highest stage of flow	0.045	0.070	0.110
c. Dense weeds, high as flow depth	0.050	0.080	0.120
d. Dense brush, high stage	0.080	0.100	0.140

Other sources that include pictures of selected streams as a guide to n value determination are available (Fasken, 1963; Barnes, 1967; and Hicks and Mason, 1991). In general, these references provide color photos with tables of calibrated n values for a range of flows.

Although there are many factors that affect the selection of the n value for the channel, some of the most important factors are the type and size of materials that compose the bed and banks of a channel, and the shape of the channel. Cowan (1956) developed a procedure for estimating the effects of these factors to determine the value of Manning's n of a channel. In Cowan's procedure, the value of n is computed by the following equation:

Table 3-1 (Continued) Manning's 'n' Values

Type of Channel and Description	Minimum	Normal	Maximum
B. Lined or Built-Up Channels			
1. Concrete			
a. Trowel finish	0.011	0.013	0.015
b. Float Finish	0.013	0.015	0.016
c. Finished, with gravel bottom	0.015	0.017	0.020
d. Unfinished	0.014	0.017	0.020
e. Gunite, good section	0.016	0.019	0.023
f. Gunite, wavy section	0.018	0.022	0.025
g. On good excavated rock	0.017	0.020	
h. On irregular excavated rock	0.022	0.027	
2. Concrete bottom float finished with sides of:			
a. Dressed stone in mortar	0.015	0.017	0.020
b. Random stone in mortar	0.017	0.020	0.024
c. Cement rubble masonry, plastered	0.016	0.020	0.024
d. Cement rubble masonry	0.020	0.025	0.030
e. Dry rubble on riprap	0.020	0.030	0.035
3. Gravel bottom with sides of:			
a. Formed concrete	0.017	0.020	0.025
b. Random stone in mortar	0.020	0.023	0.026
c. Dry rubble or riprap	0.023	0.033	0.036
4. Brick			
a. Glazed	0.011	0.013	0.015
b. In cement mortar	0.012	0.015	0.018
5. Metal			
a. Smooth steel surfaces	0.011	0.012	0.014
b. Corrugated metal	0.021	0.025	0.030
6. Asphalt			
a. Smooth	0.013	0.013	
b. Rough	0.016	0.016	
7. Vegetal lining			
	0.030	0.500	

Project/Proposal No. 11497-042 Calculated By AJS Date 9-14-12
 Project/Proposal Name Cardinal Checked By SJC Date 9/21/12
 Subject Stepped Spillway n Sheet of _____

Determine Manning's "n" for stepped spillway model in HEC-RAS

References: Boes, R.M., and Hager, W.H. (2003). "Hydraulic Design of Stepped Spillways." J. Hydraul. Eng. 129(9),

Ghare, A.D., Porey P.O., and Ingle, R.N. (2005). "Discussion of "Hydraulic Design of stepped Spillways" by Boes & Hager". J. Hydraul. Eng. 131, p. 524.

Fig. 1 of Discussion plots Manning's n vs. $\frac{Y_c}{H}$ for different H^*

$$Y_c = \frac{h_c}{h_u} \text{ normalized critical depth}$$

h_c = critical depth

h_u = uniform flow depth


H = spillway height $\approx 60'$

$$H^* = \frac{\text{spillway height}}{\text{step height}} = \frac{60'}{2'} = 30$$

$$\text{from HEC-RAS, } \frac{h_c}{h_u} = \frac{4.5'}{2'} = 2.25 = Y_c$$

$$\frac{Y_c}{H} = \frac{2.25}{60} = 0.0375 \quad (\text{for } n=0.07)$$

From Fig. 1, $n = 0.07$ for $\frac{Y_c}{H} = 0.0375$, $H^* = 30$

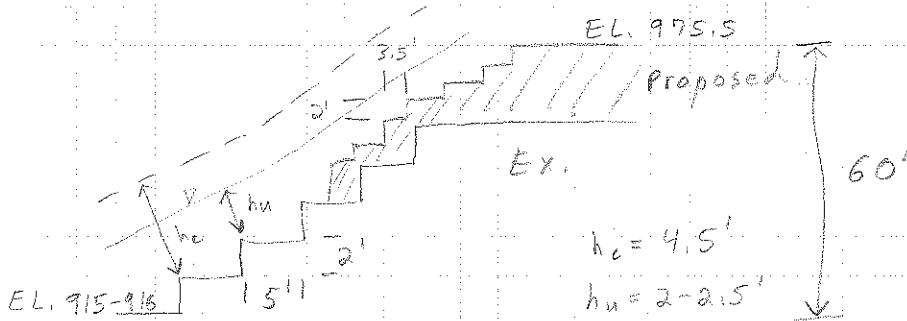

- flow and main stream skimming flows: An experimental study." *Can. J. Civ. Eng.*, 31(1), 33-44.
- Henderson, F. M. (1966). *Open channel flow*, MacMillan, New York.
- Laali, A. R., and Michel, J. M. (1984). "Air entrainment in ventilated cavities: Case of the fully developed 'half cavity'." *J. Fluids Eng., Trans ASME*, Sept., 106, 327-335.
- Matos, J. (2000). "Hydraulic design of stepped spillways over RCC dams." *Intl Workshop on Hydraulics of Stepped Spillways*, Zürich, Switzerland, H. E. Minor and W. H. Hager, eds., Balkema, Rotterdam, The Netherlands, 187-194.
- Michel, J. M. (1984). "Some features of water flows with ventilated cavities." *J. Fluids Eng., Trans ASME*, Sept., 106, 319-326.
- Ohtsu, I., Yasuda, Y., and Takahashi, M. (2000). "Characteristics of skimming flow over stepped spillways." *J. Hydraul. Eng.*, 126(11), 869-871.
- Shvajnshtejn, A. M. (1999). "Stepped spillways and energy dissipation." *Gidrotekh. Stroit.*, 5, 15-21 (in Russian).
- Silberman, E., and Song, C. S. (1961). "Instability of ventilated cavities." *J. Ship Res.*, 5(1), 13-33.
- Toombes, L., and Chanson, H. (2000). "Air-water flow and gas transfer at aeration cascades: A comparative study of smooth and stepped chutes." *Int. Workshop on Hydraulics of Stepped Spillways*, Zürich, Switzerland, Balkema, Rotterdam, The Netherlands, 77-84.
- Verron, J., and Michel, J. M. (1984). "Base-vented hydrofoils of finite span under a free surface: An experimental investigation." *J. Ship Res.*, 28(2), 90-106.
- Yasuda, Y., and Chanson, H. (2003). "Micro- and macroscopic study of two-phase flow on a stepped chute." *Proc., 30th IAHR Biennial Congress*, Thessaloniki, Greece, J. Ganoulis and P. Prinos, eds., vol. D, 695-702.
- Yasuda, Y., and Ohtsu, I. (1999). "Flow resistance of skimming flow in stepped channels." *Proc., 28th IAHR Congress*, Graz, Austria, session B14, (CD-ROM).

Discussion of "Hydraulic Design of Stepped Spillways" by Robert M. Boes and Willi H. Hager

September 2003, Vol. 129, No. 9, pp. 671-679.

DOI: 10.1061/(ASCE)0733-9429(2003)129:9(671)

A. D. Ghare¹; P. D. Porey²; and R. N. Ingle³

¹Sr. Lecturer, Civil Engineering Dept., D. C. V. Raman Institute of Technology, Nagpur, India.

²Professor, Civil Engineering Dept., Visvesvaraya National Institute of Technology, Nagpur, India.

³Emeritus Fellow, Civil Engineering Dept., Visvesvaraya National Institute of Technology, Nagpur, India.

The authors are to be complimented for presenting extensive experimental data on characteristics of aerated skimming flow over stepped spillways along with hydraulic design aspects of stepped spillways. The authors have focused their attention on various aspects, including onset of skimming flow, aeration characteristics, residual energy, and training wall design.

Considering the applicability of the design guidelines, the discussers would like to know the height of stepped spillway in the experimental setup for all 3 cases. Further, the authors may clarify regarding the limiting height of prototype stepped spillways up to which the design guidelines presented in this paper could be applied.

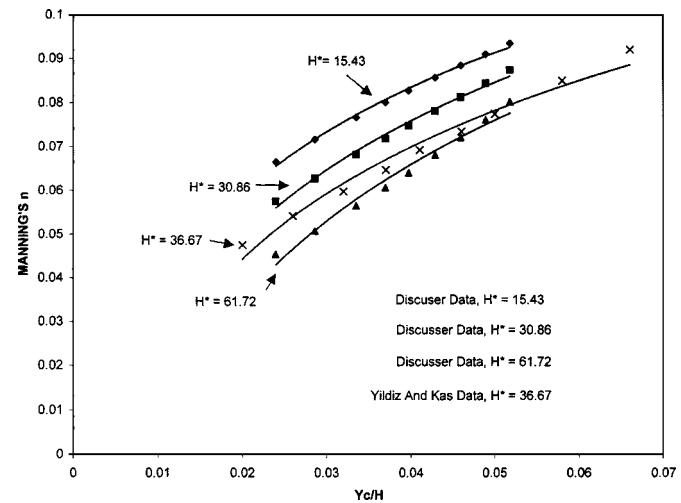


Fig. 1. Variation of Manning's n for different H^* values

The discussers would also like to know the number of steps provided in each case and the location of first step along the spillway profile. Can the authors suggest any readily usable explicit guidelines from hydraulic considerations for deciding on the step height, apart from the given RCC lift thickness? Some other investigators, including Rice and Kadavy (1996), Yildiz and Kas (1998), Chamani and Rajaratnam (1999) have indicated that the step height s affects the energy dissipation over stepped spillway.

Eq. (24) includes K , the roughness height perpendicular to the pseudobottom, which can be considered to be a representative term for step height s . In the last paragraph on energy dissipation, it is mentioned that Fig. 12 gives an idea of main parameters involved in the expression of relative residual energy. However, Fig. 12 does not indicate effect of any step height parameter on relative residual energy head ratio [H_{res}/H_{\max}]. Fig. (1) shows a plot compiled by discussers based on experimental data obtained by Ghare (2003) and Yildiz and Kas (1998), which show the effect of step height on Manning's equivalent n for a stepped spillway. In this plot H^* is considered a ratio of spillway height to step height. Can authors provide any other dimensionless plot that covers all the main parameters including step height s affecting the performance of the stepped spillway under skimming flow regime?

Proposed Eq. (24) is based on the results obtained from Eqs. (20) and (21). Hence the use of Eq. (24) appears to be a tedious process. As indicated by the authors in Fig. (12), the variation in relative residual energy head ratio for $\Phi=40^\circ$ and 50° is not appreciable; hence a simpler relationship for relative residual energy can be presented eliminating Φ as a variable. The resulting relationship would be applicable for Φ greater than 40° . Without a properly designed energy dissipation system on the downstream side, the hydraulic design of a stepped spillway system would be incomplete. The discussers would like to know the opinion of the authors regarding the applicability of the conventional conjugate depth relationship for stilling basin design in case of a stepped spillway where highly aerated flow near the toe of the spillway is encountered.

References

- Chamani, M. R., and Rajaratnam, N. (1999). "Characteristics of skimming flows over stepped spillways." *J. Hydr. Engrg.*, 125(4), 361-367.

$= (h_{w,e1} + h_{w,e2})/2 = 0.87$ m in the continuity equation yields a terminal velocity of $v_{w,e} = q_d/h_{w,e} = 20/0.87 \approx 23$ m/s.

If the chute was long enough for the attainment of uniform flow, i.e., $H_{\text{dam}} = H_{\text{dam},u} \approx 70$ m, the normalized residual head would read $H_{\text{res}}/H_{\text{max}} = 0.36$ according to Eq. (24b), with $f_b = 0.067$ from Eq. (21), $D_{h,w,u} \approx 4h_{w,u} = 4 \cdot 0.80 = 3.20$ m and $0.1 < K/D_{h,w,u} = 0.23 < 1.0$. In this case, 64% of the flow energy of $H_{\text{max}} \approx 75.2$ m would be dissipated on the spillway, and the terminal velocity would amount to $v_{w,e} \approx 20/0.80 = 25$ m/s.

Training Wall Design

With $\eta = 1.2$ for concrete dams, the required sidewall height from Eq. (25) is $h_d = 2.09$ m, with $h_{90,u} = 1.74$ m from Eq. (5). A sidewall height of 2.1 m is proposed. If the downstream dam face were prone to erosion, and if it were essential to avoid overtopping of the training walls, distinction should be made about whether the crest profile above the point of tangency is smooth or stepped. In the latter case, the required wall height should be at least $h_d = 1.5h_{90,u} = 2.61$ m, whereas for a smooth crest profile, the wall height should be $h_d = h_{\text{spray}} = 4s = 4 \times 1.2 = 4.8$ m over about $L = 25s = 25 \times 1.2 = 30$ m from the crest to allow for the spray resulting from nappe impact on the first steps below the smooth crest (Boes and Minor 2002).

Conclusions

The following findings of the present experimental study apply:

1. The onset of skimming flow is expressed by the ratio of critical depth to step height and follows a linear function as expressed in Eq. (1).
2. The uniform equivalent clear water depth $h_{w,u}$ on stepped spillways depends on the chute angle and unit discharge only, as given in Eq. (4).
3. The characteristic uniform mixture depth $h_{90,u}$ according to Eq. (5) is a function of step height, unit discharge and chute angle.
4. The drawdown length to the approximate location of uniform flow attainment as given in Eq. (13) depends on chute angle and unit discharge only.
5. The bottom roughness friction factor is approximated for a wide range of spillway angles and relative roughness by Eq. (20) or (21).
6. The significant effect of aeration on the reduction of friction factors is illustrated by the ratio f_w/f_m as function of the mean air concentration, Eq. (22), where f_w and f_m are friction factors with and without consideration of flow aeration, respectively.
7. A general expression of residual energy head along stepped chutes is given in Eq. (24), with distinction between developing and uniform flow regions.
8. Stepped spillway training walls should be designed according to Eq. (25), taking into account the erosion potential of the downstream dam face.

These conclusions in conjunction with the results of Boes and Hager (2003) allow for the hydraulic design of stepped spillways for a wide range of boundary conditions including typical applications both for embankment and gravity dams.

Acknowledgment

The present project was financed by the Swiss National Science Foundation, Grant No. 21-45424.95. The assistance of Professor

Y. Yasuda, Nihon University, Tokyo, in providing experimental data is also gratefully acknowledged.

Notation

The following symbols are used in this paper:


b	spillway or river width;
\bar{C}	depth-averaged air concentration;
\bar{C}_i	depth-averaged air concentration at inception point;
\bar{C}_u	uniform depth-averaged air concentration;
$C(y)$	local air concentration;
$D_{h,w}$	$4R_{h,w}$ hydraulic diameter;
$D_{h,\text{eff}}$	$wD_{h,w}$ effective hydraulic diameter;
F	$u/(gh)^{1/2}$ local Froude number;
F_0	$q_w/(gh_0^3)^{1/2}$ approach Froude number at jetbox;
F_*	$q_w/(g \sin \phi s^3)^{1/2}$ roughness Froude number;
f	Darcy–Weisbach friction factor of unaerated flow;
f_b	friction factor of bottom roughness;
f_m	Darcy–Weisbach friction factor in two-phase flow without consideration of aeration;
f_s	skin friction factor of sidewall roughness;
f_w	Darcy–Weisbach friction factor in two-phase flow with consideration of aeration;
g	gravitational acceleration;
H_{dam}	vertical spillway or dam height;
$H_{\text{dam},u}$	vertical distance from spillway crest to close uniform equivalent clear water flow;
H_{max}	maximum reservoir energy head;
H_{res}	residual energy head;
h	local flow depth;
h_c	critical depth;
h_d	training wall design height;
h_m	mixture depth;
$h_{m,i}$	mixture depth at inception point;
h_{spray}	spray height resulting from nappe impact on steps;
h_u	uniform flow depth;
h_w	$(1 - \bar{C})h_90$ equivalent clear water depth;
$h_{w,e}$	clear water depth at chute end;
$h_{w,i}$	clear water depth at inception point;
$h_{w,u}$	uniform equivalent clear water depth;
h_{90}	$h(C=0.90)$ characteristic mixture depth with local air concentration of $C=0.90$;
h_0	approach flow depth at jetbox;
$h_{90,u}$	uniform characteristic mixture depth;
K	$s \cdot \cos \phi$ roughness height perpendicular to pseudobottom;
L_i	black water length from spillway crest to inception point;
L_s	$s/\sin \phi = K/(\sin \phi \cos \phi) = 2K/\sin(2\phi)$ distance between step edges, roughness spacing;
Q_d	design discharge;
Q_w	water discharge;
q_d	design discharge per unit width;
q_w	water discharge per unit width;
R	$uD_{h,w}/v$ Reynolds number;
$R_{h,w}$	hydraulic radius;
S_f	friction slope;
s	step height;
u	flow velocity in x direction;
$v_{m,i}$	mixture velocity at inception point;
$v_{w,e}$	clear water velocity at chute end;

$v_{w,i}$ = clear water velocity at inception point;
 w = shape correction coefficient;
 x = streamwise coordinate originating at spillway crest;
 $x_s = h_c^3/(h_{w,u}^2 \sin \phi)$ scaling length;
 x_u = drawdown length from spillway crest to close uniform equivalent clear water flow;
 $Y = h/h_u$ normalized local flow depth;
 $Y_c = h_c/h_u$ normalized critical depth;
 y = transverse coordinate originating at pseudobottom;
 z_i = vertical black water length from spillway crest to inception point;
 α = energy correction coefficient;
 η = safety factor;
 ν = kinematic viscosity of water
 $\Pi_1 = 0.5 - 0.42 \sin(2\phi)$ function taking into account roughness spacing;
 $\Pi_2 = (K/D_{h,w})^{0.2}$ function taking into account relative chute roughness;
 σ = factor originating from Gauckler–Manning–Strickler formula;
 ϕ = chute angle from horizontal; and
 $\chi = x/x_s$ normalized streamwise coordinate.

References

- Boes, R. M. (2000). "Zweiphasenströmung und Energieumsetzung auf Grosskaskaden." PhD thesis, VAW, ETH Zurich, Switzerland (in German).
- Boes, R. M., and Hager, W. H. (1998). "Fiber-optical experimentation in two-phase cascade flow." *Proc., Int. RCC Dams Seminar*, K. Hansen, ed., Denver.
- Boes, R. M., and Hager, W. H. (2003). "Two-phase flow characteristics of stepped spillways." *J. Hydraul. Eng.*, 129(9), 661–570.
- Boes, R. M., and Minor, H.-E. (2000). "Guidelines for the hydraulic design of stepped spillways." *Proc., Int. Workshop on Hydraulics of Stepped Spillways*, VAW, ETH Zurich, H.-E. Minor and W. H. Hager, eds., Balkema, Rotterdam, The Netherlands, 163–170.
- Boes, R., and Minor, H.-E. (2002). "Hydraulic design of stepped spillways for RCC dams." *Hydropower Dams*, 9(3), 87–91.
- Chamani, M. R., and Rajaratnam, N. (1999a). "Onset of skimming flow on stepped spillways." *J. Hydraul. Eng.*, 125(9), 969–971.
- Chamani, M. R., and Rajaratnam, N. (1999b). "Characteristics of skimming flow over stepped spillways." *J. Hydraul. Eng.*, 125(4), 361–368.
- Chanson, H. (1994). *Hydraulic design of stepped cascades, channels, weirs and spillways*, Pergamon, Oxford, U.K.
- Chanson, H. (1996). "Prediction of the transition nappe/skimming flow on a stepped channel." *J. Hydraul. Res.*, 34(3), 421–429.
- Chanson, H. (2000). "Experience, operation and accidents with stepped cascades." *Presented at the Int. Workshop on Hydraulics of Stepped Spillways*, VAW, ETH, Zurich.
- Chanson, H., Yasuda, Y., and Ohtsu, I. (2000). "Flow resistance in skimming flow: A critical review." *Proc., Int. Workshop on Hydraulics of Stepped Spillways*, VAW, ETH Zurich, H.-E. Minor and W. H. Hager, eds., Balkema, Rotterdam, The Netherlands, 95–102.
- Chow, V. T. (1959). *Open channel hydraulics*, McGraw-Hill, New York.
- Frizzell, K. H., Smith, D. H., and Ruff, J. F. (1994). "Stepped overlays proven for use in protecting overtopped embankment dams." *Proc., ASDSO Annual Conf.*, Boston.
- Hager, W. H. (1991). "Uniform aerated chute flow." *J. Hydraul. Eng.*, 117(4), 528–533.
- Hager, W. H., and Blaser, F. (1998). "Drawdown curve and incipient aeration for chute flow." *Can. J. Civ. Eng.*, 25(3), 467–473.
- Hager, W. H., and Boes, R. M. (2000). "Backwater and drawdown curves in stepped spillway flow." *Proc., Int. Workshop on Hydraulics of Stepped Spillways*, VAW, ETH Zurich, H.-E. Minor and W. H. Hager, eds., Balkema, Rotterdam, The Netherlands, 129–136.
- Homann, C., Schramm, J., Demny, G., and Köngeter, J. (2000). "Wellenerscheinungen in der Hochwasserentlastungskaskade der Sorpetalsperre." *Proc., 2. Ju Wi-Treffen*, VAW, ETH Zurich, Switzerland, 30–32 (in German).
- James, C. S. (2001). "Discussion of 'Onset of skimming flow on stepped spillways' by M. R. Chamani and N. Rajaratnam." *J. Hydraul. Eng.*, 127(6), 519.
- Marchi, E. (1961). "Il moto uniforme delle correnti liquide nei condotti chiusi e aperti." *Energ. Elet.*, 38(4), 289–301, (5), 393–413 (in Italian).
- Matos, J. (2000a). "Discussion of 'Hydraulics of skimming flow on modeled stepped spillways' by G. G. S. Pegram, A. K. Officer, and S. R. Mottram." *J. Hydraul. Eng.*, 126(12), 948–950.
- Matos, J. (2000b). "Discussion of 'Characteristics of skimming flow over stepped spillways' by M. R. Chamani and N. Rajaratnam." *J. Hydraul. Eng.*, 126(11), 865–869.
- Matos, J. (2001). "Discussion of 'Onset of skimming flow on stepped spillways' by M. R. Chamani and N. Rajaratnam." *J. Hydraul. Eng.*, 127(6), 519–521.
- Matos, J., and Quintela, A. (1995). "Guidelines for the hydraulic design of stepped spillways for concrete dams." *ICOLD Energy Dissipation Bull.*
- Matos, J., Sanchez, M., Quintela, A., and Dolz, J. (1999). "Characteristic depth and pressure profiles in skimming flow over stepped spillways." *Proc., 28th IAHR Congress*, (CD-ROM) H. Bergmann, R. Krainer, and H. Breinhälder, eds., Graz, Austria B14.
- Ohtsu, I., and Yasuda, Y. (1997). "Characteristics of flow conditions on stepped channels." *Proc., 27th IAHR Congress*, F. M. Holly and A. Alsaffar, eds., San Francisco, 583–588.
- Ohtsu, I., Yasuda, Y., and Takahashi, M. (2000). "Discussion of 'Hydraulics of skimming flow on modeled stepped spillways' by G. G. S. Pegram, A. K. Officer, and S. R. Mottram." *J. Hydraul. Eng.*, 126(12), 950–951.
- Ohtsu, I., Yasuda, Y., and Takahashi, M. (2001). "Discussion of 'Onset of skimming flow on stepped spillways' by M. R. Chamani and N. Rajaratnam." *J. Hydraul. Eng.*, 127(6), 522–524.
- Rajaratnam, N. (1990). "Skimming flow in stepped spillways." *J. Hydraul. Eng.*, 116(4), 587–591.
- Schläpfer, D. (2000). "Treppenschussrinnen." MSc thesis, VAW, ETH Zurich, Switzerland (in German).
- Schröder, R. C. M. (1990). "Hydraulische Methoden zur Erfassung von Rauheiten." *DVVW Bull.* 92, Paul Parey, Germany (in German).
- Stephenson, D. (1991). "Energy dissipation down stepped spillways." *Int. Water Power Dam Constr.*, 43(9), 27–30.
- Tatewar, S. P., Ingle, R. N., and Porey, P. D. (2001). "Discussion of 'Onset of skimming flow on stepped spillways,' by M. R. Chamani and N. Rajaratnam." *J. Hydraul. Eng.*, 127(6), 524.
- Tozzi, M. J. (1992). "Caracterização/comportamento de escoamentos em vertedouros com paramento em degraus." PhD thesis, Univ. of São Paulo, São Paulo, Brazil (in Portuguese).
- Wahrheit-Lensing, A. (1996). "Selbstbelüftung und Energieumwandlung beim Abfluss über treppenförmige Entlastungsanlagen." PhD thesis, Univ. of Karlsruhe, Karlsruhe, Germany (in German).
- Yasuda, Y., and Ohtsu, I. (1999). "Flow resistance of skimming flows in stepped channels." *Proc., 28th IAHR Congress*, H. Bergmann, R. Krainer, and H. Breinhälder, eds. (CD-ROM), Graz, Austria, B14.
- Yıldız, D., and Kas, I. (1998). "Hydraulic performance of stepped chute spillways." *Hydropower Dams*, 5(4), 64–70.

Cardinal Dam Raising - Top of Dam El. 983.0 - PMF Event
Flow vs. Stage Hydrograph

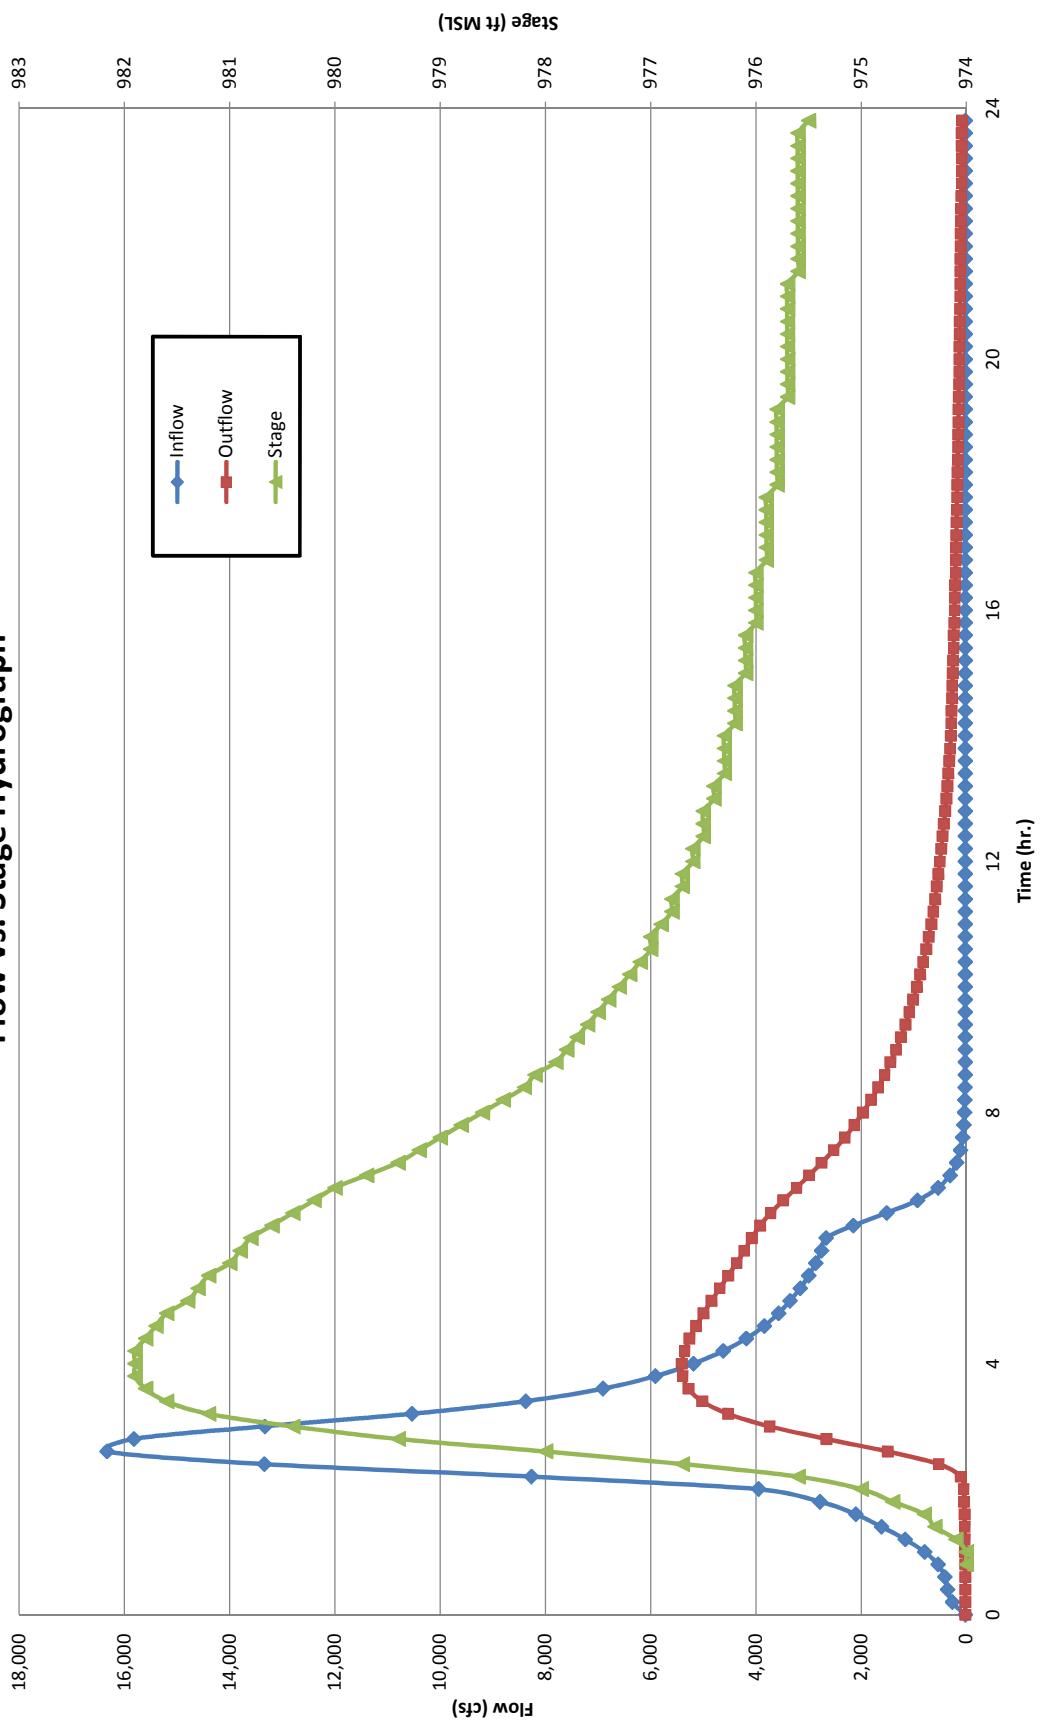

 *
 * FLOOD HYDROGRAPH PACKAGE (HEC-1) *
 * JUN 1998 *
 * VERSION 4.1 *
 *
 * RUN DATE 22SEP12 TIME 16:34:01 *
 *
 *

P/M F

* U.S. ARMY CORPS OF ENGINEERS
 * HYDROLOGIC ENGINEERING CENTER
 * 609 SECOND STREET
 * DAVIS, CALIFORNIA 95616
 * (916) 756-1104
 *

```

      X   X   XXXXXX  XXXXX      X
      X   X   X       X   XX
      X   X   X       X       X
      XXXXXX XXXX  X       XXXXX  X
      X   X   X       X       X
      X   X   X       X   X       X
      X   X   XXXXXX  XXXXX      XXX
  
```

THIS PROGRAM REPLACES ALL PREVIOUS VERSIONS OF HEC-1 KNOWN AS HEC1 (JAN 73), HEC1GS, HEC1DB, AND HEC1KW.

THE DEFINITIONS OF VARIABLES -RTIMP- AND -RTIOR- HAVE CHANGED FROM THOSE USED WITH THE 1973-STYLE INPUT STRUCTURE.
 THE DEFINITION OF -AMSKK- ON RM-CARD WAS CHANGED WITH REVISIONS DATED 28 SEP 81. THIS IS THE FORTRAN77 VERSION
 NEW OPTIONS: DAMBREAK OUTFLOW SUMMERGENCE, SINGLE EVENT DAMAGE CALCULATION, DSS:WRITE STAGE FREQUENCY,
 DSS:READ TIME SERIES AT DESIRED CALCULATION INTERVAL LOSS RATE:GREEN AND AMPT INFILTRATION
 KINEMATIC WAVE: NEW FINITE DIFFERENCE ALGORITHM

1 HEC-1 INPUT PAGE 1

LINE	ID.....1.....2.....3.....4.....5.....6.....7.....8.....9.....10
*** FREE ***	
1	ID CARDINAL FLY ASH DAM #2
2	ID THIRD RAISING - CREST OF 983 FT
3	ID DESIGN FLOOD PMP, 6-HR
4	ID FILE: FAD2-PMP-105FT
5	IT 12 0 0 120
6	IO 1
7	PG 10 26.5
8	PC 0 .0130 .027 .042 .059 .078 .099 .122 .147 .18
9	PC .23 .38 .53 .625 .67 .705 .736 .764 .79 .814
10	PC .836 .856 .875 .8931 .9103 .9267 .9423 .9573 .9719 .9861
11	PC 1.0
12	KK WEST RUNOFF FROM FAD#1 WATERSHED
13	KM RECLAIMED POND AND LANDFILL
14	BA 1.06
15	LS 0 75
16	PR 10
17	PW 1
18	PT 10
19	UD 0.52
20	KK EAST RUNOFF FROM EAST WATERSHED
21	KM WOODS ONLY
22	BA 0.75
23	LS 0 70
24	PR 10
25	PW 1
26	PT 10
27	UD 0.34
28	KK LAKE INSTANTANEOUS RUNOFF FROM LAKE SURFACE
29	KM LAKE ONLY
30	BA 0.30
31	BF 20
32	LS 0 100
33	PR 10
34	PW 1
35	PT 10
36	UD 0.1
37	KK IN COMBINE INFLOWS FROM WEST AND EAST WATERSHEDS AND LAKE SURFACE
38	HC 3
39	KK DAM ROUTE FLOOD HYDROGRAPHS THRU FAD#2
40	KM STARTING POOL IS MAXIMUM OPERATING LEVEL
41	KM MAXIMUM TOP OF STOP LOG IS 972.5
42	KM STOP LOG WIDTH IS 4 FT

PAGE 2

LINE ID.....1.....2.....3.....4.....5.....6.....7.....8.....9.....10

50	SS	975.5
51	ST	983
52	ZZ	

```
*****
*          *
*      FLOOD HYDROGRAPH PACKAGE (HEC-1) *
*          JUN 1998   *
*          VERSION 4.1   *
*          *
*      RUN DATE 22SEP12 TIME 16:34:01   *
*          *
*****
```

CARDINAL FLY ASH DAM #2
THIRD RAISING - CREST OF 983 FT
DESIGN FLOOD PMP, 6-HR
FILE: FAD2-PMP-105FT

```

6 IO      OUTPUT CONTROL VARIABLES
          IPRINT           1 PRINT CONTROL
          IPLOT            0 PLOT CONTROL
          QSCAL            0. HYDROGRAPH PLOT SCALE

IT      HYDROGRAPH TIME DATA
          NMIN             12 MINUTES IN COMPUTATION INTERVAL
          IDATE           1 0 STARTING DATE
          ITIME            0000 STARTING TIME
          NQ               120 NUMBER OF HYDROGRAPH ORDINATES
          NDDATE          1 0 ENDING DATE
          NDTIME           2348 ENDING TIME
          ICENT            19 CENTURY MARK

          COMPUTATION INTERVAL    .20 HOURS
          TOTAL TIME BASE       23.80 HOURS

```

ENGLISH UNITS	
DRAINAGE AREA	SQUARE MILES
PRECIPITATION DEPTH	INCHES
LENGTH, ELEVATION	FEET
FLOW	CUBIC FEET PER SECOND
STORAGE VOLUME	ACRE-FEET
SURFACE AREA	ACRES
TEMPERATURE	DEGREES FAHRENHEIT

* * * * *
* * * * *
12 KK * WEST * * RUNOFF FROM FAD#1 WATERSHED
* * * * *

RECLAIMED POND AND LANDFILL

SUBBASIN RUNOFF DATA

14 BA SUBBASIN CHARACTERISTICS
TAREA 1.06 SUBBASIN AREA

PRECIPITATION DATA

18 PT TOTAL STORM STATIONS 10
0 PW WEIGHTS 1.00

16 PR RECORDING STATIONS 10
17 PW WEIGHTS 1.00

15 LS SCS LOSS RATE

15 LS SCS LOSS RATE

15 LS SCS LOSS RATE

STRTL .67 INITIAL ABSTRACTION
 CRVNBR 75.00 CURVE NUMBER
 RTIMP .00 PERCENT IMPERVIOUS AREA

19 UD SCS DIMENSIONLESS UNITGRAPH
 TLAG .52 LAG

PRECIPITATION STATION DATA

STATION	TOTAL	AVG. ANNUAL	WEIGHT
10	26.50	.00	1.00

TEMPORAL DISTRIBUTIONS

STATION	10, WEIGHT = 1.00
.01	.01 .01 .02 .02 .02 .02 .02 .02 .03 .02 .02 .05
.15	.15 .10 .05 .03 .03 .03 .03 .03 .02 .02 .02 .02
.02	.02 .02 .02 .02 .02 .01 .01 .01 .01 .01 .01 .01
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00

WARNING *** TIME INTERVAL IS GREATER THAN .29*LAG

UNIT HYDROGRAPH
 15 END-OF-PERIOD ORDINATES
 180. 607. 826. 716. 453. 259. 157. 92. 54. 32.
 19. 11. 7. 4. 1.

HYDROGRAPH AT STATION WEST

DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q	*	DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q
1	0000	1	.00	.00	0.	0.	*	*	1	1200	61	.00	.00	.00	0.	0.
1	0012	2	.34	.34	0.	0.	*	*	1	1212	62	.00	.00	.00	0.	0.
1	0024	3	.37	.37	0.	0.	*	*	1	1224	63	.00	.00	.00	0.	0.
1	0036	4	.40	.35	.05	10.	*	*	1	1236	64	.00	.00	.00	0.	0.
1	0048	5	.45	.31	.14	57.	*	*	1	1248	65	.00	.00	.00	0.	0.
1	0100	6	.50	.28	.22	167.	*	*	1	1300	66	.00	.00	.00	0.	0.
1	0112	7	.56	.25	.31	343.	*	*	1	1312	67	.00	.00	.00	0.	0.
1	0124	8	.61	.22	.39	566.	*	*	1	1324	68	.00	.00	.00	0.	0.
1	0136	9	.66	.19	.47	815.	*	*	1	1336	69	.00	.00	.00	0.	0.
1	0148	10	.97	.20	.68	1100.	*	*	1	1348	70	.00	.00	.00	0.	0.
1	0200	11	1.32	.23	1.10	1504.	*	*	1	1400	71	.00	.00	.00	0.	0.
1	0212	12	3.97	.40	3.58	2516.	*	*	1	1412	72	.00	.00	.00	0.	0.
1	0224	13	3.97	.21	3.77	4635.	*	*	1	1424	73	.00	.00	.00	0.	0.
1	0236	14	2.52	.09	2.43	7003.	*	*	1	1436	74	.00	.00	.00	0.	0.
1	0248	15	1.19	.03	1.16	8174.	*	*	1	1448	75	.00	.00	.00	0.	0.
1	0300	16	.93	.02	.90	7671.	*	*	1	1500	76	.00	.00	.00	0.	0.
1	0312	17	.82	.02	.80	6310.	*	*	1	1512	77	.00	.00	.00	0.	0.
1	0324	18	.74	.02	.73	5000.	*	*	1	1524	78	.00	.00	.00	0.	0.
1	0336	19	.69	.01	.67	4045.	*	*	1	1536	79	.00	.00	.00	0.	0.
1	0348	20	.64	.01	.62	3386.	*	*	1	1548	80	.00	.00	.00	0.	0.
1	0400	21	.58	.01	.57	2915.	*	*	1	1600	81	.00	.00	.00	0.	0.
1	0412	22	.53	.01	.52	2566.	*	*	1	1612	82	.00	.00	.00	0.	0.
1	0424	23	.50	.01	.49	2292.	*	*	1	1624	83	.00	.00	.00	0.	0.
1	0436	24	.48	.01	.47	2077.	*	*	1	1636	84	.00	.00	.00	0.	0.
1	0448	25	.46	.01	.45	1908.	*	*	1	1648	85	.00	.00	.00	0.	0.
1	0500	26	.43	.01	.43	1771.	*	*	1	1700	86	.00	.00	.00	0.	0.
1	0512	27	.41	.01	.41	1657.	*	*	1	1712	87	.00	.00	.00	0.	0.
1	0524	28	.40	.01	.39	1562.	*	*	1	1724	88	.00	.00	.00	0.	0.
1	0536	29	.39	.01	.38	1484.	*	*	1	1736	89	.00	.00	.00	0.	0.
1	0548	30	.38	.01	.37	1419.	*	*	1	1748	90	.00	.00	.00	0.	0.
1	0600	31	.37	.00	.36	1366.	*	*	1	1800	91	.00	.00	.00	0.	0.
1	0612	32	.00	.00	.00	1258.	*	*	1	1812	92	.00	.00	.00	0.	0.
1	0624	33	.00	.00	.00	1007.	*	*	1	1824	93	.00	.00	.00	0.	0.
1	0636	34	.00	.00	.00	686.	*	*	1	1836	94	.00	.00	.00	0.	0.
1	0648	35	.00	.00	.00	413.	*	*	1	1848	95	.00	.00	.00	0.	0.
1	0700	36	.00	.00	.00	241.	*	*	1	1900	96	.00	.00	.00	0.	0.
1	0712	37	.00	.00	.00	143.	*	*	1	1912	97	.00	.00	.00	0.	0.
1	0724	38	.00	.00	.00	83.	*	*	1	1924	98	.00	.00	.00	0.	0.
1	0736	39	.00	.00	.00	49.	*	*	1	1936	99	.00	.00	.00	0.	0.
1	0748	40	.00	.00	.00	28.	*	*	1	1948	100	.00	.00	.00	0.	0.
1	0800	41	.00	.00	.00	16.	*	*	1	2000	101	.00	.00	.00	0.	0.
1	0812	42	.00	.00	.00	9.	*	*	1	2012	102	.00	.00	.00	0.	0.
1	0824	43	.00	.00	.00	5.	*	*	1	2024	103	.00	.00	.00	0.	0.
1	0836	44	.00	.00	.00	2.	*	*	1	2036	104	.00	.00	.00	0.	0.
1	0848	45	.00	.00	.00	0.	*	*	1	2048	105	.00	.00	.00	0.	0.
1	0900	46	.00	.00	.00	0.	*	*	1	2100	106	.00	.00	.00	0.	0.

1	0912	47	.00	.00	.00	0.	*	1	2112	107	.00	.00	.00	0.
1	0924	48	.00	.00	.00	0.	*	1	2124	108	.00	.00	.00	0.
1	0936	49	.00	.00	.00	0.	*	1	2136	109	.00	.00	.00	0.
1	0948	50	.00	.00	.00	0.	*	1	2148	110	.00	.00	.00	0.
1	1000	51	.00	.00	.00	0.	*	1	2200	111	.00	.00	.00	0.
1	1012	52	.00	.00	.00	0.	*	1	2212	112	.00	.00	.00	0.
1	1024	53	.00	.00	.00	0.	*	1	2224	113	.00	.00	.00	0.
1	1036	54	.00	.00	.00	0.	*	1	2236	114	.00	.00	.00	0.
1	1048	55	.00	.00	.00	0.	*	1	2248	115	.00	.00	.00	0.
1	1100	56	.00	.00	.00	0.	*	1	2300	116	.00	.00	.00	0.
1	1112	57	.00	.00	.00	0.	*	1	2312	117	.00	.00	.00	0.
1	1124	58	.00	.00	.00	0.	*	1	2324	118	.00	.00	.00	0.
1	1136	59	.00	.00	.00	0.	*	1	2336	119	.00	.00	.00	0.
1	1148	60	.00	.00	.00	0.	*	1	2348	120	.00	.00	.00	0.

TOTAL RAINFALL = 26.50, TOTAL LOSS = 3.62, TOTAL EXCESS = 22.88

PEAK FLOW + (CFS)	TIME (HR)	MAXIMUM AVERAGE FLOW			23.80-HR
		6-HR	24-HR	72-HR	
+ 8174.	2.80	2588.	658.	658.	658.
		(INCHES) 22.704	22.881	22.881	22.881
		(AC-FT) 1264.	1294.	1294.	1294.

CUMULATIVE AREA = 1.06 SQ MI

* * * * *
20 KK * * EAST * RUNOFF FROM EAST WATERSHED
* * * * *
WOODS ONLY

SUBBASIN RUNOFF DATA

22 BA SUBBASIN CHARACTERISTICS
TAREA .75 SUBBASIN AREA

PRECIPITATION DATA

26 PT TOTAL STORM STATIONS 10
0 PW WEIGHTS 1.00

24 PR RECORDING STATIONS 10
25 PW WEIGHTS 1.00

23 LS SCS LOSS RATE
STRTL .86 INITIAL ABSTRACTION
CRVNBR 70.00 CURVE NUMBER
RTIMP .00 PERCENT IMPERVIOUS AREA

27 UD SCS DIMENSIONLESS UNITGRAPH
TLAG .34 LAG

PRECIPITATION STATION DATA

STATION	TOTAL	AVG. ANNUAL	WEIGHT
10	26.50	.00	1.00

TEMPORAL DISTRIBUTIONS

STATION	10, WEIGHT = 1.00	.01	.01	.02	.02	.02	.02	.02	.03	.05
.15	.15	.10	.05	.03	.03	.03	.03	.02	.02	.02
.02	.02	.02	.02	.02	.02	.01	.01	.01	.01	.01
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00

WARNING *** TIME INTERVAL IS GREATER THAN .29*LAG

UNIT HYDROGRAPH									
10 END-OF-PERIOD ORDINATES									
329.	820.	669.	314.	153.	73.	34.	16.	8.	4.

HYDROGRAPH AT STATION EAST

DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q	*	DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q
								*								
1	0000	1	.00	.00	.00	.00	0.	*	1	1200	61	.00	.00	.00	.00	0.
1	0012	2	.34	.34	.00	0.	*	*	1	1212	62	.00	.00	.00	.00	0.
1	0024	3	.37	.37	.00	0.	*	*	1	1224	63	.00	.00	.00	.00	0.
1	0036	4	.40	.38	.01	5.	*	*	1	1236	64	.00	.00	.00	.00	0.
1	0048	5	.45	.36	.09	40.	*	*	1	1248	65	.00	.00	.00	.00	0.
1	0100	6	.50	.34	.17	134.	*	*	1	1300	66	.00	.00	.00	.00	0.
1	0112	7	.56	.31	.25	280.	*	*	1	1312	67	.00	.00	.00	.00	0.
1	0124	8	.61	.28	.33	454.	*	*	1	1324	68	.00	.00	.00	.00	0.
1	0136	9	.66	.25	.41	641.	*	*	1	1336	69	.00	.00	.00	.00	0.
1	0148	10	.87	.27	.61	871.	*	*	1	1348	70	.00	.00	.00	.00	0.
1	0200	11	1.32	.31	1.01	1265.	*	*	1	1400	71	.00	.00	.00	.00	0.
1	0212	12	3.97	.57	3.41	2563.	*	*	1	1412	72	.00	.00	.00	.00	0.
1	0224	13	3.97	.31	3.67	4966.	*	*	1	1424	73	.00	.00	.00	.00	0.
1	0236	14	2.52	.13	2.39	6527.	*	*	1	1436	74	.00	.00	.00	.00	0.
1	0248	15	1.19	.05	1.14	6074.	*	*	1	1448	75	.00	.00	.00	.00	0.
1	0300	16	.93	.04	.89	4601.	*	*	1	1500	76	.00	.00	.00	.00	0.
1	0312	17	.82	.03	.79	3261.	*	*	1	1512	77	.00	.00	.00	.00	0.
1	0324	18	.74	.03	.72	2611.	*	*	1	1524	78	.00	.00	.00	.00	0.
1	0336	19	.69	.02	.67	2157.	*	*	1	1536	79	.00	.00	.00	.00	0.
1	0348	20	.64	.02	.62	1871.	*	*	1	1548	80	.00	.00	.00	.00	0.
1	0400	21	.58	.02	.57	1670.	*	*	1	1600	81	.00	.00	.00	.00	0.
1	0412	22	.53	.01	.52	1506.	*	*	1	1612	82	.00	.00	.00	.00	0.
1	0424	23	.50	.01	.49	1371.	*	*	1	1624	83	.00	.00	.00	.00	0.
1	0436	24	.48	.01	.47	1270.	*	*	1	1636	84	.00	.00	.00	.00	0.
1	0448	25	.46	.01	.44	1195.	*	*	1	1648	85	.00	.00	.00	.00	0.
1	0500	26	.43	.01	.42	1132.	*	*	1	1700	86	.00	.00	.00	.00	0.
1	0512	27	.41	.01	.40	1075.	*	*	1	1712	87	.00	.00	.00	.00	0.
1	0524	28	.40	.01	.39	1024.	*	*	1	1724	88	.00	.00	.00	.00	0.
1	0536	29	.39	.01	.38	981.	*	*	1	1736	89	.00	.00	.00	.00	0.
1	0548	30	.38	.01	.37	946.	*	*	1	1748	90	.00	.00	.00	.00	0.
1	0600	31	.37	.01	.36	917.	*	*	1	1800	91	.00	.00	.00	.00	0.
1	0612	32	.00	.00	.00	777.	*	*	1	1812	92	.00	.00	.00	.00	0.
1	0624	33	.00	.00	.00	469.	*	*	1	1824	93	.00	.00	.00	.00	0.
1	0636	34	.00	.00	.00	222.	*	*	1	1836	94	.00	.00	.00	.00	0.
1	0648	35	.00	.00	.00	106.	*	*	1	1848	95	.00	.00	.00	.00	0.
1	0700	36	.00	.00	.00	50.	*	*	1	1900	96	.00	.00	.00	.00	0.
1	0712	37	.00	.00	.00	23.	*	*	1	1912	97	.00	.00	.00	.00	0.
1	0724	38	.00	.00	.00	10.	*	*	1	1924	98	.00	.00	.00	.00	0.
1	0736	39	.00	.00	.00	4.	*	*	1	1936	99	.00	.00	.00	.00	0.
1	0748	40	.00	.00	.00	1.	*	*	1	1948	100	.00	.00	.00	.00	0.
1	0800	41	.00	.00	.00	0.	*	*	1	2000	101	.00	.00	.00	.00	0.
1	0812	42	.00	.00	.00	0.	*	*	1	2012	102	.00	.00	.00	.00	0.
1	0824	43	.00	.00	.00	0.	*	*	1	2024	103	.00	.00	.00	.00	0.
1	0836	44	.00	.00	.00	0.	*	*	1	2036	104	.00	.00	.00	.00	0.
1	0848	45	.00	.00	.00	0.	*	*	1	2048	105	.00	.00	.00	.00	0.
1	0900	46	.00	.00	.00	0.	*	*	1	2100	106	.00	.00	.00	.00	0.
1	0912	47	.00	.00	.00	0.	*	*	1	2112	107	.00	.00	.00	.00	0.
1	0924	48	.00	.00	.00	0.	*	*	1	2124	108	.00	.00	.00	.00	0.
1	0936	49	.00	.00	.00	0.	*	*	1	2136	109	.00	.00	.00	.00	0.
1	0948	50	.00	.00	.00	0.	*	*	1	2148	110	.00	.00	.00	.00	0.
1	1000	51	.00	.00	.00	0.	*	*	1	2200	111	.00	.00	.00	.00	0.
1	1012	52	.00	.00	.00	0.	*	*	1	2212	112	.00	.00	.00	.00	0.
1	1024	53	.00	.00	.00	0.	*	*	1	2224	113	.00	.00	.00	.00	0.
1	1036	54	.00	.00	.00	0.	*	*	1	2236	114	.00	.00	.00	.00	0.
1	1048	55	.00	.00	.00	0.	*	*	1	2248	115	.00	.00	.00	.00	0.
1	1100	56	.00	.00	.00	0.	*	*	1	2300	116	.00	.00	.00	.00	0.
1	1112	57	.00	.00	.00	0.	*	*	1	2312	117	.00	.00	.00	.00	0.
1	1124	58	.00	.00	.00	0.	*	*	1	2324	118	.00	.00	.00	.00	0.
1	1136	59	.00	.00	.00	0.	*	*	1	2336	119	.00	.00	.00	.00	0.
1	1148	60	.00	.00	.00	0.	*	*	1	2348	120	.00	.00	.00	.00	0.

TOTAL RAINFALL = 26.50, TOTAL LOSS = 4.53, TOTAL EXCESS = 21.97

PEAK FLOW + (CFS)	TIME (HR)	MAXIMUM AVERAGE FLOW		
		6-HR	24-HR	72-HR
+ 6527.	2.60	1767. (INCHES) 876. (AC-FT)	447. 21.971 879.	447. 21.971 879.
			23.80-HR	21.971 879.

CUMULATIVE AREA = .75 SQ MI


```

*****
*
*      LAKE      * INSTANTANEOUS RUNOFF FROM LAKE SURFACE
*
***** LAKE ONLY

SUBBASIN RUNOFF DATA

30 BA      SUBBASIN CHARACTERISTICS
            TAREA       .30    SUBBASIN AREA

31 BF      BASE FLOW CHARACTERISTICS
            STFTQ      20.00  INITIAL FLOW
            QRCNSN     .00    BEGIN BASE FLOW RECESSION
            RTIOR      1.00000 RECESSION CONSTANT

PRECIPITATION DATA

35 PT      TOTAL STORM STATIONS        10
0 PW      WEIGHTS                  1.00

33 PR      RECORDING STATIONS        10
34 PW      WEIGHTS                  1.00

32 LS      SCS LOSS RATE
            STRTL      .00    INITIAL ABSTRACTION
            CRVNBR     100.00 CURVE NUMBER
            RTIMP      .00    PERCENT IMPERVIOUS AREA

36 UD      SCS DIMENSIONLESS UNITGRAPH
            TLAG       .10    LAG

```

PRECIPITATION STATION DATA

STATION	TOTAL	AVG.	ANNUAL	WEIGHT
10	26.50		.00	1.00

TEMPORAL DISTRIBUTIONS

WARNING *** TIME INTERVAL IS GREATER THAN .29*LAG

UNIT HYDROGRAPH
5 END-OF-PERIOD ORDINATES

HYDROGRAPH AT STATION LAKE

```
*****
***
```

							*							*							
DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q	*	*	DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q				
1	0000	1	.00	.00	.00	20.	*	*	1	1200	61	.00	.00	.00	20.						
1	0012	2	.34	.00	.34	268.	*	*	1	1212	62	.00	.00	.00	20.						
1	0024	3	.37	.00	.37	356.	*	*	1	1224	63	.00	.00	.00	20.						
1	0036	4	.40	.00	.40	394.	*	*	1	1236	64	.00	.00	.00	20.						
1	0048	5	.45	.00	.45	441.	*	*	1	1248	65	.00	.00	.00	20.						
1	0100	6	.50	.00	.50	491.	*	*	1	1300	66	.00	.00	.00	20.						
1	0112	7	.56	.00	.56	543.	*	*	1	1312	67	.00	.00	.00	20.						
1	0124	8	.61	.00	.61	594.	*	*	1	1324	68	.00	.00	.00	20.						
1	0136	9	.66	.00	.66	645.	*	*	1	1336	69	.00	.00	.00	20.						
1	0148	10	.87	.00	.87	811.	*	*	1	1348	70	.00	.00	.00	20.						
1	0200	11	1.32	.00	1.32	1180.	*	*	1	1400	71	.00	.00	.00	20.						
1	0212	12	3.97	.00	3.97	3185.	*	*	1	1412	72	.00	.00	.00	20.						
1	0224	13	3.97	.00	3.97	3738.	*	*	1	1424	73	.00	.00	.00	20.						
1	0236	14	2.52	.00	2.52	2799.	*	*	1	1436	74	.00	.00	.00	20.						
1	0248	15	1.19	.00	1.19	1573.	*	*	1	1448	75	.00	.00	.00	20.						
1	0300	16	.93	.00	.93	1058.	*	*	1	1500	76	.00	.00	.00	20.						
1	0312	17	.82	.00	.82	865.	*	*	1	1512	77	.00	.00	.00	20.						
1	0324	18	.74	.00	.74	765.	*	*	1	1524	78	.00	.00	.00	20.						
1	0336	19	.69	.00	.69	705.	*	*	1	1536	79	.00	.00	.00	20.						
1	0348	20	.64	.00	.64	652.	*	*	1	1548	80	.00	.00	.00	20.						

1	0400	21	.58	.00	.58	600.	*	1	1600	81	.00	.00	.00	20.
1	0412	22	.53	.00	.53	549.	*	1	1612	82	.00	.00	.00	20.
1	0424	23	.50	.00	.50	517.	*	1	1624	83	.00	.00	.00	20.
1	0436	24	.48	.00	.48	492.	*	1	1636	84	.00	.00	.00	20.
1	0448	25	.46	.00	.46	468.	*	1	1648	85	.00	.00	.00	20.
1	0500	26	.43	.00	.43	447.	*	1	1700	86	.00	.00	.00	20.
1	0512	27	.41	.00	.41	427.	*	1	1712	87	.00	.00	.00	20.
1	0524	28	.40	.00	.40	410.	*	1	1724	88	.00	.00	.00	20.
1	0536	29	.39	.00	.39	398.	*	1	1736	89	.00	.00	.00	20.
1	0548	30	.38	.00	.38	388.	*	1	1748	90	.00	.00	.00	20.
1	0600	31	.37	.00	.37	379.	*	1	1800	91	.00	.00	.00	20.
1	0612	32	.00	.00	.00	112.	*	1	1812	92	.00	.00	.00	20.
1	0624	33	.00	.00	.00	38.	*	1	1824	93	.00	.00	.00	20.
1	0636	34	.00	.00	.00	23.	*	1	1836	94	.00	.00	.00	20.
1	0648	35	.00	.00	.00	20.	*	1	1848	95	.00	.00	.00	20.
1	0700	36	.00	.00	.00	20.	*	1	1900	96	.00	.00	.00	20.
1	0712	37	.00	.00	.00	20.	*	1	1912	97	.00	.00	.00	20.
1	0724	38	.00	.00	.00	20.	*	1	1924	98	.00	.00	.00	20.
1	0736	39	.00	.00	.00	20.	*	1	1936	99	.00	.00	.00	20.
1	0748	40	.00	.00	.00	20.	*	1	1948	100	.00	.00	.00	20.
1	0800	41	.00	.00	.00	20.	*	1	2000	101	.00	.00	.00	20.
1	0812	42	.00	.00	.00	20.	*	1	2012	102	.00	.00	.00	20.
1	0824	43	.00	.00	.00	20.	*	1	2024	103	.00	.00	.00	20.
1	0836	44	.00	.00	.00	20.	*	1	2036	104	.00	.00	.00	20.
1	0848	45	.00	.00	.00	20.	*	1	2048	105	.00	.00	.00	20.
1	0900	46	.00	.00	.00	20.	*	1	2100	106	.00	.00	.00	20.
1	0912	47	.00	.00	.00	20.	*	1	2112	107	.00	.00	.00	20.
1	0924	48	.00	.00	.00	20.	*	1	2124	108	.00	.00	.00	20.
1	0936	49	.00	.00	.00	20.	*	1	2136	109	.00	.00	.00	20.
1	0948	50	.00	.00	.00	20.	*	1	2148	110	.00	.00	.00	20.
1	1000	51	.00	.00	.00	20.	*	1	2200	111	.00	.00	.00	20.
1	1012	52	.00	.00	.00	20.	*	1	2212	112	.00	.00	.00	20.
1	1024	53	.00	.00	.00	20.	*	1	2224	113	.00	.00	.00	20.
1	1036	54	.00	.00	.00	20.	*	1	2236	114	.00	.00	.00	20.
1	1048	55	.00	.00	.00	20.	*	1	2248	115	.00	.00	.00	20.
1	1100	56	.00	.00	.00	20.	*	1	2300	116	.00	.00	.00	20.
1	1112	57	.00	.00	.00	20.	*	1	2312	117	.00	.00	.00	20.
1	1124	58	.00	.00	.00	20.	*	1	2324	118	.00	.00	.00	20.
1	1136	59	.00	.00	.00	20.	*	1	2336	119	.00	.00	.00	20.
1	1148	60	.00	.00	.00	20.	*	1	2348	120	.00	.00	.00	20.

TOTAL RAINFALL =		26.50, TOTAL LOSS =	.00, TOTAL EXCESS =	26.50		
PEAK FLOW		TIME	MAXIMUM AVERAGE FLOW			
+ (CFS)	(HR)		6-HR	24-HR	72-HR	23.80-HR
+ 3738.	2.40	(CFS)	869.	236.	236.	236.
		(INCHES)	26.923	28.959	28.959	28.959
		(AC-FT)	431.	463.	463.	463.

CUMULATIVE AREA = .30 SQ MIL

38 HC HYDROGRAPH COMBINATION
ICOMP 3 NUMBER OF HYDROGRAPHS TO COMBINE

六六六

HYDROGRAPH AT STATION IN
SUM OF 3 HYDROGRAPHS

DA MON HRMN ORD FLOW * DA MON HRMN ORD FLOW * DA MON HRMN ORD FLOW * DA MON HRMN ORD
FLOW * DA MON HRMN ORD FLOW * DA MON HRMN ORD FLOW * DA MON HRMN ORD FLOW * DA MON HRMN ORD
1 0000 1 20. * 1 0600 31 2663. * 1 1200 61 20. * 1 1800 91
20. 1 0012 2 268. * 1 0612 32 2148. * 1 1212 62 20. * 1 1812 92
20. 1 0024 3 356. * 1 0624 33 1513. * 1 1224 63 20. * 1 1824 93
20.

20.	1	0036	4	409.	*	1	0636	34	931.	*	1	1236	64	20.	*	1	1836	94
20.	1	0048	5	538.	*	1	0648	35	539.	*	1	1248	65	20.	*	1	1848	95
20.	1	0100	6	793.	*	1	0700	36	311.	*	1	1300	66	20.	*	1	1900	96
20.	1	0112	7	1165.	*	1	0712	37	186.	*	1	1312	67	20.	*	1	1912	97
20.	1	0124	8	1613.	*	1	0724	38	114.	*	1	1324	68	20.	*	1	1924	98
20.	1	0136	9	2102.	*	1	0736	39	73.	*	1	1336	69	20.	*	1	1936	99
20.	1	0148	10	2781.	*	1	0748	40	49.	*	1	1348	70	20.	*	1	1948	100
20.	1	0200	11	3949.	*	1	0800	41	36.	*	1	1400	71	20.	*	1	2000	101
20.	1	0212	12	8264.	*	1	0812	42	29.	*	1	1412	72	20.	*	1	2012	102
20.	1	0224	13	13339.	*	1	0824	43	25.	*	1	1424	73	20.	*	1	2024	103
20.	1	0236	14	16329.	*	1	0836	44	22.	*	1	1436	74	20.	*	1	2036	104
20.	1	0248	15	15821.	*	1	0848	45	20.	*	1	1448	75	20.	*	1	2048	105
20.	1	0300	16	13330.	*	1	0900	46	20.	*	1	1500	76	20.	*	1	2100	106
20.	1	0312	17	10536.	*	1	0912	47	20.	*	1	1512	77	20.	*	1	2112	107
20.	1	0324	18	8376.	*	1	0924	48	20.	*	1	1524	78	20.	*	1	2124	108
20.	1	0336	19	6907.	*	1	0936	49	20.	*	1	1536	79	20.	*	1	2136	109
20.	1	0348	20	5909.	*	1	0948	50	20.	*	1	1548	80	20.	*	1	2148	110
20.	1	0400	21	5186.	*	1	1000	51	20.	*	1	1600	81	20.	*	1	2200	111
20.	1	0412	22	4621.	*	1	1012	52	20.	*	1	1612	82	20.	*	1	2212	112
20.	1	0424	23	4179.	*	1	1024	53	20.	*	1	1624	83	20.	*	1	2224	113
20.	1	0436	24	3839.	*	1	1036	54	20.	*	1	1636	84	20.	*	1	2236	114
20.	1	0448	25	3571.	*	1	1048	55	20.	*	1	1648	85	20.	*	1	2248	115
20.	1	0500	26	3350.	*	1	1100	56	20.	*	1	1700	86	20.	*	1	2300	116
20.	1	0512	27	3158.	*	1	1112	57	20.	*	1	1712	87	20.	*	1	2312	117
20.	1	0524	28	2996.	*	1	1124	58	20.	*	1	1724	88	20.	*	1	2324	118
20.	1	0536	29	2863.	*	1	1136	59	20.	*	1	1736	89	20.	*	1	2336	119
20.	1	0548	30	2753.	*	1	1148	60	20.	*	1	1748	90	20.	*	1	2348	120
20.				*					*				*					

PEAK FLOW + (CFS)	TIME (HR)	MAXIMUM AVERAGE FLOW			
		6-HR	24-HR	72-HR	23.80-HR
+ 16329.	2.60	5184.	1340.	1340.	1340.
		(CFS)	(INCHES)	(INCHES)	(INCHES)
		22.843	23.422	23.422	23.422
		(AC-FT)	2571.	2636.	2636.

CUMULATIVE AREA = 2.11 SQ MI

* * * * *
39 KK * DAM * ROUTE FLOOD HYDROGRAPHS THRU FAD#2
* * * * *

STARTING POOL IS MAXIMUM OPERATING LEVEL
MAXIMUM TOP OF STOP LOG IS 972.5
STOP LOG WIDTH IS 4 FT

HYDROGRAPH ROUTING DATA

43 RS	STORAGE ROUTING		1 NUMBER OF SUBBREACHES FLOW TYPE OF INITIAL CONDITION 20.60 INITIAL CONDITION .00 WORKING R AND D COEFFICIENT							
	NSTPS	ITYP								
	RSVRIC	X								
44 SA	AREA	135.5	138.7	142.0	145.4	153.1	161.4	166.2	175.2	192.6

45 SE	ELEVATION	960.00	962.00	964.00	966.00	970.00	974.00	976.00	980.00	986.00
46 SQ 1247.	DISCHARGE	0.	5.	13.	25.	38.	53.	69.	300.	661.
		1776.	2299.	3334.	4362.	5365.	5965.	6365.		
48 SE 977.70	ELEVATION	972.50	973.00	973.50	974.00	974.50	975.00	975.50	976.27	976.89
		978.37	978.98	980.06	981.02	981.90	982.32	982.73		

50 SS	SPILLWAY	CREL	975.50	SPILLWAY CREST ELEVATION
		SPWID	.00	SPILLWAY WIDTH
		COQW	.00	WEIR COEFFICIENT
		EXPW	1.50	EXponent OF HEAD

51 ST	TOP OF DAM	TOPEL	983.00	ELEVATION AT TOP OF DAM
		DAMWID	.00	DAM WIDTH
		COQD	.00	WEIR COEFFICIENT
		EXPD	.00	EXponent OF HEAD

COMPUTED STORAGE-ELEVATION DATA

STORAGE	.00	274.19	554.89	842.28	1439.21	2068.14	2395.73	3078.45	4181.44
ELEVATION	960.00	962.00	964.00	966.00	970.00	974.00	976.00	980.00	986.00

COMPUTED STORAGE-OUTFLOW-ELEVATION DATA

(INCLUDING FLOW OVER DAM)

STORAGE	.00	274.19	554.89	842.28	1439.21	1828.40	1907.79	1987.70	2068.14	2149.14
OUTFLOW	.00	.00	.00	.00	.00	.00	.00	4.70	13.30	24.50
ELEVATION	960.00	962.00	964.00	966.00	970.00	972.50	973.00	973.50	974.00	974.50
STORAGE	2230.74	2312.93	2395.73	2440.69	2544.53	2681.49	2795.89	2900.93	3078.45	3088.97
OUTFLOW	52.70	69.20	218.74	299.50	660.80	1247.10	1776.00	2298.90	3276.78	3334.30
ELEVATION	975.00	975.50	976.00	976.27	976.89	977.70	978.37	978.98	980.00	980.06
STORAGE	3258.64	3416.47	3492.58	3567.37	4181.44					
OUTFLOW	4362.00	5364.50	5964.90	6365.20	10355.69					
ELEVATION	991.02	981.90	982.32	982.73	986.00					

HYDROGRAPH AT STATION DAM

*	*	*	*	*	*	*	*	*	*	*							
DA	MON	HRMN	ORD	OUTFLOW	STORAGE	STAGE	*	DA	MON	HRMN	ORD	OUTFLOW	STORAGE				
STAGE								STAGE									
1	0000	1	21.	2040.1	973.8 *	1	0800	41	1966.	2833.9	978.6 *	1	1600	81	225.	2399.1	
976.0	1	0012	2	2042.1	973.8 *	1	0812	42	1812.	2803.2	979.4 *	1	1612	82	219.	2395.7	
976.0	1	0024	3	2046.9	973.9 *	1	0824	43	1679.	2774.8	978.2 *	1	1624	83	213.	2392.5	
976.0	1	0036	4	2052.8	973.9 *	1	0836	44	1557.	2748.4	978.1 *	1	1636	84	207.	2389.4	
975.9	1	0048	5	2060.2	974.0 *	1	0848	45	1444.	2724.0	977.9 *	1	1648	85	202.	2386.3	
975.9	1	0100	6	2070.8	974.0 *	1	0900	46	1339.	2701.3	977.8 *	1	1700	86	196.	2383.4	
975.9	1	0112	7	2086.5	974.1 *	1	0912	47	1242.	2680.3	977.7 *	1	1712	87	191.	2380.5	
975.9	1	0124	8	2108.9	974.3 *	1	0924	48	1159.	2660.8	977.6 *	1	1724	88	186.	2377.7	
975.9	1	0136	9	2139.0	974.4 *	1	0936	49	1081.	2642.6	977.5 *	1	1736	89	181.	2375.0	
975.9	1	0148	10	2178.6	974.7 *	1	0948	50	1009.	2625.7	977.4 *	1	1748	90	177.	2372.4	
975.9	1	0200	11	2233.4	975.0 *	1	1000	51	941.	2609.9	977.3 *	1	1800	91	172.	2369.8	
975.8	1	0212	12	2333.3	975.6 *	1	1012	52	878.	2595.2	977.2 *	1	1812	92	168.	2367.3	
975.8	1	0224	13	529.	2506.6	978.7 *	1	1024	53	820.	2581.5	977.1 *	1	1824	93	163.	2364.9
975.8	1	0236	14	1495.	2735.0	978.0 *	1	1036	54	765.	2568.7	977.0 *	1	1836	94	159.	2362.6
975.8	1	0248	15	2661.	2966.4	979.4 *	1	1048	55	714.	2556.8	977.0 *	1	1848	95	155.	2360.3
975.8	1	0300	16	3739.	3155.5	980.4 *	1	1100	56	666.	2545.8	976.9 *	1	1900	96	151.	2358.1
975.8	1	0312	17	4529.	3284.7	981.2 *	1	1112	57	629.	2535.4	976.9 *	1	1912	97	147.	2356.0
975.8	1	0324	18	5021.	3362.1	981.6 *	1	1124	58	595.	2525.6	976.8 *	1	1924	98	143.	2353.9
975.7																	

1	0336	19	5280.	3403.1	981.8 *	1	1136	59	563.	2516.4	976.7 *	1	1936	99	140.	2351.9		
975.7			0348	20	5393.	3420.8	981.9 *	1	1148	60	533.	2507.6	976.7 *	1	1948	100	136.	2350.0
975.7	1		0400	21	5409.	3423.2	981.9 *	1	1200	61	504.	2499.4	976.6 *	1	2000	101	133.	2348.1
975.7	1		0412	22	5357.	3415.3	981.9 *	1	1212	62	477.	2491.6	976.6 *	1	2012	102	129.	2346.2
975.7	1		0424	23	5263.	3400.4	981.8 *	1	1224	63	451.	2484.3	976.5 *	1	2024	103	126.	2344.5
975.7	1		0436	24	5139.	3380.8	981.7 *	1	1236	64	427.	2477.3	976.5 *	1	2036	104	123.	2342.7
975.7	1		0448	25	4997.	3358.4	981.6 *	1	1248	65	405.	2470.8	976.5 *	1	2048	105	120.	2341.1
975.7	1		0500	26	4845.	3334.4	981.4 *	1	1300	66	383.	2464.6	976.4 *	1	2100	106	117.	2339.4
975.7	1		0512	27	4687.	3309.5	981.3 *	1	1312	67	363.	2458.8	976.4 *	1	2112	107	114.	2337.9
975.7	1		0524	28	4527.	3284.4	981.2 *	1	1324	68	343.	2453.3	976.3 *	1	2124	108	112.	2336.3
975.6	1		0536	29	4367.	3259.4	981.0 *	1	1336	69	325.	2448.1	976.3 *	1	2136	109	109.	2334.8
975.6	1		0548	30	4220.	3235.1	980.9 *	1	1348	70	308.	2443.2	976.3 *	1	2148	110	106.	2333.4
975.6	1		0600	31	4078.	3211.4	980.8 *	1	1400	71	296.	2438.5	976.3 *	1	2200	111	104.	2332.0
975.6	1		0612	32	3920.	3185.3	980.6 *	1	1412	72	288.	2434.0	976.2 *	1	2212	112	101.	2330.6
975.6	1		0624	33	3720.	3152.4	980.4 *	1	1424	73	280.	2429.7	976.2 *	1	2224	113	99.	2329.3
975.6	1		0636	34	3481.	3113.1	980.2 *	1	1436	74	272.	2425.4	976.2 *	1	2236	114	97.	2328.0
975.6	1		0648	35	3229.	3069.8	980.0 *	1	1448	75	265.	2421.3	976.2 *	1	2248	115	94.	2326.8
975.6	1		0700	36	2986.	3025.4	979.7 *	1	1500	76	258.	2417.3	976.1 *	1	2300	116	92.	2325.6
975.6	1		0712	37	2748.	2982.1	979.4 *	1	1512	77	251.	2413.5	976.1 *	1	2312	117	90.	2324.4
975.6	1		0724	38	2521.	2941.1	979.2 *	1	1524	78	244.	2409.7	976.1 *	1	2324	118	88.	2323.3
975.6	1		0736	39	2309.	2902.7	979.0 *	1	1536	79	237.	2406.1	976.1 *	1	2336	119	86.	2322.2
975.6	1		0748	40	2131.	2867.0	978.8 *	1	1548	80	231.	2402.5	976.0 *	1	2348	120	84.	2321.1
975.5					*						*							

PEAK OUTFLOW IS 5409. AT TIME 4.00 HOURS

PEAK FLOW + (CFS)	TIME (HR)	MAXIMUM AVERAGE FLOW			
		6-HR	24-HR	72-HR	23.80-HR
+ 5409.	4.00	3785.	1198.	1198.	1198.
		(CFS)	(INCHES)	(AC-FT)	
		16.677	20.947	20.947	20.947
		1877.	2357.	2357.	2357.
PEAK STORAGE + (AC-FT)	TIME (HR)	MAXIMUM AVERAGE STORAGE			
+ 3423.	4.00	3153.	2585.	2585.	2585.
PEAK STAGE + (FEET)	TIME (HR)	MAXIMUM AVERAGE STAGE			
+ 981.94	4.00	980.41	977.10	977.10	977.10
		CUMULATIVE AREA =	2.11 SQ MI		

OPERATION	STATION	PEAK FLOW	TIME OF PEAK	AVERAGE FLOW FOR MAXIMUM PERIOD			BASIN AREA	MAXIMUM STAGE	TIME OF MAX STAGE
				6-HOUR	24-HOUR	72-HOUR			
HYDROGRAPH AT	WEST	8174.	2.80	2588.	658.	658.	1.06		
HYDROGRAPH AT	EAST	6527.	2.60	1767.	447.	447.	.75		
HYDROGRAPH AT	LAKE	3738.	2.40	869.	236.	236.	.30		
3 COMBINED AT	IN	16329.	2.60	5184.	1340.	1340.	2.11		
ROUTED TO	DAM	5409.	4.00	3785.	1198.	1198.	2.11		

1
SUMMARY OF DAM OVERTOPPING/BREACH ANALYSIS FOR STATION 981.94 DAM
(PEAKS SHOWN ARE FOR INTERNAL TIME STEP USED DURING BREACH FORMATION) 4.00

PLAN 1
INITIAL VALUE SPILLWAY CREST TOP OF DAM
ELEVATION 973.83 975.50 983.00
STORAGE 2040. 2313. 3617.
OUTFLOW 21. 69. 6695.

RATIO OF PMF	MAXIMUM RESERVOIR W.S.ELEV	MAXIMUM DEPTH OVER DAM	MAXIMUM STORAGE AC-FT	MAXIMUM OUTFLOW CFS	DURATION OVER TOP HOURS	TIME OF MAX OUTFLOW HOURS	TIME OF FAILURE HOURS
1.00	981.94	.00	3423.	5409.	.00	4.00	.00

*** NORMAL END OF HEC-1 ***

981.94 < 983.0 ✓

```

1*****
***** FLOOD HYDROGRAPH PACKAGE (HEC-1) *****
* JUN 1998 *
* VERSION 4.1 *
* RUN DATE 22SEP12 TIME 16:46:48 *
*****
PMF, assume Service spillway is blocked.
***** U.S. ARMY CORPS OF ENGINEERS
***** HYDROLOGIC ENGINEERING CENTER
***** 609 SECOND STREET
***** DAVIS, CALIFORNIA 95616
***** (916) 756-1104
*****
```

```

X   X   XXXXXX  XXXXX   X
X   X   X       X   XX
X   X   X       X       X
XXXXXX XXXX  X       XXXXX  X
X   X   X       X       X
X   X   X       X   X   X
X   X   XXXXXX  XXXXX   XXX
```

THIS PROGRAM REPLACES ALL PREVIOUS VERSIONS OF HEC-1 KNOWN AS HEC1 (JAN 73), HEC1GS, HEC1DB, AND HEC1KW.

THE DEFINITIONS OF VARIABLES -RTIMP- AND -RTIOR- HAVE CHANGED FROM THOSE USED WITH THE 1973-STYLE INPUT STRUCTURE.
 THE DEFINITION OF -AMSKK- ON RM-CARD WAS CHANGED WITH REVISIONS DATED 28 SEP 81. THIS IS THE FORTRAN77 VERSION
 NEW OPTIONS: DAMBREAK OUTFLOW SUBMERGENCE, SINGLE EVENT DAMAGE CALCULATION, DSS:WRITE STAGE FREQUENCY,
 DSS:READ TIME SERIES AT DESIRED CALCULATION INTERVAL LOSS RATE:GREEN AND AMPT INFILTRATION
 KINEMATIC WAVE: NEW FINITE DIFFERENCE ALGORITHM

1	HEC-1 INPUT	PAGE 1
LINE	ID.....1.....2.....3.....4.....5.....6.....7.....8.....9.....10	
*** FREE ***		
1	ID CARDINAL FLY ASH DAM #2	
2	ID THIRD RAISING - CREST OF 983 FT	
3	ID DESIGN FLOOD PMP, 6-HR	
4	ID FILE: FAD2-PMP-105FT-noPS	
5	IT 12 0 0 120	
6	IO 1	
7	PG 10 26.5	
8	PC 0 .0130 .027 .042 .059 .078 .099 .122 .147 .18	
9	PC .23 .38 .53 .625 .67 .705 .736 .764 .79 .814	
10	PC .836 .856 .875 .8931 .9103 .9267 .9423 .9573 .9719 .9861	
11	PC 1.0	
12	KK WEST RUNOFF FROM FAD#1 WATERSHED	
13	KM RECLAIMED POND AND LANDFILL	
14	BA 1.06	
15	LS 0 75	
16	PR 10	
17	FW 1	
18	PT 10	
19	UD 0.52	
20	KK EAST RUNOFF FROM EAST WATERSHED	
21	KM WOODS ONLY	
22	BA 0.75	
23	LS 0 70	
24	PR 10	
25	PW 1	
26	PT 10	
27	UD 0.34	
28	KK LAKE INSTANTANEOUS RUNOFF FROM LAKE SURFACE	
29	KM LAKE ONLY	
30	BA 0.30	
31	BF 20	
32	LS 0 100	
33	PR 10	
34	PW 1	
35	PT 10	
36	UD 0.1	
37	KK IN COMBINE INFLOWS FROM WEST AND EAST WATERSHEDS AND LAKE SURFACE	
38	HC 3	
39	KK DAM ROUTE FLOOD HYDROGRAPHS THRU FAD#2	
40	KM STARTING POOL IS MAXIMUM OPERATING LEVEL	
41	KM ASSUME PRINCIPAL SPILLWAY IS BLOCKED	
42	RS 1 FLOW 20.6	

43	SA	135.5	138.7	142.0	145.4	153.1	161.4	166.2	175.2	192.6
44	SE	960	962	964	966	970	974	976	980	986
45	SQ	0	0	0	0	0	0	0	200	500
46	SQ	1500	2000	3000	4000	5000	5500	6000		
47	SE	972.5	973	973.5	974	974.5	975	975.5	976.27	976.89
48	SE	978.37	978.98	980.06	981.02	981.9	982.32	982.73		977.7
49	SS	975.5								

1

HEC-1 INPUT

PAGE 2

LINE ID.....1.....2.....3.....4.....5.....6.....7.....8.....9.....10

50 ST 983

51 ZZ

CRVNBR 75.00 CURVE NUMBER
RTIMP .00 PERCENT IMPERVIOUS AREA

19 UD SCS DIMENSIONLESS UNITGRAPH
TLAG .52 LAG

* *

PRECIPITATION STATION DATA

STATION	TOTAL	AVG. ANNUAL	WEIGHT
10	26.50	.00	1.00

TEMPORAL DISTRIBUTIONS

WARNING *** TIME INTERVAL IS GREATER THAN .29*LAG

UNIT HYDROGRAPH
15 END-OF-PERIOD ORDINATES

180.	607.	826.	719.	453.	259.	157.	92.	54.	32.
19.	11.	7.	4.	1.					

HYDROGRAPH AT STATION WEST

DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP	Q	*	DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP	Q
1	0000	1		.00	.00	.00	0.	*	*	1	1200	61	.00	.00	.00	.00	0.	
1	0012	2		.34	.34	.00	0.	*	1	1212	62	.00	.00	.00	.00	0.		
1	0024	3		.37	.37	.00	0.	*	1	1224	63	.00	.00	.00	.00	0.		
1	0036	4		.40	.35	.05	10.	*	1	1236	64	.00	.00	.00	.00	0.		
1	0048	5		.45	.31	.14	57.	*	1	1248	65	.00	.00	.00	.00	0.		
1	0100	6		.50	.28	.22	167.	*	1	1300	66	.00	.00	.00	.00	0.		
1	0112	7		.56	.25	.31	343.	*	1	1312	67	.00	.00	.00	.00	C.		
1	0124	8		.61	.22	.39	566.	*	1	1324	68	.00	.00	.00	.00	0.		
1	0136	9		.66	.19	.47	815.	*	1	1336	69	.00	.00	.00	.00	0.		
1	0148	10		.87	.20	.68	1100.	*	1	1348	70	.00	.00	.00	.00	0.		
1	0200	11		1.32	.23	1.10	1504.	*	1	1400	71	.00	.00	.00	.00	0.		
1	0212	12		3.97	.40	3.58	2516.	*	1	1412	72	.00	.00	.00	.00	0.		
1	0224	13		3.97	.21	3.77	4635.	*	1	1424	73	.00	.00	.00	.00	0.		
1	0236	14		2.52	.09	2.43	7003.	*	1	1436	74	.00	.00	.00	.00	0.		
1	0248	15		1.19	.03	1.16	8174.	*	1	1448	75	.00	.00	.00	.00	0.		
1	0300	16		.93	.02	.90	7671.	*	1	1500	76	.00	.00	.00	.00	0.		
1	0312	17		.82	.02	.80	6310.	*	1	1512	77	.00	.00	.00	.00	C.		
1	0324	18		.74	.02	.73	5000.	*	1	1524	78	.00	.00	.00	.00	0.		
1	0336	19		.69	.01	.67	4045.	*	1	1536	79	.00	.00	.00	.00	0.		
1	0348	20		.64	.01	.62	3386.	*	1	1548	80	.00	.00	.00	.00	0.		
1	0400	21		.58	.01	.57	2915.	*	1	1600	81	.00	.00	.00	.00	0.		
1	0412	22		.53	.01	.52	2566.	*	1	1612	82	.00	.00	.00	.00	0.		
1	0424	23		.50	.01	.49	2292.	*	1	1624	83	.00	.00	.00	.00	0.		
1	0436	24		.48	.01	.47	2077.	*	1	1636	84	.00	.00	.00	.00	0.		
1	0448	25		.46	.01	.45	1908.	*	1	1648	85	.00	.00	.00	.00	0.		
1	0500	26		.43	.01	.43	1771.	*	1	1700	86	.00	.00	.00	.00	0.		
1	0512	27		.41	.01	.41	1657.	*	1	1712	87	.00	.00	.00	.00	0.		
1	0524	28		.40	.01	.39	1562.	*	1	1724	88	.00	.00	.00	.00	0.		
1	0536	29		.39	.01	.38	1484.	*	1	1736	89	.00	.00	.00	.00	0.		
1	0548	30		.38	.01	.37	1419.	*	1	1748	90	.00	.00	.00	.00	0.		
1	0600	31		.37	.00	.36	1366.	*	1	1800	91	.00	.00	.00	.00	0.		
1	0612	32		.00	.00	.00	1258.	*	1	1812	92	.00	.00	.00	.00	0.		
1	0624	33		.00	.00	.00	1007.	*	1	1824	93	.00	.00	.00	.00	0.		
1	0636	34		.00	.00	.00	686.	*	1	1836	94	.00	.00	.00	.00	0.		
1	0648	35		.00	.00	.00	413.	*	1	1848	95	.00	.00	.00	.00	0.		
1	0700	36		.00	.00	.00	241.	*	1	1900	96	.00	.00	.00	.00	0.		
1	0712	37		.00	.00	.00	143.	*	1	1912	97	.00	.00	.00	.00	0.		
1	0724	38		.00	.00	.00	83.	*	1	1924	98	.00	.00	.00	.00	0.		
1	0736	39		.00	.00	.00	49.	*	1	1936	99	.00	.00	.00	.00	C.		
1	0748	40		.00	.00	.00	28.	*	1	1948	100	.00	.00	.00	.00	0.		
1	0800	41		.00	.00	.00	16.	*	1	2000	101	.00	.00	.00	.00	0.		
1	0812	42		.00	.00	.00	9.	*	1	2012	102	.00	.00	.00	.00	0.		
1	0824	43		.00	.00	.00	5.	*	1	2024	103	.00	.00	.00	.00	0.		
1	0836	44		.00	.00	.00	2.	*	1	2036	104	.00	.00	.00	.00	0.		
1	0848	45		.00	.00	.00	0.	*	1	2048	105	.00	.00	.00	.00	0.		
1	0900	46		.00	.00	.00	0.	*	1	2100	106	.00	.00	.00	.00	0.		
1	0912	47		.00	.00	.00	0.	*	1	2112	107	.00	.00	.00	.00	0.		

1	0924	48	.00	.00	.00	0.	*	1	2124	108	.00	.00	.00	0.
1	0936	49	.00	.00	.00	0.	*	1	2136	109	.00	.00	.00	0.
1	0948	50	.00	.00	.00	0.	*	1	2148	110	.00	.00	.00	0.
1	1000	51	.00	.00	.00	0.	*	1	2200	111	.00	.00	.00	0.
1	1012	52	.00	.00	.00	0.	*	1	2212	112	.00	.00	.00	0.
1	1024	53	.00	.00	.00	0.	*	1	2224	113	.00	.00	.00	0.
1	1036	54	.00	.00	.00	0.	*	1	2236	114	.00	.00	.00	0.
1	1048	55	.00	.00	.00	0.	*	1	2248	115	.00	.00	.00	0.
1	1100	56	.00	.00	.00	0.	*	1	2300	116	.00	.00	.00	0.
1	1112	57	.00	.00	.00	0.	*	1	2312	117	.00	.00	.00	0.
1	1124	58	.00	.00	.00	0.	*	1	2324	118	.00	.00	.00	0.
1	1136	59	.00	.00	.00	0.	*	1	2336	119	.00	.00	.00	0.
1	1148	60	.00	.00	.00	0.	*	1	2348	120	.00	.00	.00	0.

TOTAL RAINFALL = 26.50, TOTAL LOSS = 3.62, TOTAL EXCESS = 22.88

PEAK FLOW + (CFS)	TIME (HR)	MAXIMUM AVERAGE FLOW		
		6-HR	24-HR	72-HR
+ 8174.	2.80	2588. (INCHES) (AC-FT)	658. 22.881 1284.	658. 22.881 1294.
CUMULATIVE AREA = 1.06 SQ MI				

* * * * *
20 KK * EAST * RUNOFF FROM EAST WATERSHED
* * * * *

WOODS ONLY

SUBBASIN RUNOFF DATA

22 BA SUBBASIN CHARACTERISTICS
TAREA .75 SUBBASIN AREA

PRECIPITATION DATA

26 PT TOTAL STORM STATIONS 10
0 PW WEIGHTS 1.00

24 PR RECORDING STATIONS 10
25 PW WEIGHTS 1.00

23 LS SCS LOSS RATE
STRTL .86 INITIAL ABSTRACTION
CRVNR 70.00 CURVE NUMBER
RTIMP .00 PERCENT IMPERVIOUS AREA

27 UD SCS DIMENSIONLESS UNITGRAPH
TLAG .34 LAG

PRECIPITATION STATION DATA

STATION	TOTAL	AVG. ANNUAL	WEIGHT
10	26.50	.00	1.00

TEMPORAL DISTRIBUTIONS

STATION	10, WEIGHT = 1.00
.01	.01 .01 .02 .02 .02 .02 .02 .03 .03 .02 .02
.15	.15 .10 .05 .03 .03 .03 .03 .03 .03 .02 .02
.02	.02 .02 .02 .02 .02 .01 .01 .01 .01 .01 .01
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00

WARNING *** TIME INTERVAL IS GREATER THAN .29*LAG

UNIT HYDROGRAPH 10 END-OF-PERIOD ORDINATES									
329.	820.	669.	314.	153.	73.	34.	16.	8.	4.

HYDROGRAPH AT STATION EAST

DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP	Q	*	DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP	Q	
									*										
1	0000	1	.00	.00	0.	*	1	1200	61	.00	.00	.00	1	1212	62	.00	.00	0.	
1	0012	2	.34	.34	0.	*	1	1212	62	.00	.00	.00	1	1224	63	.00	.00	0.	
1	0024	3	.37	.37	0.	*	1	1224	63	.00	.00	.00	1	1236	64	.00	.00	0.	
1	0036	4	.40	.38	.01	5.	*	1	1248	65	.00	.00	.00	1	1248	65	.00	.00	0.
1	0048	5	.45	.36	.09	40.	*	1	1300	66	.00	.00	.00	1	1312	67	.00	.00	0.
1	0100	6	.50	.34	.17	134.	*	1	1312	67	.00	.00	.00	1	1324	68	.00	.00	0.
1	0112	7	.56	.31	.25	280.	*	1	1324	68	.00	.00	.00	1	1336	69	.00	.00	0.
1	0124	8	.61	.28	.33	454.	*	1	1336	69	.00	.00	.00	1	1348	70	.00	.00	0.
1	0136	9	.66	.25	.41	641.	*	1	1348	70	.00	.00	.00	1	1400	71	.00	.00	0.
1	0148	10	.87	.27	.61	871.	*	1	1400	71	.00	.00	.00	1	1412	72	.00	.00	0.
1	0200	11	1.32	.31	1.01	1265.	*	1	1412	72	.00	.00	.00	1	1424	73	.00	.00	0.
1	0212	12	3.97	.57	3.41	2563.	*	1	1424	73	.00	.00	.00	1	1436	74	.00	.00	0.
1	0224	13	3.97	.31	3.67	4966.	*	1	1448	75	.00	.00	.00	1	1448	75	.00	.00	0.
1	0236	14	2.52	.13	2.39	6527.	*	1	1500	76	.00	.00	.00	1	1512	77	.00	.00	0.
1	0248	15	1.19	.05	1.14	6074.	*	1	1512	77	.00	.00	.00	1	1524	78	.00	.00	0.
1	0300	16	.93	.04	.89	4601.	*	1	1524	78	.00	.00	.00	1	1536	79	.00	.00	0.
1	0312	17	.82	.03	.79	3361.	*	1	1536	79	.00	.00	.00	1	1548	80	.00	.00	0.
1	0324	18	.74	.03	.72	2611.	*	1	1548	80	.00	.00	.00	1	1600	81	.00	.00	0.
1	0336	19	.69	.02	.67	2157.	*	1	1600	81	.00	.00	.00	1	1612	82	.00	.00	0.
1	0348	20	.64	.02	.62	1871.	*	1	1612	82	.00	.00	.00	1	1624	83	.00	.00	0.
1	0400	21	.58	.02	.57	1670.	*	1	1624	83	.00	.00	.00	1	1636	84	.00	.00	0.
1	0412	22	.53	.01	.52	1506.	*	1	1636	84	.00	.00	.00	1	1648	85	.00	.00	0.
1	0424	23	.50	.01	.49	1371.	*	1	1648	85	.00	.00	.00	1	1700	86	.00	.00	0.
1	0436	24	.48	.01	.47	1270.	*	1	1700	86	.00	.00	.00	1	1712	87	.00	.00	0.
1	0448	25	.46	.01	.44	1195.	*	1	1712	87	.00	.00	.00	1	1724	88	.00	.00	0.
1	0500	26	.43	.01	.42	1132.	*	1	1724	88	.00	.00	.00	1	1736	89	.00	.00	0.
1	0512	27	.41	.01	.40	1075.	*	1	1736	89	.00	.00	.00	1	1748	90	.00	.00	0.
1	0524	28	.40	.01	.39	1024.	*	1	1748	90	.00	.00	.00	1	1800	91	.00	.00	0.
1	0536	29	.39	.01	.38	981.	*	1	1800	91	.00	.00	.00	1	1812	92	.00	.00	0.
1	0548	30	.38	.01	.37	946.	*	1	1812	92	.00	.00	.00	1	1824	93	.00	.00	0.
1	0600	31	.37	.01	.36	917.	*	1	1824	93	.00	.00	.00	1	1836	94	.00	.00	0.
1	0612	32	.00	.00	.00	777.	*	1	1836	94	.00	.00	.00	1	1848	95	.00	.00	0.
1	0624	33	.00	.00	.00	469.	*	1	1848	95	.00	.00	.00	1	1900	96	.00	.00	0.
1	0636	34	.00	.00	.00	222.	*	1	1900	96	.00	.00	.00	1	1912	97	.00	.00	0.
1	0648	35	.00	.00	.00	106.	*	1	1912	97	.00	.00	.00	1	1924	98	.00	.00	0.
1	0700	36	.00	.00	.00	50.	*	1	1924	98	.00	.00	.00	1	1936	99	.00	.00	0.
1	0712	37	.00	.00	.00	23.	*	1	1936	99	.00	.00	.00	1	1948	100	.00	.00	0.
1	0724	38	.00	.00	.00	10.	*	1	1948	100	.00	.00	.00	1	2000	101	.00	.00	0.
1	0736	39	.00	.00	.00	4.	*	1	2000	101	.00	.00	.00	1	2012	102	.00	.00	0.
1	0748	40	.00	.00	.00	1.	*	1	2012	102	.00	.00	.00	1	2024	103	.00	.00	0.
1	0800	41	.00	.00	.00	0.	*	1	2024	103	.00	.00	.00	1	2036	104	.00	.00	0.
1	0812	42	.00	.00	.00	0.	*	1	2036	104	.00	.00	.00	1	2048	105	.00	.00	0.
1	0824	43	.00	.00	.00	0.	*	1	2048	105	.00	.00	.00	1	2112	107	.00	.00	0.
1	0836	44	.00	.00	.00	0.	*	1	2112	107	.00	.00	.00	1	2124	108	.00	.00	0.
1	0848	45	.00	.00	.00	0.	*	1	2124	108	.00	.00	.00	1	2136	109	.00	.00	0.
1	0900	46	.00	.00	.00	0.	*	1	2136	109	.00	.00	.00	1	2148	110	.00	.00	0.
1	0912	47	.00	.00	.00	0.	*	1	2148	110	.00	.00	.00	1	2200	111	.00	.00	0.
1	0924	48	.00	.00	.00	0.	*	1	2200	111	.00	.00	.00	1	2212	112	.00	.00	0.
1	0936	49	.00	.00	.00	0.	*	1	2212	112	.00	.00	.00	1	2224	113	.00	.00	0.
1	0948	50	.00	.00	.00	0.	*	1	2224	113	.00	.00	.00	1	2236	114	.00	.00	0.
1	1000	51	.00	.00	.00	0.	*	1	2236	114	.00	.00	.00	1	2248	115	.00	.00	0.
1	1012	52	.00	.00	.00	0.	*	1	2248	115	.00	.00	.00	1	2300	116	.00	.00	0.
1	1024	53	.00	.00	.00	0.	*	1	2300	116	.00	.00	.00	1	2312	117	.00	.00	0.
1	1036	54	.00	.00	.00	0.	*	1	2312	117	.00	.00	.00	1	2324	118	.00	.00	0.
1	1048	55	.00	.00	.00	0.	*	1	2324	118	.00	.00	.00	1	2336	119	.00	.00	0.
1	1100	56	.00	.00	.00	0.	*	1	2336	119	.00	.00	.00	1	2348	120	.00	.00	0.
1	1112	57	.00	.00	.00	0.	*	1	2348	120	.00	.00	.00	1	2360	121	.00	.00	0.
1	1124	58	.00	.00	.00	0.	*	1	2360	121	.00	.00	.00	1	2372	122	.00	.00	0.
1	1136	59	.00	.00	.00	0.	*	1	2372	122	.00	.00	.00	1	2384	123	.00	.00	0.
1	1148	60	.00	.00	.00	0.	*	1	2384	123	.00	.00	.00	1	2396	124	.00	.00	0.

TOTAL RAINFALL =	26.50,	TOTAL LOSS =	4.53,	TOTAL EXCESS =	21.97
PEAK FLOW	TIME		MAXIMUM FLOW	AVERAGE FLOW	
+ (CFS)	(HR)		6-HR	24-HR	72-HR
+ 6527.	2.60	(CFS)	1767.	447.	447.
		(INCHES)	21.902	21.971	21.971
		(AC-FT)	876.	879.	879.
		CUMULATIVE AREA =	.75 SQ MI		

* * *
28 KK * LAKE * INSTANTANEOUS RUNOFF FROM LAKE SURFACE
* * *

LAKE ONLY

SUBBASIN RUNOFF DATA

30 BA SUBBASIN CHARACTERISTICS
TAREA .30 SUBBASIN AREA

31 BF BASE FLOW CHARACTERISTICS
STRTO 20.00 INITIAL FLOW
QRCSEN .00 BEGIN BASE FLOW RECESSION
RTIOR 1.00000 RECESSION CONSTANT

PRECIPITATION DATA

35 PT TOTAL STORM STATIONS 10
0 PW WEIGHTS 1.00

33 PR RECORDING STATIONS 10
34 PW WEIGHTS 1.00

32 LS SCS LOSS RATE
STRTL .00 INITIAL ABSTRACTION
CRVNBR 100.00 CURVE NUMBER
RTIMP .00 PERCENT IMPERVIOUS AREA

36 UD SCS DIMENSIONLESS UNITGRAPH
TLAG .10 LAG

PRECIPITATION STATION DATA

STATION	TOTAL	AVG. ANNUAL	WEIGHT
10	26.50	.00	1.00

TEMPORAL DISTRIBUTIONS

STATION	10, WEIGHT = 1.00
.01	.01 .01 .01 .02 .02 .02 .02 .02 .03 .03 .02 .02
.15	.15 .10 .05 .03 .03 .03 .03 .03 .01 .01 .01 .01
.02	.02 .02 .02 .02 .02 .02 .02 .02 .01 .01 .01 .01
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
.00	.00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00

WARNING *** TIME INTERVAL IS GREATER THAN .29*LAG

UNIT HYDROGRAPH
5 END-OF-PERIOD ORDINATES
719. 201. 40. 8. 0.

HYDROGRAPH AT STATION LAKE

DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q	*	DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q
1	0000	1	.00	.00	.00	.00	20.	*	1	1200	61	.00	.00	.00	.00	20.
1	0012	2	.34	.00	.34	.00	268.	*	1	1212	62	.00	.00	.00	.00	20.
1	0024	3	.37	.00	.37	.00	356.	*	1	1224	63	.00	.00	.00	.00	20.
1	0036	4	.40	.00	.40	.00	394.	*	1	1236	64	.00	.00	.00	.00	20.
1	0048	5	.45	.00	.45	.00	441.	*	1	1248	65	.00	.00	.00	.00	20.
1	0100	6	.50	.00	.50	.00	491.	*	1	1300	66	.00	.00	.00	.00	20.
1	0112	7	.56	.00	.56	.00	543.	*	1	1312	67	.00	.00	.00	.00	20.
1	0124	8	.61	.00	.61	.00	594.	*	1	1324	68	.00	.00	.00	.00	20.
1	0136	9	.66	.00	.66	.00	645.	*	1	1336	69	.00	.00	.00	.00	20.
1	0148	10	.87	.00	.87	.00	811.	*	1	1348	70	.00	.00	.00	.00	20.
1	0200	11	1.32	.00	1.32	.00	1180.	*	1	1400	71	.00	.00	.00	.00	20.
1	0212	12	3.97	.00	3.97	.00	3185.	*	1	1412	72	.00	.00	.00	.00	20.
1	0224	13	3.97	.00	3.97	.00	3738.	*	1	1424	73	.00	.00	.00	.00	20.
1	0236	14	2.52	.00	2.52	.00	2799.	*	1	1436	74	.00	.00	.00	.00	20.
1	0248	15	1.19	.00	1.19	.00	1573.	*	1	1448	75	.00	.00	.00	.00	20.
1	0300	16	.93	.00	.93	.00	1058.	*	1	1500	76	.00	.00	.00	.00	20.
1	0312	17	.82	.00	.82	.00	865.	*	1	1512	77	.00	.00	.00	.00	20.
1	0324	18	.74	.00	.74	.00	765.	*	1	1524	78	.00	.00	.00	.00	20.
1	0336	19	.69	.00	.69	.00	705.	*	1	1536	79	.00	.00	.00	.00	20.
1	0348	20	.64	.00	.64	.00	652.	*	1	1548	80	.00	.00	.00	.00	20.

1	0400	21	.58	.00	.58	600.	*	1	1600	81	.00	.00	.00	20.
1	0412	22	.53	.00	.53	549.	*	1	1612	82	.00	.00	.00	20.
1	0424	23	.50	.00	.50	517.	*	1	1624	83	.00	.00	.00	20.
1	0436	24	.48	.00	.48	492.	*	1	1636	84	.00	.00	.00	20.
1	0448	25	.46	.00	.46	468.	*	1	1648	85	.00	.00	.00	20.
1	0500	26	.43	.00	.43	447.	*	1	1700	86	.00	.00	.00	20.
1	0512	27	.41	.00	.41	427.	*	1	1712	87	.00	.00	.00	20.
1	0524	28	.40	.00	.40	410.	*	1	1724	88	.00	.00	.00	20.
1	0536	29	.39	.00	.39	398.	*	1	1736	89	.00	.00	.00	20.
1	0548	30	.38	.00	.38	388.	*	1	1748	90	.00	.00	.00	20.
1	0600	31	.37	.00	.37	379.	*	1	1800	91	.00	.00	.00	20.
1	0612	32	.30	.00	.30	112.	*	1	1812	92	.00	.00	.00	20.
1	0624	33	.00	.00	.00	38.	*	1	1824	93	.00	.00	.00	20.
1	0636	34	.00	.00	.00	23.	*	1	1836	94	.00	.00	.00	20.
1	0648	35	.00	.00	.00	20.	*	1	1848	95	.00	.00	.00	20.
1	0700	36	.00	.00	.00	20.	*	1	1900	96	.00	.00	.00	20.
1	0712	37	.00	.00	.00	20.	*	1	1912	97	.00	.00	.00	20.
1	0724	38	.00	.00	.00	20.	*	1	1924	98	.00	.00	.00	20.
1	0736	39	.00	.00	.00	20.	*	1	1936	99	.00	.00	.00	20.
1	0748	40	.00	.00	.00	20.	*	1	1948	100	.00	.00	.00	20.
1	0800	41	.00	.00	.00	20.	*	1	2000	101	.00	.00	.00	20.
1	0812	42	.00	.00	.00	20.	*	1	2012	102	.00	.00	.00	20.
1	0824	43	.00	.00	.00	20.	*	1	2024	103	.00	.00	.00	20.
1	0836	44	.00	.00	.00	20.	*	1	2036	104	.00	.00	.00	20.
1	0848	45	.00	.00	.00	20.	*	1	2048	105	.00	.00	.00	20.
1	0900	46	.00	.00	.00	20.	*	1	2100	106	.00	.00	.00	20.
1	0912	47	.00	.00	.00	20.	*	1	2112	107	.00	.00	.00	20.
1	0924	48	.00	.00	.00	20.	*	1	2124	108	.00	.00	.00	20.
1	0936	49	.00	.00	.00	20.	*	1	2136	109	.00	.00	.00	20.
1	0948	50	.00	.00	.00	20.	*	1	2148	110	.00	.00	.00	20.
1	1000	51	.00	.00	.00	20.	*	1	2200	111	.00	.00	.00	20.
1	1012	52	.00	.00	.00	20.	*	1	2212	112	.00	.00	.00	20.
1	1024	53	.00	.00	.00	20.	*	1	2224	113	.00	.00	.00	20.
1	1036	54	.00	.00	.00	20.	*	1	2236	114	.00	.00	.00	20.
1	1048	55	.00	.00	.00	20.	*	1	2248	115	.00	.00	.00	20.
1	1100	56	.00	.00	.00	20.	*	1	2300	116	.00	.00	.00	20.
1	1112	57	.00	.00	.00	20.	*	1	2312	117	.00	.00	.00	20.
1	1124	58	.00	.00	.00	20.	*	1	2324	118	.00	.00	.00	20.
1	1136	59	.00	.00	.00	20.	*	1	2336	119	.00	.00	.00	20.
1	1148	60	.00	.00	.00	20.	*	1	2348	120	.00	.00	.00	20.

TOTAL RAINFALL = 26.50, TOTAL LOSS = .00, TOTAL EXCESS = 26.50

PEAK FLOW + (CFS)	TIME (HR)	MAXIMUM AVERAGE FLOW			23.80-HR
		6-HR	24-HR	72-HR	
+ 3738.	2.40	869.	236.	236.	236.
		(INCHES) 26.923	28.959	28.959	28.959
		(AC-FT) 431.	463.	463.	463.

CUMULATIVE AREA = .30 SQ MI

* * * * *
37 KK * IN * COMBINE INFLOWS FROM WEST AND EAST WATERSHEDS AND LAKE SURFACE
* * * * *

38 HC HYDROGRAPH COMBINATION
ICOMP 3 NUMBER OF HYDROGRAPHS TO COMBINE

HYDROGRAPH AT STATION IN
SUM OF 3 HYDROGRAPHS

DA	MON	HRMN	ORD	FLOW	*	DA	MON	HRMN	ORD	FLOW	*	DA	MON	HRMN	ORD			
FLOW					*	DA	MON	HRMN	ORD	FLOW	*	DA	MON	HRMN	ORD			
20.	1	0000	1	20.	*	1	0600	31	2663.	*	1	1200	61	20.	*	1	1800	91
20.	1	0012	2	268.	*	1	0612	32	2148.	*	1	1212	62	20.	*	1	1812	92
20.	1	0024	3	356.	*	1	0624	33	1513.	*	1	1224	63	20.	*	1	1824	93

20.	1	0036	4	409.	*	1	0636	34	931.	*	1	1236	64	20.	*	1	1836	94
20.	1	0048	5	538.	*	1	0649	35	539.	*	1	1248	65	20.	*	1	1848	95
20.	1	0100	6	793.	*	1	0700	36	311.	*	1	1300	66	20.	*	1	1900	96
20.	1	0112	7	1165.	*	1	0712	37	186.	*	1	1312	67	20.	*	1	1912	97
20.	1	0124	8	1613.	*	1	0724	38	114.	*	1	1324	68	20.	*	1	1924	98
20.	1	0136	9	2102.	*	1	0736	39	73.	*	1	1336	69	20.	*	1	1936	99
20.	1	0148	10	2781.	*	1	0748	40	49.	*	1	1348	70	20.	*	1	1948	100
20.	1	0200	11	3949.	*	1	0800	41	36.	*	1	1400	71	20.	*	1	2000	101
20.	1	0212	12	8264.	*	1	0812	42	29.	*	1	1412	72	20.	*	1	2012	102
20.	1	0224	13	13339.	*	1	0824	43	25.	*	1	1424	73	20.	*	1	2024	103
20.	1	0236	14	16329.	*	1	0836	44	22.	*	1	1436	74	20.	*	1	2036	104
20.	1	0248	15	15821.	*	1	0848	45	20.	*	1	1448	75	20.	*	1	2048	105
20.	1	0300	16	13330.	*	1	0900	46	20.	*	1	1500	76	20.	*	1	2100	106
20.	1	0312	17	10536.	*	1	0912	47	20.	*	1	1512	77	20.	*	1	2112	107
20.	1	0324	18	8376.	*	1	0924	48	20.	*	1	1524	78	20.	*	1	2124	108
20.	1	0336	19	6907.	*	1	0936	49	20.	*	1	1536	79	20.	*	1	2136	109
20.	1	0348	20	5909.	*	1	0948	50	20.	*	1	1548	80	20.	*	1	2148	110
20.	1	0400	21	5186.	*	1	1000	51	20.	*	1	1600	81	20.	*	1	2200	111
20.	1	0412	22	4621.	*	1	1012	52	20.	*	1	1612	82	20.	*	1	2212	112
20.	1	0424	23	4179.	*	1	1024	53	20.	*	1	1624	83	20.	*	1	2224	113
20.	1	0436	24	3839.	*	1	1036	54	20.	*	1	1636	84	20.	*	1	2236	114
20.	1	0448	25	3571.	*	1	1048	55	20.	*	1	1648	85	20.	*	1	2248	115
20.	1	0500	26	3350.	*	1	1100	56	20.	*	1	1700	86	20.	*	1	2300	116
20.	1	0512	27	3158.	*	1	1112	57	20.	*	1	1712	87	20.	*	1	2312	117
20.	1	0524	28	2996.	*	1	1124	58	20.	*	1	1724	88	20.	*	1	2324	118
20.	1	0536	29	2863.	*	1	1136	59	20.	*	1	1736	89	20.	*	1	2336	119
20.	1	0548	30	2753.	*	1	1148	60	20.	*	1	1748	90	20.	*	1	2348	120
20.				*					*				*				*	

PEAK FLOW + (CFS)	TIME (HR)	MAXIMUM AVERAGE FLOW				
		6-HR	24-HR	72-HR	23.80-HR	
+ 16329.	2.60	(CFS) (INCHES) (AC-FT)	5184. 22.843 2571.	1340. 23.422 2636.	1340. 23.422 2636.	1340. 23.422 2636.

CUMULATIVE AREA = 2.11 SQ MI

* DAM * ROUTE FLOOD HYDROGRAPHS THRU FAD#2
* * * * *

STARTING POOL IS MAXIMUM OPERATING LEVEL
ASSUME PRINCIPAL SPILLWAY IS BLOCKED

HYDROGRAPH ROUTING DATA

42 RS	STORAGE ROUTING									
	NSTPS ITYP RSVRIC X	1 NUMBER OF SUBBREACHES								
		FLOW	TYPE OF INITIAL CONDITION							
		20.60	INITIAL CONDITION							
.00	WORKING R AND D COEFFICIENT									
43 SA	AREA	135.5	138.7	142.0	145.4	153.1	161.4	166.2	175.2	192.6
44 SE	ELEVATION	960.00	962.00	964.00	966.00	970.00	974.00	976.00	980.00	986.00

45 SQ 1000.	DISCHARGE	0.	0.	0.	0.	0.	0.	0.	200.	500.
		1500	3000	3000	4000	5000	5500	6000		

	ELEVATION	972.50	973.00	973.50	974.00	974.50	975.00	975.50	976.27	976.89
47 SE 977.70		978.37	978.98	980.06	981.02	981.98	982.32	982.73		

49 SS	SPILLWAY CREL 975.50 SPILLWAY CREST ELEVATION SPWID .00 SPILLWAY WIDTH COQW .00 WEIR COEFFICIENT EXPW 1.5C EXPONENT OF HEAD
-------	--

50 ST TOP OF DAM
TOPEL 983.00 ELEVATION AT TOP OF DAM
DAMWID .00 DAM WIDTH
COOD .00 WEIR COEFFICIENT
EXPD .00 EXPONENT OF HEAD

COMPUTED STORAGE-ELEVATION DATA

STORAGE	.00	274.19	554.89	842.28	1439.21	2068.14	2395.73	3078.45	4181.44
EL E V A T I O N	960.00	962.00	964.00	966.00	970.00	974.00	976.00	980.00	986.00

COMPUTED STORAGE-OUTFLOW-ELEVATION DATA

(INCLUDING FLOW OVER DAM)

STORAGE	.00	274.19	554.89	842.28	1439.21	1828.40	1907.79	1987.70	2068.14	2149.14
OUTFLOW	.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
ELEVATION	960.00	962.00	964.00	966.00	970.00	972.50	973.00	973.50	974.00	974.50
STORAGE	2230.74	2312.93	2395.73	2440.69	2544.53	2681.49	2795.89	2900.93	3078.45	3088.97
OUTFLOW	.00	.00	129.87	200.00	500.00	1000.00	1500.00	2000.00	2944.45	3000.00
ELEVATION	975.00	975.50	976.00	976.27	976.89	977.70	978.37	978.98	980.00	980.06
STORAGE	3259.64	3416.47	3492.58	3567.37	4181.44					
OUTFLOW	4000.00	5000.00	5500.00	6000.00	9988.09					
ELEVATION	981.02	981.90	982.32	982.73	986.00					

HYDROGRAPH AT STATION

1	0348	20	6059.	3576.2	982.8 *	1	1148	60	572.	2564.2	977.0 *	1	1948	100	136.	2399.4	
976.0	1	0400	21	6005.	3568.2	982.7 *	1	1200	61	540.	2555.4	977.0 *	1	2000	101	133.	2397.5
976.0	1	0412	22	5891.	3551.0	982.6 *	1	1212	62	509.	2547.0	976.9 *	1	2012	102	130.	2395.7
976.0	1	0424	23	5736.	3527.8	982.5 *	1	1224	63	484.	2539.1	976.9 *	1	2024	103	127.	2393.9
976.0	1	0436	24	5555.	3500.8	982.4 *	1	1236	64	463.	2531.6	976.8 *	1	2036	104	124.	2392.2
976.0	1	0448	25	5365.	3472.0	982.2 *	1	1248	65	442.	2524.5	976.8 *	1	2048	105	122.	2390.5
976.0	1	0500	26	5170.	3442.3	982.0 *	1	1300	66	423.	2517.7	976.7 *	1	2100	106	119.	2388.8
976.0	1	0512	27	4975.	3412.5	981.9 *	1	1312	67	404.	2511.2	976.7 *	1	2112	107	117.	2387.2
975.9	1	0524	28	4788.	3382.9	981.7 *	1	1324	68	386.	2505.0	976.7 *	1	2124	108	114.	2385.6
975.9	1	0536	29	4605.	3353.9	981.6 *	1	1336	69	369.	2499.1	976.6 *	1	2136	109	112.	2384.1
975.9	1	0548	30	4427.	3325.8	981.4 *	1	1348	70	353.	2493.4	976.6 *	1	2148	110	109.	2382.6
975.9	1	0600	31	4257.	3299.9	981.2 *	1	1400	71	337.	2488.1	976.6 *	1	2200	111	107.	2381.1
975.9	1	0612	32	4072.	3270.0	981.1 *	1	1412	72	322.	2482.9	976.5 *	1	2212	112	105.	2379.7
975.9	1	0624	33	3860.	3234.7	980.9 *	1	1424	73	308.	2478.1	976.5 *	1	2224	113	103.	2378.3
975.9	1	0636	34	3616.	3193.1	980.7 *	1	1436	74	295.	2473.4	976.5 *	1	2236	114	101.	2377.0
975.9	1	0648	35	3348.	3147.7	980.4 *	1	1448	75	282.	2469.0	976.4 *	1	2248	115	99.	2375.7
975.9	1	0700	36	3075.	3101.7	980.1 *	1	1500	76	270.	2464.7	976.4 *	1	2300	116	97.	2374.4
975.9	1	0712	37	2831.	3057.0	979.9 *	1	1512	77	258.	2460.7	976.4 *	1	2312	117	95.	2373.2
975.9	1	0724	38	2606.	3014.5	979.6 *	1	1524	78	247.	2456.9	976.4 *	1	2324	118	93.	2371.9
975.9	1	0736	39	2394.	2974.7	979.4 *	1	1536	79	236.	2453.2	976.3 *	1	2336	119	91.	2370.8
975.8	1	0748	40	2197.	2937.8	979.2 *	1	1548	80	226.	2449.7	976.3 *	1	2348	120	89.	2369.6
975.8						*					*						

PEAK OUTFLOW IS 6059. AT TIME 3.80 HOURS

PEAK FLOW + (CFS)	TIME (HR)	MAXIMUM AVERAGE FLOW			
		6-HR	24-HR	72-HR	23.80-HR
+ 6059.	3.80	4139.	1319.	1319.	1319.
		(CFS)	(INCHES)	(INCHES)	(INCHES)
		18.238	23.055	23.055	23.055
		(AC-FT)	2052.	2594.	2594.
PEAK STORAGE + (AC-FT)	TIME (HR)	MAXIMUM AVERAGE STORAGE			
+ 3576.	3.80	3268.	2678.	2678.	2678.
PEAK STAGE + (FEET)	TIME (HR)	MAXIMUM AVERAGE STAGE			
+ 982.78	3.80	981.06	977.64	977.64	977.64
		CUMULATIVE AREA =	2.11 SQ MI		

RUNOFF SUMMARY									
FLOW IN CUBIC FEET PER SECOND									
TIME IN HOURS, AREA IN SQUARE MILES									
OPERATION	STATION	PEAK FLOW	TIME OF PEAK	AVERAGE FLOW FOR MAXIMUM PERIOD			BASIN AREA	MAXIMUM STAGE	TIME OF MAX STAGE
				6-HOUR	24-HOUR	72-HOUR			
HYDROGRAPH AT	WEST	8174.	2.80	2588.	658.	658.	1.06		
HYDROGRAPH AT	EAST	6527.	2.60	1767.	447.	447.	.75		
HYDROGRAPH AT	LAKE	3738.	2.40	869.	236.	236.	.30		
3 COMBINED AT	IN	16329.	2.60	5184.	1340.	1340.	2.11		
ROUTED TO	DAM	6059.	3.80	4139.	1319.	1319.	2.11	982.78	3.80
SUMMARY OF DAM OVERTOPPING/BREACH ANALYSIS FOR STATION									DAM

(PEAKS SHOWN ARE FOR INTERNAL TIME STEP USED DURING BREACH FORMATION)

PLAN 1	INITIAL VALUE	SPILLWAY CREST	TOP OF DAM
ELEVATION	975.58	975.50	983.00
STORAGE	2326.	2313.	3617.
OUTFLOW	21.	0.	6329.

RATIO OF PMF	MAXIMUM RESERVOIR W.S.ELEV	MAXIMUM DEPTH OVER DAM	MAXIMUM STORAGE AC-FT	MAXIMUM OUTFLOW CFS	DURATION OVER TOP HOURS	TIME OF MAX OUTFLOW HOURS	TIME OF FAILURE HOURS
1.00	<u>982.78</u>	.00	3576.	6059.	.00	3.80	.00

*** NORMAL END OF HEC-1 ***

982.78 < 983.0 ✓

```

*****
*          * FLOOD HYDROGRAPH PACKAGE (HEC-1) *
*          JUN 1998      *      50-yr storm      *
*          VERSION 4.1   *      *
*          *          *      *
* RUN DATE 22SEP12 TIME 23:34:16 *      *
*          *          *      *
*****
```

```

X   X   XXXXXX  XXXXX      X
X   X   X       X   XX
X   X   X       X       X
XXXXXX XXXX  X   XXXXX  X
X   X   X       X       X
X   X   X       X   X   X
X   X   XXXXXX  XXXXX      XXX
```

THIS PROGRAM REPLACES ALL PREVIOUS VERSIONS OF HEC-1 KNOWN AS HEC1 (JAN 73), HEC1GS, HEC1DB, AND HEC1KW.

THE DEFINITIONS OF VARIABLES -RTIMP- AND -RTIOR- HAVE CHANGED FROM THOSE USED WITH THE 1973-STYLE INPUT STRUCTURE.
 THE DEFINITION OF -AMSKK- ON RM-CARD WAS CHANGED WITH REVISIONS DATED 28 SEP 81. THIS IS THE FORTRAN77 VERSION
 NEW OPTIONS: DAMBREAK OUTFLOW SUBMERGENCE , SINGLE EVENT DAMAGE CALCULATION, DSS:WRITE STAGE FREQUENCY,
 DSS:READ TIME SERIES AT DESIRED CALCULATION INTERVAL LOSS RATE:GREEN AND AMPT INFILTRATION
 KINEMATIC WAVE: NEW FINITE DIFFERENCE ALGORITHM

1	HEC-1 INPUT	PAGE 1
LINE	ID.....1.....2.....3.....4.....5.....6.....7.....8.....9.....10	
*** FREE ***		
1	ID CARDINAL FLY ASH DAM #2	
2	ID THIRD RAISING - CREST OF 983 FT	
3	ID DESIGN FLOOD 50 YR, 24-HR	
4	ID FILE: FAD2-50YR	
5	IT 49 0 0 100	
6	IO 1	
7	PG 10 4.51	
8	PC 0 .0130 .027 .042 .059 .078 .099 .122 .147 .18	
9	PC .23 .38 .53 .625 .67 .705 .736 .764 .79 .814	
10	PC .836 .956 .875 .8931 .9103 .9267 .9423 .9573 .9719 .9861	
11	PC 1.0	
12	KK WEST RUNOFF FROM FAD#1 WATERSHED	
13	KM RECLAIMED POND AND LANDFILL	
14	BA 1.06	
15	LS 0 75	
16	PR 10	
17	PW 1	
18	PT 10	
19	UD 0.52	
20	KK EAST RUNOFF FROM EAST WATERSHED	
21	KM WOODS ONLY	
22	BA 0.75	
23	LS 0 70	
24	PR 10	
25	PW 1	
26	PT 10	
27	UD 0.34	
28	KK LAKE INSTANTANEOUS RUNOFF FROM LAKE SURFACE	
29	KM LAKE ONLY	
30	BA 0.30	
31	BF 20	
32	LS 0 100	
33	PR 10	
34	PW 1	
35	PT 10	
36	UD 0.1	
37	KK IN COMBINE INFLOWS FROM WEST AND EAST WATERSHEDS AND LAKE SURFACE	
38	HC 3	
39	KK DAM ROUTE FLOOD HYDROGRAPHS THRU FAD#2	
40	KM STARTING POOL IS MAXIMUM OPERATING LEVEL	
41	KM MAXIMUM TOP OF STOP LOG IS 972.5	
42	KM STOP LOG WIDTH IS 4 FT	

RTIMP .00 PERCENT IMPERVIOUS AREA

19 UD SCS DIMENSIONLESS UNITGRAPH
TLAG .52 LAG

六

PRECIPITATION STATION DATA

STATION	TOTAL	AVG.	ANNUAL	WEIGHT
10	4.51	.00		1.00

TEMPORAL DISTRIBUTIONS

WARNING *** TIME INTERVAL IS GREATER THAN .29*LAG

UNIT HYDROGRAPH
5 END-OF-PERIOD ORDINATES

539.	240.	59.	14.	4.
------	------	-----	-----	----

HYDROGRAPH AT STATION WEST

```

*****
* DA MON HRMN ORD RAIN LOSS EXCESS COMP Q * DA MON HRMN ORD RAIN LOSS EXCESS COMP Q
* .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 0000 1 .00 .00 .00 0. * 2 1600 51 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 0048 2 .06 .06 .00 0. * 2 1648 52 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 0136 3 .06 .06 .00 0. * 2 1736 53 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 0224 4 .07 .07 .00 0. * 2 1824 54 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 0312 5 .08 .08 .00 0. * 2 1912 55 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 0400 6 .09 .09 .00 0. * 2 2000 56 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 0448 7 .09 .09 .00 0. * 2 2048 57 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 0536 8 .10 .10 .00 0. * 2 2136 58 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 0624 9 .11 .11 .00 0. * 2 2224 59 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 0712 10 .15 .14 .01 3. * 2 2312 60 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 0800 11 .23 .19 .03 18. * 3 0000 61 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 0848 12 .68 .46 .21 123. * 3 0048 62 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 0936 13 .68 .34 .34 235. * 3 0136 63 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 1024 14 .43 .17 .26 232. * 3 0224 64 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 1112 15 .20 .07 .13 155. * 3 0312 65 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 1200 16 .16 .05 .11 109. * 3 0400 66 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 1248 17 .14 .04 .10 89. * 3 0448 67 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 1336 18 .13 .04 .09 79. * 3 0536 68 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 1424 19 .12 .03 .08 73. * 3 0624 69 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 1512 20 .11 .03 .08 69. * 3 0712 70 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 1600 21 .10 .03 .07 64. * 3 0800 71 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 1648 22 .09 .02 .07 59. * 3 0848 72 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 1736 23 .09 .02 .06 56. * 3 0936 73 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 1824 24 .08 .02 .06 53. * 3 1024 74 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 1912 25 .08 .02 .06 51. * 3 1112 75 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 2000 26 .07 .02 .06 49. * 3 1200 76 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 2048 27 .07 .02 .05 47. * 3 1248 77 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 2136 28 .07 .02 .05 45. * 3 1336 78 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 2224 29 .07 .01 .05 44. * 3 1424 79 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
1 2312 30 .06 .01 .05 43. * 3 1512 80 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 0000 31 .06 .01 .05 42. * 3 1600 81 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 0048 32 .00 .00 .00 16. * 3 1648 82 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 0136 33 .00 .00 .00 4. * 3 1736 83 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 0224 34 .00 .00 .00 1. * 3 1824 84 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 0312 35 .00 .00 .00 0. * 3 1912 85 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 0400 36 .00 .00 .00 0. * 3 2000 86 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 0448 37 .00 .00 .00 0. * 3 2048 87 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 0536 38 .00 .00 .00 0. * 3 2136 88 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 0624 39 .00 .00 .00 0. * 3 2224 89 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 0712 40 .00 .00 .00 0. * 3 2312 90 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 0800 41 .00 .00 .00 0. * 4 0000 91 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 0848 42 .00 .00 .00 0. * 4 0048 92 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 0936 43 .00 .00 .00 0. * 4 0136 93 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 1024 44 .00 .00 .00 0. * 4 0224 94 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 1112 45 .00 .00 .00 0. + 4 0312 95 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 1200 46 .00 .00 .00 0. * 4 0400 96 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 1248 47 .00 .00 .00 0. * 4 0448 97 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 1336 48 .00 .00 .00 0. * 4 0536 98 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 1424 49 .00 .00 .00 0. * 4 0624 99 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00
2 1512 50 .00 .00 .00 0. * 4 0712 100 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00 .00

```


TOTAL RAINFALL = 4.51, TOTAL LOSS = 2.45, TOTAL EXCESS = 2.06

PEAK FLOW TIME MAXIMUM AVERAGE FLOW
+ (CFS) (HR) 6-HR 24-HR 72-HR 79.20-HR
+ 235. 9.60 (CFS)
+ (INCHES) 142. 59. 20. 18.
+ (AC-FT) 1.156 2.058 2.058 2.058
+ (AC-FT) 66. 116. 116. 116.

CUMULATIVE AREA = 1.06 SQ MI

* *
20 KK * EAST * RUNOFF FROM EAST WATERSHED
* *

WOODS ONLY

SUBBASIN RUNOFF DATA

22 BA SUBBASIN CHARACTERISTICS
TAREA .75 SUBBASIN AREA

PRECIPITATION DATA

26 PT TOTAL STORM STATIONS 10
0 PW WEIGHTS 1.00

24 PR RECORDING STATIONS 10
25 PW WEIGHTS 1.00

23 LS SCS LOSS RATE
STRTL .86 INITIAL ABSTRACTION
CRVNBR 70.00 CURVE NUMBER
RTIMP .00 PERCENT IMPERVIOUS AREA

27 UD SCS DIMENSIONLESS UNITGRAPH
TLAG .34 LAG

PRECIPITATION STATION DATA

STATION	TOTAL	AVG. ANNUAL	WEIGHT
10	4.51	.00	1.00

TEMPORAL DISTRIBUTIONS

STATION	10, WEIGHT = 1.00	.01	.01	.02	.02	.02	.02	.03	.05
.01	.01	.01	.02	.02	.02	.02	.02	.02	.02
.15	.15	.10	.05	.03	.03	.03	.03	.02	.02
.02	.02	.02	.02	.02	.02	.01	.01	.01	.01
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00
.00	.00	.00	.00	.00	.00	.00	.00	.00	.00

WARNING *** TIME INTERVAL IS GREATER THAN .29*LAG

UNIT HYDROGRAPH
S END-OF-PERIOD ORDINATES
449. 126. 25. 5. 0.

HYDROGRAPH AT STATION EAST

DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q	*	DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q
1	0000	1	.00	.00	.00	0.	*	*	2	1600	51	.00	.00	.00	0.	
1	0048	2	.06	.06	.00	0.	*	*	2	1648	52	.00	.00	.00	0.	
1	0136	3	.06	.06	.00	0.	*	*	2	1736	53	.00	.00	.00	0.	
1	0224	4	.07	.07	.00	0.	*	*	2	1824	54	.00	.00	.00	0.	
1	0312	5	.08	.08	.00	0.	*	*	2	1912	55	.00	.00	.00	0.	

1	0400	6	.09	.09	.00	0.	*	2	2000	56	.00	.00	.00	0.
1	0448	7	.09	.09	.00	0.	*	2	2048	57	.00	.00	.00	0.
1	0536	8	.10	.10	.00	0.	*	2	2136	58	.00	.00	.00	0.
1	0624	9	.11	.11	.00	0.	*	2	2224	59	.00	.00	.00	0.
1	0712	10	.15	.15	.00	0.	*	2	2312	60	.00	.00	.00	0.
1	0800	11	.23	.22	.01	3.	*	3	0000	61	.00	.00	.00	0.
1	0848	12	.68	.54	.14	62.	*	3	0048	62	.00	.00	.00	0.
1	0936	13	.68	.42	.26	135.	*	3	0136	63	.00	.00	.00	0.
1	1024	14	.43	.22	.21	132.	*	3	0224	64	.00	.00	.00	0.
1	1112	15	.20	.09	.11	83.	*	3	0312	65	.00	.00	.00	0.
1	1200	16	.16	.07	.09	61.	*	3	0400	66	.00	.00	.00	0.
1	1248	17	.14	.06	.08	52.	*	3	0448	67	.00	.00	.00	0.
1	1336	18	.13	.05	.08	47.	*	3	0536	68	.00	.00	.00	0.
1	1424	19	.12	.04	.07	45.	*	3	0624	69	.00	.00	.00	0.
1	1512	20	.11	.04	.07	42.	*	3	0712	70	.00	.00	.00	0.
1	1600	21	.10	.04	.06	39.	*	3	0800	71	.00	.00	.00	0.
1	1648	22	.09	.03	.06	36.	*	3	0848	72	.00	.00	.00	0.
1	1736	23	.09	.03	.06	35.	*	3	0936	73	.00	.00	.00	0.
1	1824	24	.08	.03	.05	33.	*	3	1024	74	.00	.00	.00	0.
1	1912	25	.08	.03	.05	32.	*	3	1112	75	.00	.00	.00	0.
1	2000	26	.07	.02	.05	31.	*	3	1200	76	.00	.00	.00	0.
1	2048	27	.07	.02	.05	30.	*	3	1248	77	.00	.00	.00	0.
1	2136	28	.07	.02	.05	29.	*	3	1336	78	.00	.00	.00	0.
1	2224	29	.07	.02	.05	28.	*	3	1424	79	.00	.00	.00	0.
1	2312	30	.06	.02	.04	27.	*	3	1512	80	.00	.00	.00	0.
2	0000	31	.06	.02	.04	27.	*	3	1600	81	.00	.00	.00	0.
2	0048	32	.00	.00	.00	7.	*	3	1648	82	.00	.00	.00	0.
2	0136	33	.00	.00	.00	1.	*	3	1736	83	.00	.00	.00	0.
2	0224	34	.00	.00	.00	0.	*	3	1824	84	.00	.00	.00	0.
2	0312	35	.00	.00	.00	0.	*	3	1912	85	.00	.00	.00	0.
2	0400	36	.00	.00	.00	0.	*	3	2000	86	.00	.00	.00	0.
2	0448	37	.00	.00	.00	0.	*	3	2048	87	.00	.00	.00	0.
2	0536	38	.00	.00	.00	0.	*	3	2136	88	.00	.00	.00	0.
2	0624	39	.00	.00	.00	0.	*	3	2224	89	.00	.00	.00	0.
2	0712	40	.00	.00	.00	0.	*	3	2312	90	.00	.00	.00	0.
2	0800	41	.00	.00	.00	0.	*	4	0000	91	.00	.00	.00	0.
2	0848	42	.00	.00	.00	0.	*	4	0048	92	.00	.00	.00	0.
2	0936	43	.00	.00	.00	0.	*	4	0136	93	.00	.00	.00	0.
2	1024	44	.00	.00	.00	0.	*	4	0224	94	.00	.00	.00	0.
2	1112	45	.00	.00	.00	0.	*	4	0312	95	.00	.00	.00	0.
2	1200	46	.00	.00	.00	0.	*	4	0400	96	.00	.00	.00	0.
2	1248	47	.00	.00	.00	0.	*	4	0448	97	.00	.00	.00	0.
2	1336	48	.00	.00	.00	0.	*	4	0536	98	.00	.00	.00	0.
2	1424	49	.00	.00	.00	0.	*	4	0624	99	.00	.00	.00	0.
2	1512	50	.00	.00	.00	0.	*	4	0712	100	.00	.00	.00	0.

TOTAL RAINFALL = 4.51, TOTAL LOSS = 2.83, TOTAL EXCESS = 1.68

PEAK FLOW + (CFS)	TIME (HR)	MAXIMUM AVERAGE FLOW			79.20-HR
		6-HR	24-HR	72-HR	
+ 135.	9.60	80.	34.	11.	10.
		(INCHES)	.931	1.681	1.681
		(AC-FT)	37.	67.	67.

CUMULATIVE AREA = .75 SQ MI

* LAKE * INSTANTANEOUS RUNOFF FROM LAKE SURFACE

LAKE ONLY

SUBBASIN RUNOFF DATA

30 BA SUBBASIN CHARACTERISTICS
TAREA .30 SUBBASIN AREA

31 BF BASE FLOW CHARACTERISTICS
STRTQ 20.00 INITIAL FLOW
QRCSN .00 BEGIN BASE FLOW RECEDITION
RTIOR 1.00000 RECESSION CONSTANT

PRECIPITATION DATA

35 PT TOTAL STORM STATIONS 10
0 PW WEIGHTS 1.00

33 PR RECORDING STATIONS 10
34 PW WEIGHTS 1.00

32 LS SCS LOSS RATE

STRTL .00 INITIAL ABSTRACTION
 CRVNBR 100.00 CURVE NUMBER
 RTIMP .00 PERCENT IMPERVIOUS AREA

36 UD SCS DIMENSIONLESS UNITGRAPH
 TLAG .10 LAG

PRECIPITATION STATION DATA

STATION	TOTAL	AVG. ANNUAL	WEIGHT
10	4.51	.00	1.00

TEMPORAL DISTRIBUTIONS

STATION	10, WEIGHT = 1.00	.01	.01	.02	.02	.02	.02	.02	.03	.05
		.15	.15	.10	.05	.03	.03	.03	.02	.02
		.02	.02	.02	.02	.02	.01	.01	.01	.01
		.00	.00	.00	.00	.00	.00	.00	.00	.00
		.00	.00	.00	.00	.00	.00	.00	.00	.00
		.00	.00	.00	.00	.00	.00	.00	.00	.00
		.00	.00	.00	.00	.00	.00	.00	.00	.00
		.00	.00	.00	.00	.00	.00	.00	.00	.00
		.00	.00	.00	.00	.00	.00	.00	.00	.00
		.00	.00	.00	.00	.00	.00	.00	.00	.00
		.00	.00	.00	.00	.00	.00	.00	.00	.00

WARNING *** TIME INTERVAL IS GREATER THAN .29*LAG

UNIT HYDROGRAPH
 5 END-OF-PERIOD ORDINATES
 180. 50. 10. 2. 0.

HYDROGRAPH AT STATION LAKE

DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q	*	DA	MON	HRMN	ORD	RAIN	LOSS	EXCESS	COMP Q
1	0000	1	.00	.00	.00	.00	20.	*	2	1600	51	.00	.00	.00	.00	20.
1	0048	2	.06	.00	.06	.00	31.	*	2	1648	52	.00	.00	.00	.00	20.
1	0136	3	.06	.00	.06	.00	34.	*	2	1736	53	.00	.00	.00	.00	20.
1	0224	4	.07	.00	.07	.00	36.	*	2	1824	54	.00	.00	.00	.00	20.
1	0312	5	.09	.00	.08	.00	38.	*	2	1912	55	.00	.00	.00	.00	20.
1	0400	6	.09	.00	.09	.00	40.	*	2	2000	56	.00	.00	.00	.00	20.
1	0448	7	.09	.00	.09	.00	42.	*	2	2048	57	.00	.00	.00	.00	20.
1	0536	8	.10	.00	.10	.00	44.	*	2	2136	58	.00	.00	.00	.00	20.
1	0624	9	.11	.00	.11	.00	47.	*	2	2224	59	.00	.00	.00	.00	20.
1	0712	10	.15	.00	.15	.00	54.	*	2	2312	60	.00	.00	.00	.00	20.
1	0800	11	.23	.00	.23	.00	69.	*	3	0000	61	.00	.00	.00	.00	20.
1	0848	12	.68	.00	.68	.00	155.	*	3	0048	62	.00	.00	.00	.00	20.
1	0936	13	.69	.00	.68	.00	178.	*	3	0136	63	.00	.00	.00	.00	20.
1	1024	14	.43	.00	.43	.00	138.	*	3	0224	64	.00	.00	.00	.00	20.
1	1112	15	.20	.00	.20	.00	86.	*	3	0312	65	.00	.00	.00	.00	20.
1	1200	16	.16	.00	.16	.00	64.	*	3	0400	66	.00	.00	.00	.00	20.
1	1248	17	.14	.00	.14	.00	56.	*	3	0448	67	.00	.00	.00	.00	20.
1	1336	18	.13	.00	.13	.00	52.	*	3	0536	68	.00	.00	.00	.00	20.
1	1424	19	.12	.00	.12	.00	49.	*	3	0624	69	.00	.00	.00	.00	20.
1	1512	20	.11	.00	.11	.00	47.	*	3	0712	70	.00	.00	.00	.00	20.
1	1600	21	.10	.00	.10	.00	45.	*	3	0800	71	.00	.00	.00	.00	20.
1	1648	22	.09	.00	.09	.00	43.	*	3	0848	72	.00	.00	.00	.00	20.
1	1736	23	.09	.00	.09	.00	41.	*	3	0936	73	.00	.00	.00	.00	20.
1	1824	24	.08	.00	.08	.00	40.	*	3	1024	74	.00	.00	.00	.00	20.
1	1912	25	.08	.00	.08	.00	39.	*	3	1112	75	.00	.00	.00	.00	20.
1	2000	26	.07	.00	.07	.00	38.	*	3	1200	76	.00	.00	.00	.00	20.
1	2048	27	.07	.00	.07	.00	37.	*	3	1248	77	.00	.00	.00	.00	20.
1	2136	28	.07	.00	.07	.00	37.	*	3	1336	78	.00	.00	.00	.00	20.
1	2224	29	.07	.00	.07	.00	36.	*	3	1424	79	.00	.00	.00	.00	20.
1	2312	30	.06	.00	.06	.00	36.	*	3	1512	80	.00	.00	.00	.00	20.
2	0000	31	.06	.00	.06	.00	35.	*	3	1600	81	.00	.00	.00	.00	20.
2	0048	32	.00	.00	.00	.00	24.	*	3	1648	82	.00	.00	.00	.00	20.
2	0136	33	.00	.00	.00	.00	21.	*	3	1736	83	.00	.00	.00	.00	20.
2	0224	34	.00	.00	.00	.00	20.	*	3	1824	84	.00	.00	.00	.00	20.
2	0312	35	.00	.00	.00	.00	20.	*	3	1912	85	.00	.00	.00	.00	20.
2	0400	36	.00	.00	.00	.00	20.	*	3	2000	86	.00	.00	.00	.00	20.
2	0448	37	.00	.00	.00	.00	20.	*	3	2048	87	.00	.00	.00	.00	20.
2	0536	38	.00	.00	.00	.00	20.	*	3	2136	88	.00	.00	.00	.00	20.
2	0624	39	.00	.00	.00	.00	20.	*	3	2224	89	.00	.00	.00	.00	20.
2	0712	40	.00	.00	.00	.00	20.	*	3	2312	90	.00	.00	.00	.00	20.
2	0800	41	.00	.00	.00	.00	20.	*	4	0000	91	.00	.00	.00	.00	20.
2	0848	42	.00	.00	.00	.00	20.	*	4	0048	92	.00	.00	.00	.00	20.
2	0936	43	.00	.00	.00	.00	20.	*	4	0136	93	.00	.00	.00	.00	20.
2	1024	44	.00	.00	.00	.00	20.	*	4	0224	94	.00	.00	.00	.00	20.
2	1112	45	.00	.00	.00	.00	20.	*	4	0312	95	.00	.00	.00	.00	20.
2	1200	46	.00	.00	.00	.00	20.	*	4	0400	96	.00	.00	.00	.00	20.
2	1248	47	.00	.00	.00	.00	20.	*	4	0448	97	.00	.00	.00	.00	20.
2	1336	48	.00	.00	.00	.00	20.	*	4	0536	98	.00	.00	.00	.00	20.
2	1424	49	.00	.00	.00	.00	20.	*	4	0624	99	.00	.00	.00	.00	20.

2 1512 50 .00 .00 .00 20. * 4 0712 100 .00 .00 .00 20.

TOTAL RAINFALL = 4.51, TOTAL LOSS = .00, TOTAL EXCESS = 4.51

PEAK FLOW + (CFS)	TIME (HR)	MAXIMUM AVERAGE FLOW				
		6-HR	24-HR	72-HR		
+ 178.	9.60	(CFS) (INCHES) (AC-FT)	107. 3.081 49.	56. 6,956 111.	32. 11,948 191.	31. 12,692 203.

CUMULATIVE AREA = .30 SQ MI

* * * * *
37 KK IN * COMBINE INFLOWS FROM WEST AND EAST WATERSHEDS AND LAKE SURFACE

38 HC HYDROGRAPH COMBINATION
ICOMP 3 NUMBER OF HYDROGRAPHS TO COMBINE

HYDROGRAPH AT STATION IN
SUM OF 3 HYDROGRAPHS

FLOW DA MON HRMN ORD	FLOW *	DA MON HRMN ORD	FLOW *	DA MON HRMN ORD	FLOW *	DA MON HRMN ORD	FLOW *	DA MON HRMN ORD																																																																															
									*	*	*	*	*	*	*	*																																																																							
20. 1 0000 1 20. *	1 2000 26 118. *	2 1600 51 20. *	3 1200 76	20. 1 0048 2 31. *	1 2048 27 114. *	2 1648 52 20. *	3 1248 77	20. 1 0136 3 34. *	1 2136 28 111. *	2 1736 53 20. *	3 1336 78	20. 1 0224 4 36. *	1 2224 29 108. *	2 1824 54 20. *	3 1424 79	20. 1 0312 5 38. *	1 2312 30 106. *	2 1912 55 20. *	3 1512 80	20. 1 0400 6 40. *	2 0000 31 105. *	2 2000 56 20. *	3 1600 81	20. 1 0448 7 42. *	2 0048 32 46. *	2 2048 57 20. *	3 1648 82	20. 1 0536 8 44. *	2 0136 33 26. *	2 2136 58 20. *	3 1736 83	20. 1 0624 9 47. *	2 0224 34 21. *	2 2224 59 20. *	3 1824 84	20. 1 0712 10 57. *	2 0312 35 20. *	2 2312 60 20. *	3 1912 85	20. 1 0900 11 91. *	2 0400 36 20. *	3 0000 61 20. *	3 2000 86	20. 1 0848 12 339. *	2 0448 37 20. *	3 0048 62 20. *	3 2048 87	20. 1 0936 13 547. *	2 0536 38 20. *	3 0136 63 20. *	3 2136 89	20. 1 1024 14 502. *	2 0624 39 20. *	3 0224 64 20. *	3 2224 89	20. 1 1112 15 324. *	2 0712 40 20. *	3 0312 65 20. *	3 2312 90	20. 1 1200 16 234. *	2 0800 41 20. *	3 0400 66 20. *	4 0000 91	20. 1 1248 17 197. *	2 0848 42 20. *	3 0448 67 20. *	4 0048 92	20. 1 1336 18 178. *	2 0936 43 20. *	3 0536 68 20. *	4 0136 93	20. 1 1424 19 167. *	2 1024 44 20. *	3 0624 69 20. *	4 0224 94	20. 1 1512 20 158. *	2 1112 45 20. *	3 0712 70 20. *	4 0312 95	20. 1 1600 21 148. *	2 1200 46 20. *	3 0800 71 20. *	4 0400 96	20. 1 1648 22 138. *	2 1248 47 20. *	3 0848 72 20. *	4 0448 97

20.	1	1736	23	132.	*	2	1336	48	20.	*	3	0936	73	20.	*	4	0536	98
20.	1	1824	24	127.	*	2	1424	49	20.	*	3	1024	74	20.	*	4	0624	99
20.	1	1912	25	122.	*	2	1512	50	20.	*	3	1112	75	20.	*	4	0712	100
20.				*			*		*			*		*				

PEAK FLOW + (CFS)	TIME (BR)	MAXIMUM AVERAGE FLOW				
		6-HR	24-HR	72-HR	79.20-HR	
+ 547.	9.60	(CFS) (INCHES) (AC-FT)	325. 1.339 151.	148. 2.612 294.	63. 3.330 375.	59. 3.436 387.
CUMULATIVE AREA = 2.111 SQ MI						

* * * * *
39 KK * DAM * ROUTE FLOOD HYDROGRAPHS THRU FAD#2
* * * * *

STARTING POOL IS MAXIMUM OPERATING LEVEL
MAXIMUM TOP OF STOP LOG IS 972.5
STOP LOG WIDTH IS 4 FT

HYDROGRAPH ROUTING DATA

43 RS	STORAGE ROUTING	NSTPS ITYP RSVRIC	1 FLOW 20.60	NUMBER OF SUBREACHES TYPE OF INITIAL CONDITION INITIAL CONDITION						
		X	.00	WORKING R AND D COEFFICIENT						
44 SA	AREA	135.5	138.7	142.0	145.4	153.1	161.4	166.2	175.2	192.6
45 SE	ELEVATION	960.00	962.00	964.00	966.00	970.00	974.00	976.00	980.00	986.00
46 SQ	DISCHARGE	0.	5.	13.	25.	38.	53.	69.		
47 SE	ELEVATION	972.50	973.00	973.50	974.00	974.50	975.00	975.50		
48 SS	SPILLWAY	CREL SPWID COQW EXPW	975.50 .00 .00 1.50	SPILLWAY CREST ELEVATION SPILLWAY WIDTH WEIR COEFFICIENT EXPOENT OF HEAD						
49 ST	TOP OF DAM	TOPEL DAMWID COOD EXPD	983.00 .00 .00 .00	ELEVATION AT TOP OF DAM DAM WIDTH WEIR COEFFICIENT EXPOENT OF HEAD						

COMPUTED STORAGE-ELEVATION DATA

STORAGE ELEVATION	.00 960.00	274.19 962.00	554.89 964.00	842.28 966.00	1439.21 970.00	2068.14 974.00	2395.73 976.00	3078.45 980.00	4181.44 986.00
----------------------	---------------	------------------	------------------	------------------	-------------------	-------------------	-------------------	-------------------	-------------------

COMPUTED STORAGE-OUTFLOW-ELEVATION DATA

(INCLUDING FLOW OVER DAM)

STORAGE ELEVATION	.00 960.00	274.19 962.00	554.89 964.00	842.28 966.00	1439.21 970.00	1828.40 974.00	1907.79 972.50	1987.70 973.00	2068.14 973.50	2149.14 974.00
OUTFLOW	.00	.00	.00	.00	.00	.00	4.70	13.30	24.50	37.70
STORAGE ELEVATION	52.70 975.00	2312.93 975.50	2395.73 976.00	3078.45 980.00	4181.44 986.00					
OUTFLOW	52.70	69.20	85.70	217.70	415.70					
ELEVATION	975.00	975.50	976.00	980.00	986.00					

HYDROGRAPH AT STATION DRN

* * *

STAGE	DA	MON	HRMN	ORD	OUTFLOW	STORAGE	STAGE *	DA	MON	HRMN	ORD	OUTFLOW	STORAGE	STAGE *	DA	MON	HRMN	ORD	OUTFLOW	STORAGE
						*							*							
1	0000	1		21.	2040.1	973.8 *	2	0312	35	57.	2249.9	975.1 *	3	0624	69	44.			2183.3	
1	0048	2		21.	2040.4	973.8 *	2	0400	36	56.	2247.6	975.1 *	3	0712	70	44.			2181.8	
1	0136	3		21.	2041.1	973.8 *	2	0448	37	56.	2245.2	975.1 *	3	0800	71	43.			2180.2	
1	0224	4		21.	2042.1	973.8 *	2	0536	38	55.	2242.9	975.1 *	3	0848	72	43.			2178.7	
1	0312	5		21.	2043.1	973.8 *	2	0624	39	55.	2240.6	975.1 *	3	0936	73	43.			2177.2	
1	0400	6		21.	2044.3	973.9 *	2	0712	40	54.	2238.3	975.0 *	3	1024	74	43.			2175.7	
1	0448	7		21.	2045.6	973.9 *	2	0800	41	54.	2236.1	975.0 *	3	1112	75	42.			2174.2	
1	0536	8		22.	2047.1	973.9 *	2	0848	42	53.	2233.8	975.0 *	3	1200	76	42.			2172.7	
1	0624	9		22.	2048.6	973.9 *	2	0936	43	53.	2231.7	975.0 *	3	1248	77	42.			2171.3	
1	0712	10		22.	2050.6	973.9 *	2	1024	44	52.	2229.5	975.0 *	3	1336	78	42.			2169.9	
1	0800	11		23.	2054.0	973.9 *	2	1112	45	52.	2227.4	975.0 *	3	1424	79	41.			2168.5	
1	0848	12		24.	2066.6	974.0 *	2	1200	46	52.	2225.3	975.0 *	3	1512	80	41.			2167.1	
1	0936	13		29.	2094.1	974.2 *	2	1248	47	51.	2223.2	975.0 *	3	1600	81	41.			2165.7	
1	1024	14		34.	2126.6	974.4 *	2	1336	48	51.	2221.2	974.9 *	3	1648	82	41.			2164.3	
1	1112	15		38.	2151.5	974.5 *	2	1424	49	51.	2219.1	974.9 *	3	1736	83	40.			2163.0	
1	1200	16		41.	2167.3	974.6 *	2	1512	50	50.	2217.1	974.9 *	3	1824	84	40.			2161.7	
1	1248	17		43.	2178.7	974.7 *	2	1600	51	50.	2215.2	974.9 *	3	1912	85	40.			2160.4	
1	1336	18		45.	2188.2	974.7 *	2	1648	52	49.	2213.2	974.9 *	3	2000	86	40.			2159.1	
1	1424	19		46.	2196.5	974.8 *	2	1736	53	49.	2211.3	974.9 *	3	2048	87	39.			2157.8	
1	1512	20		48.	2204.1	974.8 *	2	1824	54	49.	2209.4	974.9 *	3	2136	88	39.			2156.5	
1	1600	21		49.	2211.0	974.9 *	2	1912	55	48.	2207.5	974.9 *	3	2224	89	39.			2155.3	
1	1648	22		50.	2217.2	974.9 *	2	2000	56	48.	2205.6	974.8 *	3	2312	90	39.			2154.0	
1	1736	23		51.	2222.7	975.0 *	2	2048	57	48.	2203.8	974.8 *	4	0000	91	38.			2152.8	
1	1824	24		52.	2227.8	975.0 *	2	2136	58	47.	2202.0	974.8 *	4	0048	92	38.			2151.6	
1	1912	25		53.	2232.5	975.0 *	2	2224	59	47.	2200.2	974.8 *	4	0136	93	38.			2150.4	
1	2000	26		54.	2236.9	975.0 *	2	2312	60	47.	2198.4	974.8 *	4	0224	94	38.			2149.3	
1	2048	27		55.	2241.0	975.1 *	3	0000	61	46.	2196.6	974.8 *	4	0312	95	38.			2148.1	
1	2136	28		56.	2244.8	975.1 *	3	0048	62	46.	2194.9	974.8 *	4	0400	96	37.			2146.9	
1	2224	29		56.	2248.3	975.1 *	3	0136	63	46.	2193.2	974.8 *	4	0448	97	37.			2145.8	
1	2312	30		57.	2251.6	975.1 *	3	0224	64	46.	2191.5	974.8 *	4	0536	98	37.			2144.7	
2	0000	31		58.	2254.8	975.1 *	3	0312	65	45.	2189.8	974.7 *	4	0624	99	37.			2143.6	
2	0048	32		58.	2256.0	975.2 *	3	0400	66	45.	2188.2	974.7 *	4	0712	100	37.			2142.5	
2	0136	33		57.	2254.5	975.1 *	3	0448	67	45.	2186.5	974.7 *								
2	0224	34		57.	2252.3	975.1 *	3	0536	68	44.	2184.9	974.7 *								
				*									*							

PEAK OUTFLOW IS 58. AT TIME 24.80 HOURS

PEAK FLOW + (CFS)	TIME (HR)	(CFS)	MAXIMUM AVERAGE FLOW				
			6-HR	24-HR	72-HR	79.20-HR	
+ 58.	24.80		57.	54.	46.	43.	
		(INCHES)	.235	.949	2.412	2.524	
		(AC-FT)	26.	107.	271.	284.	
PEAK STORAGE + (AC-FT)	TIME (HR)		MAXIMUM AVERAGE STORAGE				
2256.	24.80		2252.	2236.	2191.	2178.	
PEAK STAGE + (FEET)	TIME (HR)		MAXIMUM AVERAGE STAGE				
975.15	24.80		975.13	975.03	974.76	974.68	

CUMULATIVE AREA = 2.11 SQ MI

1

RUNOFF SUMMARY FLOW IN CUBIC FEET PER SECOND TIME IN HOURS, AREA IN SQUARE MILES										
+	OPERATION	STATION	PEAK FLOW	TIME OF PEAK	AVERAGE FLOW FOR MAXIMUM PERIOD			BASIN AREA	MAXIMUM STAGE	TIME OF MAX STAGE
					6-HOUR	24-HOUR	72-HOUR			
+	HYDROGRAPH AT	WEST	235.	9.60	142.	59.	20.	1.06		
+	HYDROGRAPH AT	EAST	135.	9.60	80.	34.	11.	.75		
+	HYDROGRAPH AT	LAKE	178.	9.60	107.	56.	32.	.30		
+	3 COMBINED AT	IN	547.	9.60	325.	148.	63.	2.11		
+	ROUTED TO	DAM	58.	24.80	57.	54.	46.	2.11	975.15	24.80
1	SUMMARY OF DAM OVERTOPPING/BREACH ANALYSIS FOR STATION								DAM	
	(PEAKS SHOWN ARE FOR INTERNAL TIME STEP USED DURING BREACH FORMATION)									

PLAN 1		INITIAL VALUE		SPILLWAY CREST		TOP OF DAM			
		ELEVATION	973.83	SPILLWAY CREST	975.50	TOP OF DAM	983.00		
		STORAGE	2040.		2313.		3617.		
		OUTFLOW	21.		69.		317.		
		RATIO OF PMF	MAXIMUM RESERVOIR W.S.ELEV	MAXIMUM DEPTH OVER DAM	MAXIMUM STORAGE AC-FT	MAXIMUM OUTFLOW CFS	DURATION OVER TOP HOURS	TIME OF MAX OUTFLOW HOURS	TIME OF FAILURE HOURS
		1.00	975.15	.00	2256.	58.	.00	24.80	.00

*** NORMAL END OF HEC-1 ***

975.15 < 975.5 ✓